



Sky Air Alpha-series
Air Conditioning
Technical Data
RZAG-NV1



TABLE OF CONTENTS

RZAG-NV1

1	Features	4
	RZAG-NV1	4
2	Specifications	5
3	Electrical data	17
4	Options	23
5	Combination table	24
6	Capacity tables	25
	Cooling/Heating Capacity Tables	25
	Capacity Correction Factor	29
7	Dimensional drawings	30
8	Centre of gravity	31
9	Piping diagrams	32
	Piping Diagram Twin Application	33
	Piping Diagram Triple Application	34
	Piping Diagram Double Twin Application	35
10	Wiring diagrams	36
	Wiring Diagrams - Single Phase	36
11	Sound data	38
	Sound Power Spectrum	38
	Sound Pressure Spectrum - Cooling	40
	Sound Pressure Spectrum - Heating	42
	Sound Pressure Spectrum Quiet Mode Level 1	44
	Sound Pressure Spectrum Quiet Mode Level 2	46
	Sound Pressure Spectrum Quiet Mode Level 3	48
12	Installation	50
	Installation Method	50
13	Operation range	53
14	Appropriate Indoors	54

1 Features

1 - 1 RZAG-NV1

Industry leading technology in the most compact casing ever

1

- › Unique, low-height single fan range
- › Compact dimensions allow almost unnoticeable installation
- › Market-leading serviceability and handling, thanks to wide access area, 7-segment display and additional handle
- › Top efficiency: - Energy labels up to A++ in both cooling and heating - compressor offers substantial efficiency improvements
- › Choosing for an R-32 product, reduces the environmental impact with 68% compared to R-410A, leads directly to lower energy consumption thanks to its high energy efficiency and has a lower refrigerant charge
- › The perfect balance in efficiency and comfort thanks to Variable Refrigerant Temperature: top seasonal efficiency throughout most of the year and quick reaction speed on the hottest days.
- › Suits high sensible, infrastructure cooling applications
- › Replace existing systems with R-32 technology without needing to replace the piping
- › Guarantees operation in both heating and cooling mode down to -20°C
- › Refrigerant cooled PCB guarantees reliable cooling, as it is not influenced by ambient temperature.
- › Maximum piping length up to 85m
- › Outdoor units for pair, twin, triple, double twin application



Infrastructure cooling



Inverter



Auto cooling-heating changeover

2 Specifications

1 - 1 RZAG-NV1

Technical Specifications					RZAG71NV1	RZAG100NV1	RZAG125NV1	RZAG140NV1	
Casing	Colour	Ivory white							
	Material	Painted galvanized steel plate							
Dimensions	Unit	Height	mm	870					
		Width	mm	1,100					
		Depth	mm	460					
	Packed unit	Height	mm	1,050					
		Width	mm	1,205					
		Depth	mm	569					
Weight	Unit	kg	81	85	95				
	Packed unit	kg	92	95	106				
Packing	Weight	kg	10						
Heat exchanger	Fin	WF fin							
	Type Treatment	Anti-corrosion treatment (PE)							
Fan	Type	Propeller							
	Discharge direction	Horizontal							
	Quantity	1							
	Air flow rate	Cooling	Nom.	m ³ /min	68	67	80	87	
Heating			Nom.	m ³ /min	75	82	80	87	
Partial		m ³ /min	-	-	45 (1)				
Fan motor	Quantity	1							
	Model	Brushless DC motor							
	Output	W	234						
	Drive	Direct drive							
Compressor	Quantity	1							
	Type	Hermetically sealed swing compressor							
Operation range	Cooling	Ambient	Min.	°CDB	-20				
			Max.	°CDB	52				
	Heating	Ambient	Min.	°CWB	-20				
			Max.	°CWB	18				
Sound power level	Cooling		dB	64	66	69	70		
	Heating		dB	-	-	68 (1)	71 (1)		
Sound pressure level	Cooling	Nom.	dB	46	47	49	50		
	Heating	Nom.	dB	48	50	52			
Refrigerant	Type	R-32							
	Charge	kg	3.20			3.70			
	Charge	TCO ₂ Eq	2.16			2.50			
Refrigerant	Control	Expansion valve (electronic type)							
	GWP	675							
	Circuits	Quantity	1						
Refrigerant oil	Type	FW68DA							
	Charged volume	l	0.9			1.4			
Piping connections	Liquid	Quantity	1						
		Type	Flare connection						
	OD	mm	10						
		Quantity	1						
	Gas	Type	Flare connection						
		OD	mm	15.9					
	Drain	Quantity	8						
		Type	Hole						
	OD	mm	26						
		OU - IU	Min.	m	3				
	Max.		m	55	85				
	System	Equivalent	m	75	100				
		Chargeless	m	40					
	Additional refrigerant charge	kg/m	See installation manual						
	Level difference	IU - OU	Max.	m	30				
	Level difference	IU - IU		m	0.5				
Heat insulation	Both liquid and gas pipes								
Defrost method	Reversed cycle								
Defrost control	Sensor for outdoor heat exchanger temperature								
Capacity control	Method	Inverter controlled							
PED	Category	Category II							
	Most critical part	Name	Accumulator						
	Ps*V	Bar*l	136.5	143.0					
Safety devices	Item	01	High pressure switch						
		02	Low pressure switch						
	03	Fan driver overload protector							
	04	Fuse							
	05	Compressor motor thermal protector							

Standard accessories: Tie-wraps;Quantity: 2;

Standard accessories: Installation manual;Quantity: 1;

2 Specifications

1 - 1 RZAG-NV1

Standard accessories: General safety precautions;Quantity: 1;

Standard accessories: Peel off F-gas label;Quantity: 1;

Standard accessories: Refrigerant label for F-gas regulation;Quantity: 1;

2

Electrical Specifications			RZAG71NV1	RZAG100NV1	RZAG125NV1	RZAG140NV1
Power supply	Name		V1			
	Phase		1~			
	Frequency	Hz	50			
	Voltage	V	220-240			
	Voltage range	V	198 264			
Current	Zmax	List	Complies to EN61000-3-11			
Wiring connections	For power supply	Remark	See installation manual outdoor unit			
	For connection with indoor	Remark	See installation manual outdoor unit			
Power supply intake			See installation manual outdoor unit			
Current - 50Hz	Maximum fuse amps (MFA)	A	20	32		

(1)According to ENER Lot 21

Technical specifications			FCAHG71H + RZAG71NV1	FCAHG100H + RZAG71NV1	FCAHG100H + RZAG100NV1	FCAHG140H + RZAG100NV1	FCAHG125H + RZAG125NV1	FCAHG140H + RZAG140NV1
Cooling capacity	Nom.	kW	6.80 (1)		9.50 (1)		12.1 (1)	13.4 (1)
Heating capacity	Nom.	kW	7.50 (2)		10.8 (2)		13.5 (2)	15.5 (2)
Space cooling	Energy efficiency class		A++				-	
	Capacity Pdesign	kW	6.80		9.50		12.1	13.4
	SEER		7.90	7.05	7.70	7.49	8.02	7.93
	ηs,c	%	-				318	314
	Annual energy consumption	kWh/a	301	338	432	444	905	1,014
Space heating (Average climate)	Energy efficiency class		A++	A+	A++		-	
	Capacity Pdesign	kW	4.70		9.52			
	SCOP/A		4.61	4.20	4.75	4.70	4.53	4.44
	SCOPnet/A		4.61	4.20	4.75	4.70	4.53	4.44
	ηs,h	%	-				178	175
Annual energy consumption	kWh/a	1,427	1,567	2,805	2,836	2,943	3,002	
Required back up heating cap at design conditions	kW	0.00						

2 Specifications

1 - 1 RZAG-NV1

2

Technical specifications				FCAHG71H + RZAG71NV1	FCAHG100H + RZAG71NV1	FCAHG100H + RZAG100NV1	FCAHG140H + RZAG100NV1	FCAHG125H + RZAG125NV1	FCAHG140H + RZAG140NV1	
Space cooling	A Condi- tion (35°C -27/19)	Pdc	kW	6.80		9.50		12.10	13.40	
		EERd		4.13	4.14	4.23	4.04	3.84	3.68	
	B Condi- tion (30°C -27/19)	Pdc	kW	5.01	5.03	7.00	7.03	8.92	9.88	
		EERd		5.96	6.00	6.14	5.96	5.81	5.77	
	C Condi- tion (25°C -27/19)	Pdc	kW	0.84		1.14	1.18	1.54	1.71	
		EERd		3.22	3.20	4.50	4.46	5.74	6.35	
	D Condi- tion (20°C -27/19)	Pdc	kW	10.19	8.66	9.32	9.12	9.63	9.37	
		EERd		0.32	0.37	0.48	0.49	0.60	0.68	
	E Condi- tion (15°C -27/19)	Pdc	kW	2.64	2.72	3.71	3.59	3.61		
		EERd		14.60	10.83	12.87	12.38	13.99	14.07	
Space heating (Average climate)	TOL	Tol (temperature operating limit)	°C	-10						
		Pdh (declared heating cap)	kW	4.70		9.52				
		COPd (declared COP)		2.97	2.94	2.79	2.77	2.22	2.23	
		Power input	kW	1.58	1.60	3.42	3.43	4.29	4.27	
	TBivalent	Tbiv (bivalent temperature)	°C	-10						
		Pdh (declared heating cap)	kW	4.70		9.52				
		COPd (declared COP)		2.97	2.94	2.79	2.77	2.22	2.23	
		Power input	kW	1.58	1.60	3.42	3.43	4.29	4.27	
	A Condi- tion (-7°C)	Pdh (declared heating cap)	kW	4.16	4.14	8.42	8.38	8.42		
		COPd (declared COP)		3.32	3.30	3.14	3.13	2.84	2.80	
	Space heating (Average climate)	A Condi- tion (-7°C)	Power input	kW	1.25		2.69	2.68	2.97	3.01
			Pdh (declared heating cap)	kW	2.53	2.54	5.13	5.14	5.13	
		B Condi- tion (2°C)	COPd (declared COP)		4.57	4.30	4.79	4.76	4.58	4.42
			Power input	kW	0.55	0.59	1.07	1.08	1.12	1.16
C Condi- tion (7°C)		Pdh (declared heating cap)	kW	1.79	1.89	3.30	3.33	3.30		
		COPd (declared COP)		5.48	4.73	5.81	5.71	5.79	5.78	
D Condi- tion (12°C)		Power input	kW	0.33	0.40	0.57	0.58	0.57		
		Pdh (declared heating cap)	kW	2.01	2.11	2.58	2.60		6.60	
E Condi- tion (17°C)		COPd (declared COP)		7.02	5.75	6.86	6.64	6.62	6.60	
		Power input	kW	0.29	0.37	0.38	0.39			
Power consump- tion in other than active mode	Crank- case heater mode	Cooling PCK	kW	0.000						
		Heating PCK	kW	0.000						
	Off mode	Cooling POFF	kW	0.009						
		Heating POFF	kW	0.009						
	Standby mode	Cooling PSB	kW	0.009						
		Heating PSB	kW	0.009						
	Thermo- stat-off mode	Cooling PTO	kW	0.005						
		Heating PTO	kW	0.013						
	Indication if the heater is equipped with a supplementary heater (pair application)			No						
	Supplementary heater (pair application)	Back-up capacity	Heating elbu	kW	0.0					
Cooling	Cdc (Degradation cooling)		0.25							
Heating	Cdh (Degradation heating)		0.25							
Cooling function included			Yes							
Heating function included			Yes							
Average climate included			Yes							
Cold season included			No							
Warm season included			No							

(1)Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m. |

(2)Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

Technical specifications				FCAG71B + RZAG71NV1	FCAG100B + RZAG71NV1	FCAG100B + RZAG100NV1	FCAG140B + RZAG100NV1	FCAG125B + RZAG125NV1	FCAG140B + RZAG140NV1
Cooling capacity	Nom.	kW	6.80 (1)		9.50 (1)		12.1 (1)	13.4 (1)	
Heating capacity	Nom.	kW	7.50 (2)		10.8 (2)		13.5 (2)	15.5 (2)	
Space cooling	Energy efficiency class		A++						
	Capacity Pdesign	kW	6.80		9.50		12.1	13.4	
	SEER		6.83	7.50	7.14	7.86	7.15	6.80	
	ηs,c	%	-						
	Annual energy consumption	kWh/a	348	317	466	423	1,016	1,182	

2 Specifications

1 - 1 RZAG-NV1

Technical specifications				FCAG71B + RZAG71NV1	FCAG100B + RZAG71NV1	FCAG100B + RZAG100NV1	FCAG140B + RZAG100NV1	FCAG125B + RZAG125NV1	FCAG140B + RZAG140NV1	
Space heating (Average climate)	Energy efficiency class			A+			A++		-	
	Capacity	Pdesign	kW	4.70		7.80		9.52		
	SCOP/A			4.22	4.45	4.53	4.66	4.34		
	SCOPnet/A			4.22	4.45	4.53	4.66	4.34		
	ηs,h			-					171	
	Annual energy consumption			1,560	1,479	2,413	2,343	3,071		
	Required back up heating cap at design conditions						0.00			
Space cooling	A Condi- tion (35°C - 27/19)	Pdc	kW	6.80		9.50		12.10	13.40	
		EERd		3.54	4.14	3.59	4.13	3.32	3.12	
	B Condi- tion (30°C - 27/19)	Power input	kW	1.92	1.64	2.65	2.30	3.65	4.29	
		Pdc	kW	5.03		7.03		8.92	9.88	
	C Condi- tion (25°C - 27/19)	EERd		5.43	5.65	5.83	5.76	5.65	4.47	
		Power input	kW	0.93	0.89	1.21	1.22	1.58	2.21	
	D Condi- tion (20°C - 27/19)	Pdc	kW	3.20		4.46		5.74	6.35	
		EERd		8.32	9.57	8.18	9.72	7.87	8.17	
	E Condi- tion (15°C - 27/19)	Power input	kW	0.38	0.33	0.55	0.46	0.73	0.78	
		Pdc	kW	2.40	2.65	3.31	3.61	3.25	3.32	
	F Condi- tion (10°C - 27/19)	EERd		12.31	13.42	13.03	14.70	12.77	13.55	
		Power input	kW	0.20		0.25				
Space heating (Average climate)	TOL	Tol (temperature operating limit) °C						-10		
		Pdh (declared heating cap)	kW	4.70		7.80		9.52		
		COPd (declared COP)		2.54	2.88	2.51	2.73	1.91	1.93	
	TBivalent	Power input kW			1.85	1.63	3.11	2.85	4.98	4.93
		Tbiv (bivalent temperature) °C						-10		
		Pdh (declared heating cap)	kW	4.70		7.80		9.52		
	A Condi- tion (-7°C)	COPd (declared COP)			2.54	2.88	2.51	2.73	1.91	1.93
		Power input kW			1.85	1.63	3.11	2.85	4.98	4.93
		Pdh (declared heating cap) kW			4.13	4.14	6.86		8.43	8.42
	B Condi- tion (2°C)	COPd (declared COP)			2.96	3.25	2.87	3.04	2.59	2.52
		Power input kW			1.40	1.27	2.39	2.26	3.25	3.34
		Pdh (declared heating cap) kW			2.54		4.21		5.12	
C Condi- tion (7°C)	COPd (declared COP)			4.23	4.46	4.37	4.65	4.29	4.33	
	Power input kW			0.60	0.57	0.96	0.91	1.20	1.18	
	Pdh (declared heating cap) kW			1.77	1.80	2.73		3.29		
D Condi- tion (12°C)	COPd (declared COP)			5.11	5.30	6.01	5.82	5.92		
	Power input kW			0.35	0.34	0.45	0.47	0.56		
	Pdh (declared heating cap) kW			1.96	2.02	2.47	2.51	2.52	2.52	
E Condi- tion (17°C)	COPd (declared COP)			6.01	6.60	7.75	7.16	6.94		
	Power input kW			0.33	0.31	0.32	0.35	0.36		
	Pdh (declared heating cap) kW									
Power consump- tion in other than active mode	Crank- case heater mode	Cooling	PCK	kW				0.000		
		Heating	PCK	kW				0.000		
	Off mode	Cooling	POFF	kW				0.009		
		Heating	POFF	kW				0.009		
	Standby mode	Cooling	PSB	kW				0.009		
		Heating	PSB	kW				0.009		
	Thermo- stat-off mode	Cooling	PTO	kW				0.005		
Heating		PTO	kW				0.013			
Indication if the heater is equipped with a supplementary heater (pair application)							No			
Supplementary heater (pair appli- cation)	Back-up capacity	Heating	elbu	kW				0.0		
Cooling	Cdc (Degradation cooling)						0.25			
Heating	Cdh (Degradation heating)						0.25			
Cooling function included							Yes			
Heating function included							Yes			
Average climate included							Yes			
Cold season included							No			
Warm season included							No			

(1)Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m. |

(2)Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

2 Specifications

1 - 1 RZAG-NV1

Technical specifications				FBA71A9 + RZAG71NV1	FBA100A + RZAG71NV1	FBA100A + RZAG100NV1	FBA140A + RZAG100NV1	FBA125A + RZAG125NV1	FBA140A + RZAG140NV1	
Cooling capacity	Nom.	kW		6.80 (1)		9.50 (1)		12.1 (1)	13.4 (1)	
Heating capacity	Nom.	kW		7.50 (2)		10.8 (2)		13.5 (2)	15.5 (2)	
Space cooling	Energy efficiency class			A++	A+	A++		-		
	Capacity	Pdesign	kW	6.80		9.50		12.1	13.4	
	SEER			6.50	5.81	6.47	6.39	6.56	6.42	
	ηs,c		%	-		-		259	254	
	Annual energy consumption		kWh/a	366	410	514	520	1,107	1,252	
Space heating (Average climate)	Energy efficiency class			A+		-		-		
	Capacity	Pdesign	kW	4.70		7.80		9.52		
	SCOP/A			4.20	4.06	4.36	4.20	4.37	4.34	
	SCOPnet/A			4.20	4.06	4.36	4.20	4.37	4.34	
	ηs,h		%	-		-		172	171	
	Annual energy consumption		kWh/a	1,566	1,621	2,505	2,600	3,050	3,070	
	Required back up heating cap at design conditions		kW	-		0.00		-		
Space cooling	A Condi- tion (35°C -27/19)	Pdc EERd Power input	kW	6.80		9.50		12.10	13.40	
		EERd		3.40	4.15	3.69	4.18	3.27	2.86	
		Power input	kW	2.00	1.64	2.58	2.27	3.70	4.69	
	B Condi- tion (30°C -27/19)	Pdc EERd Power input	kW	5.03		7.03		8.92	9.88	
		EERd		5.07	4.39	4.92	4.69	4.95	4.64	
		Power input	kW	0.99	1.15	1.43	1.50	1.80	2.13	
	C Condi- tion (25°C -27/19)	Pdc EERd Power input	kW	3.20		4.46		5.74	6.35	
		EERd		7.94	7.06	7.80	7.62	7.45	7.47	
		Power input	kW	0.40	0.45	0.57	0.59	0.77	0.85	
	D Condi- tion (20°C -27/19)	Pdc EERd Power input	kW	2.44		3.33		3.66	3.34	3.50
		EERd		12.41	9.51	11.22	11.10	11.49	12.13	
		Power input	kW	0.20	0.28	0.30	0.33	0.29	0.29	
	Space heating (Average climate)	TOL	Tol (temperature operating limit)		°C		-10		-	
		Pdh (declared heating cap)	kW	4.70		7.80		9.52		
		COPd (declared COP)		2.50	2.69	2.46	2.52	1.97	2.01	
		Power input	kW	1.88	1.75	3.17	3.09	4.83	4.74	
TBivalent		Tbiv (bivalent temperature)		°C		-10		-		
		Pdh (declared heating cap)	kW	4.70		7.80		9.52		
		COPd (declared COP)		2.50	2.69	2.46	2.52	1.97	2.01	
		Power input	kW	1.88	1.75	3.17	3.09	4.83	4.74	
A Con- dition (-7°C)		Pdh (declared heating cap)	kW	4.14		6.87		8.42	8.43	
		COPd (declared COP)		2.92	3.04	2.82	2.80	2.67	2.58	
Space heating (Average climate)		A Con- dition (-7°C)	Power input	kW	1.42	1.36	2.43	2.45	3.15	3.26
	B Condi- tion (2°C)	Pdh (declared heating cap)	kW	2.54		4.21		5.12		
		COPd (declared COP)		4.21	4.10	4.33	4.20	4.37	4.32	
		Power input	kW	0.60	0.62	0.97	1.00	1.17	1.18	
	C Condi- tion (7°C)	Pdh (declared heating cap)	kW	1.76	1.83	2.73		3.29		
		COPd (declared COP)		5.12	4.74	5.47	5.16	5.76	5.83	
		Power input	kW	0.34	0.39	0.50	0.53	0.57		
	D Con- dition (12°C)	Pdh (declared heating cap)	kW	1.96	2.05	2.51	2.55		2.56	
		COPd (declared COP)		6.12	5.85	6.91	6.28	6.73	6.86	
		Power input	kW	0.32	0.35	0.36	0.41	0.38	0.37	
Power consump- tion in other than active mode	Crank- case heater mode	Cooling	PCK	kW	-		0.000		-	
		Heating	PCK	kW	-		0.000		-	
	Off mode	Cooling	POFF	kW	-		0.011		-	
		Heating	POFF	kW	-		0.011		-	
	Standby mode	Cooling	PSB	kW	-		0.011		-	
		Heating	PSB	kW	-		0.011		-	
	Thermo- stat-off mode	Cooling	PTO	kW	-		0.005		-	
		Heating	PTO	kW	-		0.015		-	
	Indication if the heater is equipped with a supplementary heater (pair application)						No			
	Supplementary heater (pair application)	Back-up capacity	Heating	elbu	kW			0.0		
Cooling	Cdc (Degradation cooling)					0.25				
Heating	Cdh (Degradation heating)					0.25				
Cooling function included						Yes				
Heating function included						Yes				
Average climate included						Yes				

2 Specifications

1 - 1 RZAG-NV1

Technical specifications	FBA71A9 + RZAG71NV1	FBA100A + RZAG71NV1	FBA100A + RZAG100NV1	FBA140A + RZAG100NV1	FBA125A + RZAG125NV1	FBA140A + RZAG140NV1
Cold season included						No
Warm season included						No

(1)Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m. |

(2)Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

Technical specifications				FDA125A + RZAG125NV1	
Cooling capacity	Nom.	kW		12.1 (1)	
Heating capacity	Nom.	kW		13.5 (2)	
Space cooling	Capacity Pdesign	kW		12.1	
	SEER			6.59	
	η _{s,c}	%		261	
	Annual energy consumption	kWh/a		1,102	
Space heating (Average climate)	Capacity Pdesign	kW		9.52	
	SCOP/A			4.35	
	SCOPnet/A			4.35	
	η _{s,h}	%		171	
	Annual energy consumption	kWh/a		3,064	
	Required back up heating cap at design conditions	kW		0.00	
Space cooling	A Condi- tion (35°C - 27/19)	Pdc EERd	kW	12.10	
				3.25	
		Power input	kW	3.73	
	B Condi- tion (30°C - 27/19)	Pdc EERd	kW	8.92	
				4.99	
		Power input	kW	1.79	
	C Condi- tion (25°C - 27/19)	Pdc EERd	kW	5.73	
				7.67	
		Power input	kW	0.75	
	D Condi- tion (20°C - 27/19)	Pdc EERd	kW	3.34	
				11.04	
		Power input	kW	0.30	
	Space heating (Average climate)	TOL	Tol (temperature operating limit)	°C	-10
			Pdh (declared heating cap)	kW	9.52
		COPd (declared COP)		1.99	
		Power input	kW	4.78	
TBivalent		Tbiv (bivalent temperature)	°C	-10	
		Pdh (declared heating cap)	kW	9.52	
		COPd (declared COP)		1.99	
		Power input	kW	4.78	
A Con- dition (-7°C)		Pdh (declared heating cap)	kW	8.42	
		COPd (declared COP)		2.69	
		Power input	kW	3.13	
B Condi- tion (2°C)		Pdh (declared heating cap)	kW	5.12	
Space heating (Average climate)		B Condi- tion (2°C)	COPd (declared COP)		4.33
			Power input	kW	1.18
	C Condi- tion (7°C)	Pdh (declared heating cap)	kW	3.29	
		COPd (declared COP)		5.73	
		Power input	kW	0.58	
	D Con- dition (12°C)	Pdh (declared heating cap)	kW	2.58	
		COPd (declared COP)		6.68	
		Power input	kW	0.39	
Power consump- tion in other than active mode	Crank- case heater mode	Cooling	PCK	kW	0.000
		Heating	PCK	kW	0.000
	Off mode	Cooling	POFF	kW	0.012
		Heating	POFF	kW	0.012
	Standby mode	Cooling	PSB	kW	0.012
		Heating	PSB	kW	0.012
	Thermo- stat-off mode	Cooling	PTO	kW	0.005
		Heating	PTO	kW	0.016
	Indication if the heater is equipped with a supplementary heater (pair application)				No
	Supplementary heater (pair appli- cation)	Back-up capacity	Heating elbu	kW	0.0
	Cooling	Cdc (Degradation cooling)			0.25
	Heating	Cdh (Degradation heating)			0.25
	Cooling function included				Yes

2 Specifications

1 - 1 RZAG-NV1

2

Technical specifications		FAA125A + RZAG125NV1
Heating function included		Yes
Average climate included		Yes
Cold season included		No
Warm season included		No

(1)Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m. |
 (2)Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

Technical specifications		FAA71B + RZAG71NV1	FAA100B + RZAG71NV1	FAA100B + RZAG100NV1			
Cooling capacity	Nom.	kW	6.80	6.80 (1)	9.50		
	Nom.	Btu/h	23,200	-	32,400		
	Nom.	kcal/h	5,847	-	8,169		
Heating capacity	Nom.	kW	7.50	7.50 (2)	10.80		
	Nom.	Btu/h	25,600	-	36,900		
	Nom.	kcal/h	6,449	-	9,286		
Power input	Cooling	Nom. kW	2.08	-	2.93		
	Heating	Nom. kW	2.19	-	3.41		
Nominal efficiency	EER		3.27	-	3.24		
	COP		3.42	-	3.17		
	Annual energy consumption	kWh	1,040	-	1,466		
	Energy labeling	Cooling	A	-	A		
	Energy labeling	Heating	B	-	D		
Space cooling	Energy efficiency class			A++			
	Capacity	Pdesign kW		6.80		9.50	
	SEER		6.58		6.43	6.42	
	Annual energy consumption	kWh/a	362		370	518	
Space heating (Average climate)	Energy efficiency class			A+			
	Capacity	Pdesign kW		4.70		7.80	
	SCOP/A		4.20		4.10	4.01	
	SCOPnet/A		4.20		4.10	4.01	
	Pdh Heating capacity at -10°	kW	4.70		-	7.80	
	Annual energy consumption	kWh/a	1,567		1,605	2,725	
	Required back up heating cap at design conditions	kW			0.00		
Space cooling	A Condi-	Pdc kW		6.80		9.50	
	tion (35°C	EERd	3.27		3.47	3.24	
	- 27/19)	Power input	2.08		1.96	2.93	
	B Condi-	Pdc kW	5.02		5.03	7.00	
	tion (30°C	EERd	5.04		5.22	4.59	
	- 27/19)	Power input	1.00		0.96	1.53	
	C Condi-	Pdc kW	3.23		3.20	4.51	
	tion (25°C	EERd	8.40		7.90	7.56	
	- 27/19)	Power input	0.38		0.40	0.60	
	D Condi-	Pdc kW	2.59		2.48	3.10	
	tion (20°C	EERd	11.70		10.59	13.20	
	- 27/19)	Power input	0.22			0.23	
Space heating (Average climate)	TOL	Tol (temperature operating limit)	°C		-10		
		Pdh (declared heating cap)	kW		4.70		7.80
		COPd (declared COP)		2.51		2.74	2.19
		Power input	kW	1.87		1.71	3.56
	TBivalent	Tbiv (bivalent temperature)	°C			-10	
		Pdh (declared heating cap)	kW		4.70		7.80
		COPd (declared COP)		2.51		2.74	2.19
		Power input	kW	1.87		1.71	3.56
	A Con-	Pdh (declared heating cap)	kW	4.16		4.14	6.91
	dition	COPd (declared COP)		2.60		3.07	2.32
	(-7°C)	Power input	kW	1.60		1.35	2.98
	B Condi-	Pdh (declared heating cap)	kW	2.57		2.54	4.20
	tion (2°C)	COPd (declared COP)		4.28		4.11	4.06
		Power input	kW	0.60		0.62	1.03
	C Condi-	Pdh (declared heating cap)	kW	1.83		1.79	2.70
	tion (7°C)	COPd (declared COP)		5.26		4.81	5.24
		Power input	kW	0.35		0.37	0.52
	D Con-	Pdh (declared heating cap)	kW	2.23		2.02	2.43
	dition	COPd (declared COP)		7.10		5.94	6.37
	(12°C)	Power input	kW	0.31		0.34	0.38

2 Specifications

1 - 1 RZAG-NV1

Technical specifications					FAA71B + RZAG71NV1	FAA100B + RZAG71NV1	FAA100B + RZAG100NV1
Power consumption in other than active mode	Crank-case heater mode	Cooling	PCK	kW	0.000		
		Heating	PCK	kW	0.000		
	Off mode	Cooling	POFF	kW	0.009		
		Heating	POFF	kW	0.009		
	Standby mode	Cooling	PSB	kW	0.009		
		Heating	PSB	kW	0.009		
	Thermo-stat-off mode	Cooling	PTO	kW	0.005		
		Heating	PTO	kW	0.013		
Indication if the heater is equipped with a supplementary heater (pair application)					-	No	-
Supplementary heater (pair application)					-	0.0	-
Cooling Cdc (Degradation cooling)					0.25		
Heating Cdh (Degradation heating)					0.25		
Cooling function included					Yes		
Heating function included					Yes		
Average climate included					Yes		
Cold season included					No		
Warm season included					No		
Eurovent	Sound power level outdoor	Cooling	Nom.	dBa	64	-	66
		Heating	Nom.	dBa	61	-	65
	Piping length	Cooling	Measuring condition	m	7.50	-	-

(1)Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m. |

(2)Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

Technical specifications				FHA71A9 + RZAG71NV1	FHA100A + RZAG71NV1	FHA100A + RZAG100NV1	FHA140A + RZAG100NV1	FHA125A + RZAG125NV1	FHA140A + RZAG140NV1	
Cooling capacity	Nom.		kW	6.80 (1)		9.50 (1)		12.1 (1)	13.4 (1)	
Heating capacity	Nom.		kW	7.50 (2)		10.8 (2)		13.5 (2)	15.5 (2)	
Space cooling	Energy efficiency class			A++						
	Capacity	Pdesign	kW	6.80		9.50		12.1	13.4	
	SEER			7.11	6.69	6.42	7.35	7.14	6.42	
	ηs,c		%	-		-		283	254	
	Annual energy consumption			kWh/a	335	356	518	453	1,017	1,253
Space heating (Average climate)	Energy efficiency class			A+						
	Capacity	Pdesign	kW	4.70		7.80		9.52		
	SCOP/A			4.32	4.26	4.61	4.50	4.20	4.30	
	SCOPnet/A			4.32	4.26	4.61	4.50	4.20	4.30	
	ηs,h		%	-		-		165	169	
	Annual energy consumption			kWh/a	1,523	1,545	2,369	2,429	3,174	3,100
	Required back up heating cap at design conditions			kW	0.00					
Space cooling	A Condi- tion (35°C -27/19)	Pdc	kW	6.80		9.50		12.10	13.40	
		EERd		3.75	4.02	4.10	4.05	3.40	3.11	
	B Condi- tion (30°C -27/19)	Power input	kW	1.81	1.69	2.31	2.34	3.56	4.31	
		Pdc	kW	5.03		7.03		8.92	9.87	
	C Condi- tion (25°C -27/19)	EERd		5.46	5.34	4.92	6.03	5.55	4.94	
		Power input	kW	0.92	0.94	1.43	1.17	1.61	2.00	
	D Condi- tion (20°C -27/19)	Pdc	kW	3.20		4.47		5.73	6.35	
		EERd		8.99	8.27	7.62	8.88	8.20	7.48	
	E Condi- tion (15°C -27/19)	Power input	kW	0.36	0.39	0.59	0.50	0.70	0.85	
		Pdc	kW	2.48	2.62	3.54	3.61	3.36	3.35	
F Condi- tion (10°C -27/19)	EERd		12.58	10.71	10.27	11.63	12.00	10.13		
	Power input	kW	0.20	0.24	0.34	0.31	0.28	0.33		

2 Specifications

1 - 1 RZAG-NV1

2

Technical specifications				FHA71A9 + RZAG71NV1	FHA100A + RZAG71NV1	FHA100A + RZAG100NV1	FHA140A + RZAG100NV1	FHA125A + RZAG125NV1	FHA140A + RZAG140NV1	
Space heating (Average climate)	TOL	Tol (temperature operating limit) °C		-10						
		Pdh (declared heating cap) kW	4.70		7.80		9.52			
		COPd (declared COP)	2.43	2.90	2.65	2.85	1.87	2.13		
	TBivalent	Power input kW	1.93	1.62	2.94	2.73	5.10	4.47		
		Tbiv (bivalent temperature) °C	-10							
		Pdh (declared heating cap) kW	4.70		7.80		9.52			
	A Condi- tion (-7°C)	COPd (declared COP)	2.43	2.90	2.65	2.85	1.87	2.13		
		Power input kW	1.93	1.62	2.94	2.73	5.10	4.47		
		Pdh (declared heating cap) kW	4.14		6.86		8.42			
	Space heating (Average climate)	A Condi- tion (-7°C)	COPd (declared COP)	2.95	3.26	3.03	3.15	2.55	2.70	
Power input kW			1.40	1.27	2.27	2.18	3.30	3.11		
B Condi- tion (2°C)		Pdh (declared heating cap) kW	2.54		4.21		5.12			
		COPd (declared COP)	4.44	4.32	4.61	4.57	4.26	4.33		
		Power input kW	0.57	0.59	0.91	0.92	1.20	1.18		
C Condi- tion (7°C)		Pdh (declared heating cap) kW	1.79	1.84	2.73		3.29			
		COPd (declared COP)	5.15	4.90	5.70	5.30	5.49	5.54		
		Power input kW	0.35	0.38	0.48	0.52	0.60	0.59		
D Condi- tion (12°C)		Pdh (declared heating cap) kW	1.97	2.07	2.54	2.60	2.55	2.64		
		COPd (declared COP)	5.99	6.00	7.06	6.21	6.13	6.25		
	Power input kW	0.33	0.34	0.36		0.42				
Power consump- tion in other than active mode	Crank- case heater mode	Cooling PCK kW	0.000							
		Heating PCK kW	0.000							
	Off mode	Cooling POFF kW	0.009							
		Heating POFF kW	0.009							
	Standby mode	Cooling PSB kW	0.009							
		Heating PSB kW	0.009							
	Thermo- stat-off mode	Cooling PTO kW	0.005							
		Heating PTO kW	0.013							
	Indication if the heater is equipped with a supplementary heater (pair application)				No					
	Supplementary heater (pair appli- cation)	Back-up capacity	Heating elbu kW	0.0						
Cooling	Cdc (Degradation cooling)		0.25							
Heating	Cdh (Degradation heating)		0.25							
Cooling function included				Yes						
Heating function included				Yes						
Average climate included				Yes						
Cold season included				No						
Warm season included				No						

(1)Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m. |

(2)Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

Technical specifications				FUA71A + RZAG71NV1	FUA100A + RZAG71NV1	FUA100A + RZAG100NV1	FUA125A + RZAG125NV1
Cooling capacity	Nom.	kW	6.80 (1)		9.50 (1)		12.1 (1)
Heating capacity	Nom.	kW	7.50 (2)		10.8 (2)		13.5 (2)
Space cooling	Energy efficiency class		A++				
	Capacity Pdesign	kW	6.80		9.50		12.1
	SEER		7.02	6.89	6.42	6.39	
	ηs,c	%	-				
	Annual energy consumption	kWh/a	339	345	518	1,136	
Space heating (Average climate)	Energy efficiency class		A+				
	Capacity Pdesign	kW	4.70		7.80		9.52
	SCOP/A		4.20	4.28	4.50	4.26	
	SCOPnet/A		4.20	4.28	4.50	4.26	
	ηs,h	%	-				
	Annual energy consumption	kWh/a	1,567	1,538	2,427	3,129	
	Required back up heating cap at design conditions		0.00				

2 Specifications

1 - 1 RZAG-NV1

Technical specifications				FUA71A + RZAG71NV1	FUA100A + RZAG71NV1	FUA100A + RZAG100NV1	FUA125A + RZAG125NV1
Space cooling	A Condi- tion (35°C - 27/19)	Pdc	kW	6.80		9.50	12.10
		EERd		3.83	4.02	3.57	3.02
	B Condi- tion (30°C - 27/19)	Power input	kW	1.77	1.69	2.66	4.00
		Pdc	kW	5.03		7.03	8.91
	C Condi- tion (25°C - 27/19)	EERd		5.34	5.65	4.93	5.08
		Power input	kW	0.94	0.89	1.43	1.76
	D Condi- tion (20°C - 27/19)	Pdc	kW	3.20	3.19	4.46	5.74
		EERd		8.83	8.54	7.75	7.22
		Power input	kW	0.36	0.37	0.58	0.79
		EERd		12.48	10.88	10.65	10.56
		Power input	kW	0.21	0.24	0.32	0.31
Space heating (Average climate)	TOL	Tol (temperature operating limit)	°C	-10			
		Pdh (declared heating cap)	kW	4.70		7.80	9.52
		COPd (declared COP)		2.58	2.95	2.62	1.97
	TBivalent	Power input	kW	1.82	1.59	2.97	4.83
		Tbiv (bivalent temperature)	°C	-10			
		Pdh (declared heating cap)	kW	4.70		7.80	9.52
	A Con- dition (-7°C)	COPd (declared COP)		2.58	2.95	2.62	1.97
		Power input	kW	1.82	1.59	2.97	4.83
		Pdh (declared heating cap)	kW	4.14		6.86	8.43
	A Con- dition (-7°C)	COPd (declared COP)		2.99	3.31	3.00	2.66
		Power input	kW	1.38	1.25	2.29	3.17
Space heating (Average climate)	B Condi- tion (2°C)	Pdh (declared heating cap)	kW	2.54		4.21	5.12
		COPd (declared COP)		4.27	4.36	4.53	4.31
		Power input	kW	0.60	0.58	0.93	1.19
	C Condi- tion (7°C)	Pdh (declared heating cap)	kW	1.80	1.86	2.73	3.29
		COPd (declared COP)		5.03	4.87	5.47	
		Power input	kW	0.36	0.38	0.50	0.60
D Con- dition (12°C)	Pdh (declared heating cap)	kW	2.00	2.09	2.55	2.58	
	COPd (declared COP)		6.00	5.94	6.76	6.18	
	Power input	kW	0.33	0.35	0.38	0.42	
Power consump- tion in other than active mode	Crank- case heater mode	Cooling PCK	kW	0.000			
		Heating PCK	kW	0.000			
	Off mode	Cooling POFF	kW	0.009			
		Heating POFF	kW	0.009			
	Standby mode	Cooling PSB	kW	0.009			
		Heating PSB	kW	0.009			
	Thermo- stat-off mode	Cooling PTO	kW	0.005			
		Heating PTO	kW	0.013			
	Indication if the heater is equipped with a supplementary heater (pair application)			No			
	Supplementary heater (pair application)	Back-up heating capacity	elbu kW	0.0			
	Cooling	Cdc (Degradation cooling)		0.25			
	Heating	Cdh (Degradation heating)		0.25			
Cooling function included			Yes				
Heating function included			Yes				
Average climate included			Yes				
Cold season included			No				
Warm season included			No				

(1) Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m. |

(2) Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

Technical specifications				FVA71A + RZAG71NV1	FVA100A + RZAG71NV1	FVA100A + RZAG100NV1	FVA140A + RZAG100NV1	FVA125A + RZAG125NV1	FVA140A + RZAG140NV1
Cooling capacity	Nom.	kW	6.80 (1)		9.50 (1)		12.1 (1)	13.4 (1)	
Heating capacity	Nom.	kW	7.50 (2)		10.8 (2)		13.5 (2)	15.5 (2)	
Space cooling	Energy efficiency class		A++						
	Capacity Pdesign	kW	6.80		9.50		12.1	13.4	
	SEER		6.34	6.41	6.40	6.43	6.41	6.12	
	η _{s,c}	%	-						
	Annual energy consumption	kWh/a	376	371	520	517	1,133	1,314	

2 Specifications

1 - 1 RZAG-NV1

Technical specifications				FVA71A + RZAG71NV1	FVA100A + RZAG71NY1	FVA100A + RZAG100NV1	FVA140A + RZAG100NV1	FVA125A + RZAG125NV1	FVA140A + RZAG140NV1	
Space heating (Average climate)	Energy efficiency class			A+				-		
	Capacity	Pdesign	kW	4.70		7.80		9.52		
	SCOP/A			4.05	4.03	4.20	4.05	4.15	3.94	
	SCOPnet/A			4.05	4.03	4.20	4.05	4.15	3.94	
	η _{s,h}			-				163	155	
	Annual energy consumption			1,625	1,634	2,600	2,697	3,209	3,383	
	Required back up heating cap at design conditions			0.00						
Space cooling	A Condi- tion (35°C - 27/19)	Pdc EERd	kW	6.80		9.50		12.10	13.40	
				3.27	3.95	3.57	3.93	3.21	3.03	
		Power input	kW	2.08	1.72	2.66	2.42	3.77	4.42	
	B Condi- tion (30°C - 27/19)	Pdc EERd	kW	5.03		7.03		8.92	9.87	
				5.15	5.40	5.21	5.13	5.23	4.89	
		Power input	kW	0.98	0.93	1.35	1.37	1.70	2.02	
	C Condi- tion (25°C - 27/19)	Pdc EERd	kW	3.20		4.46		4.47	5.73	
				7.53	7.81	7.67	7.63	7.07	6.90	
		Power input	kW	0.42	0.41	0.58	0.59	0.81	0.92	
	D Condi- tion (20°C - 27/19)	Pdc EERd	kW	2.33	2.61	3.20	3.54	3.23	3.24	
				11.27	9.56	9.85	10.01	10.28	9.46	
		Power input	kW	0.21	0.27	0.33	0.35	0.31	0.34	
Space heating (Average climate)	TOL	Tol (temperature operating limit)			-10					
		Pdh (declared heating cap)			4.70	7.80		9.52		
		COPd (declared COP)			2.42	2.85	2.45	2.57	1.86	
		Power input			1.94	1.65	3.19	3.04	5.11	
	TBivalent	Tbiv (bivalent temperature)			-10					
		Pdh (declared heating cap)			4.70	7.80		9.52		
		COPd (declared COP)			2.42	2.85	2.45	2.57	1.86	
		Power input			1.94	1.65	3.19	3.04	5.11	
	A Condi- tion (-7°C)	Pdh (declared heating cap)			4.14	6.86		8.43	8.42	
		COPd (declared COP)			2.83	3.18	2.82	2.84	2.55	
					2.83	3.18	2.82	2.84	2.55	
	Space heating (Average climate)	A Condi- tion (-7°C)	Power input	kW	1.46	1.30	2.43	2.42	3.30	3.48
B Condi- tion (2°C)		Pdh (declared heating cap)			2.54		4.21		5.12	
		COPd (declared COP)			4.07	4.11	4.21	4.11	4.20	3.99
		Power input			0.62		1.00	1.02	1.22	1.28
C Condi- tion (7°C)		Pdh (declared heating cap)			1.76		2.73		3.29	
		COPd (declared COP)			4.92	4.54	5.13	4.77	5.42	5.12
		Power input			0.36	0.41	0.53	0.57	0.61	0.64
D Con- dition (12°C)		Pdh (declared heating cap)			1.96	2.10	2.56	2.60	2.57	2.61
		COPd (declared COP)			5.77	5.48	6.22	5.58	6.00	5.67
		Power input			0.34	0.38	0.41	0.47	0.43	0.46
Power consump- tion in other than active mode		Crank- case heater mode	Cooling	PCK	0.000					
			Heating	PCK	0.000					
	Off mode	Cooling	POFF	0.009						
		Heating	POFF	0.009						
	Standby mode	Cooling	PSB	0.009						
		Heating	PSB	0.009						
	Thermo- stat-off mode	Cooling	PTO	0.005						
Heating		PTO	0.013							
Indication if the heater is equipped with a supplementary heater (pair application)				No						
Supplementary heater (pair appli- cation)	Back-up capacity	Heating	elbu	0.0						
Cooling	Cdc (Degradation cooling)			0.25						
Heating	Cdh (Degradation heating)			0.25						
Cooling function included				Yes						
Heating function included				Yes						
Average climate included				Yes						
Cold season included				No						
Warm season included				No						

(1)Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m. |

(2)Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

3 Electrical data

3 - 1 Electrical Data

RZAG-NV1

RZAG-NY1

Symbols

- MCA: Minimum Circuit Ampere [A]
TOCA: Total overcurrent amps [A]
MFA: Maximum Fuse Ampere [A]
MSC: Maximum current of the starting compressor [A]
RLA: Rated load amps [A]
OFM: Outdoor fan motor
IFM: Indoor fan motor
FLA: Full Load Ampere [A]
KW: Fan motor rated output [kW]

Notes

- The ·RLA· is based on the following conditions.
 - Cooling
 - Indoor temperature ·27.0°C DB / ·19.0°C WB
 - Outdoor temperature ·35.0°C DB
 - Heating
 - Indoor temperature ·20.0°C DB
 - Outdoor temperature ·7.0°C DB / ·6.0°C WB
- TOCA· is the total value of each overcurrent set.
- Voltage range
 - The units are suitable for use with electrical systems in which the voltage supplied to the unit terminals is not below or above the listed range limits.
- The maximum allowable voltage that is unbalanced between phases is ·2·%.
- MCA· is the maximum input current.
 - The capacity of the ·MFA· must be greater than that of the ·MCA·.
 - Select the ·MFA· according to the table.
- Select the wire size according to the MCA.
- MFA· is used to select the circuit breaker and the ground fault circuit interruptor.
 - Earth leakage circuit breaker

3D120944E

3 Electrical data

3 - 1 Electrical Data

RZAG-NV1
RZAG-NY1

3

Indoor	Outdoor	Power supply	Voltage range	Compressor			OFM		IFM			
				MCA	TOCA	MFA	MSC	RLA	kW	FLA	kW	FLA
FCAHG100HVEB	RZAG71N2V1B	50Hz ~ 220-240V	Minimum: -198 V- Maximum: 264 V-	18,3	—	20	—	15,5	0,234	0,8	0,221	1,3
FCAG35BVEB	x3 RZAG71N2V1B			17,9	—	20	—	15,5	0,234	0,8	0,044 x3	0,3 x3
FCAG50BVEB	x2 RZAG71N2V1B			17,6	—	20	—	15,5	0,234	0,8	0,039 x2	0,3 x2
FCAG100BVEB	RZAG71N2V1B			17,7	—	20	—	15,5	0,234	0,8	0,117	0,7
FFA35A2VEB	x3 RZAG71N2V1B			17,6	—	20	—	15,5	0,234	0,8	0,050 x3	0,2 x3
FFA50A2VEB	x2 RZAG71N2V1B			17,8	—	20	—	15,5	0,234	0,8	0,050 x2	0,4 x2
FBA35A2VEB	x3 RZAG71N2V1B			21,3	—	25	—	15,5	0,234	0,8	0,089 x3	1,4 x3
FBA50A2VEB	x2 RZAG71N2V1B			19,9	—	20	—	15,5	0,234	0,8	0,089 x2	1,4 x2
FBA100A2VEB	RZAG71N2V1B			20,6	—	25	—	15,5	0,234	0,8	0,127	3,5
FUA100AVEB9	RZAG71N2V1B			18,3	—	20	—	15,5	0,234	0,8	0,106	1,3
FAA100B1V1B	RZAG71N2V1B			17,9	—	20	—	15,5	0,234	0,8	0,064	0,9
FVA100AMVEB	RZAG71N2V1B			18,5	—	20	—	15,5	0,234	0,8	0,238	1,5
FDXM35F3V1B	x3 RZAG71N2V1B			17,9	—	20	—	15,5	0,234	0,8	0,034 x3	0,3 x3
FDXM50F3V1B	x2 RZAG71N2V1B			18,8	—	20	—	15,5	0,234	0,8	0,060 x2	0,9 x2
FHA35AVEB99	x3 RZAG71N2V1B			18,8	—	20	—	15,5	0,234	0,8	0,060 x3	0,6 x3
FHA50AVEB99	x2 RZAG71N2V1B			18,2	—	20	—	15,5	0,234	0,8	0,060 x2	0,6 x2
FHA100AVEB9	RZAG71N2V1B			18,3	—	20	—	15,5	0,234	0,8	0,150	1,3
FCAHG71HVEB	x2 RZAG100N2V1B			22,3	—	32	—	18,8	0,234	1,2	0,091 x2	0,7 x2
FCAHG140HVEB	RZAG100N2V1B			22,3	—	32	—	18,8	0,234	1,2	0,244	1,4
FCAG35BVEB	x4 RZAG100N2V1B			22,0	—	32	—	18,8	0,234	1,2	0,044 x4	0,3 x4
FCAG50BVEB	x3 RZAG100N2V1B	21,7	—	32	—	18,8	0,234	1,2	0,039 x3	0,3 x3		
FCAG71BVEB	x2 RZAG100N2V1B	21,6	—	32	—	18,8	0,234	1,2	0,054 x2	0,4 x2		
FCAG140BVEB	RZAG100N2V1B	22,2	—	32	—	18,8	0,234	1,2	0,168	1,3		
FFA35A2VEB	x4 RZAG100N2V1B	21,6	—	32	—	18,8	0,234	1,2	0,050 x4	0,8		
FFA50A2VEB	x3 RZAG100N2V1B	22,0	—	32	—	18,8	0,234	1,2	0,050 x3	0,4 x3		
FBA35A2VEB	x4 RZAG100N2V1B	26,6	—	32	—	18,8	0,234	1,2	0,089 x4	1,4 x4		
FBA50A2VEB	x3 RZAG100N2V1B	25,2	—	32	—	18,8	0,234	1,2	0,089 x3	1,4 x3		
FBA71A2VEB	x2 RZAG100N2V1B	23,5	—	32	—	18,8	0,234	1,2	0,07 x2	1,3 x2		
FBA140A2VEB	RZAG100N2V1B	24,9	—	32	—	18,8	0,234	1,2	0,187	3,9		
FUA71AVEB9	x2 RZAG100N2V1B	22,7	—	32	—	18,8	0,234	1,2	0,046 x2	0,9 x2		
FAA71B1V1B	x2 RZAG100N2V1B	21,8	—	32	—	18,8	0,234	1,2	0,048 x2	0,5 x2		
FVA140AMVEB	RZAG100N2V1B	22,7	—	32	—	18,8	0,234	1,2	0,276	1,8		
FDXM35F3V1B	x4 RZAG100N2V1B	22,0	—	32	—	18,8	0,234	1,2	0,034 x4	0,3 x4		
FDXM50F3V1B	x3 RZAG100N2V1B	23,6	—	32	—	18,8	0,234	1,2	0,060 x3	0,9 x3		
FHA35AVEB99	x4 RZAG100N2V1B	23,3	—	32	—	18,8	0,234	1,2	0,060 x4	0,6 x4		
FHA50AVEB99	x3 RZAG100N2V1B	22,7	—	32	—	18,8	0,234	1,2	0,060 x3	0,6 x3		
FHA71AVEB99	x2 RZAG100N2V1B	22,5	—	32	—	18,8	0,234	1,2	0,091 x2	0,8 x2		
FHA140AVEB9	RZAG100N2V1B	22,7	—	32	—	18,8	0,234	1,2	0,150	1,8		

Indoor	Outdoor	Power supply	Voltage range	Compressor			OFM		IFM			
				MCA	TOCA	MFA	MSC	RLA	kW	FLA	kW	FLA
FCAHG71HVEB	x2 RZAG125N2V1B	50Hz ~ 220-240V	Minimum: -198 V- Maximum: 264 V-	27,5	—	32	—	23,8	0,234	1,2	0,091 x2	0,7 x2
FCAHG140HVEB	RZAG125N2V1B			27,5	—	32	—	23,8	0,234	1,2	0,244	1,4
FCAG35BVEB	x4 RZAG125N2V1B			27,2	—	32	—	23,8	0,234	1,2	0,044 x4	0,3 x4
FCAG50BVEB	x3 RZAG125N2V1B			26,9	—	32	—	23,8	0,234	1,2	0,039 x3	0,3 x3
FCAG71BVEB	x2 RZAG125N2V1B			26,8	—	32	—	23,8	0,234	1,2	0,054 x2	0,4 x2
FCAG140BVEB	RZAG125N2V1B			27,4	—	32	—	23,8	0,234	1,2	0,168	1,3
FFA35A2VEB	x4 RZAG125N2V1B			26,8	—	32	—	23,8	0,234	1,2	0,050 x4	0,2 x4
FFA50A2VEB	x3 RZAG125N2V1B			27,2	—	32	—	23,8	0,234	1,2	0,050 x3	0,4 x3
FBA35A2VEB	x4 RZAG125N2V1B			31,8	—	32	—	23,8	0,234	1,2	0,089 x4	1,4 x4
FBA50A2VEB	x3 RZAG125N2V1B			30,4	—	32	—	23,8	0,234	1,2	0,089 x3	1,4 x3
FBA71A2VEB	x2 RZAG125N2V1B			28,7	—	32	—	23,8	0,234	1,2	0,070 x2	1,3 x2
FBA140A2VEB	RZAG125N2V1B			30,1	—	32	—	23,8	0,234	1,2	0,187	3,9
FUA71AVEB9	x2 RZAG125N2V1B			27,9	—	32	—	23,8	0,234	1,2	0,046 x2	0,9 x2
FAA71B1V1B	x2 RZAG125N2V1B			27,0	—	32	—	23,8	0,234	1,2	0,048 x2	0,5 x2
FVA140AMVEB	RZAG125N2V1B			27,9	—	32	—	23,8	0,234	1,2	0,276	1,8
FDXM35F3V1B	x4 RZAG125N2V1B			27,2	—	32	—	23,8	0,234	1,2	0,034 x4	0,3 x4
FDXM50F3V1B	x3 RZAG125N2V1B			28,8	—	32	—	23,8	0,234	1,2	0,060 x3	0,9 x3
FHA35AVEB99	x4 RZAG125N2V1B			28,5	—	32	—	23,8	0,234	1,2	0,060 x4	0,6 x4
FHA50AVEB99	x3 RZAG125N2V1B			27,9	—	32	—	23,8	0,234	1,2	0,060 x3	0,6 x3
FHA71AVEB99	x2 RZAG125N2V1B			27,7	—	32	—	23,8	0,234	1,2	0,091 x2	0,8 x2
FHA140AVEB9	RZAG125N2V1B	27,9	—	32	—	23,8	0,234	1,2	0,150	1,8		
FCAHG71HVEB	x2 RZAG140N2V1B	27,5	—	32	—	23,6	0,234	1,4	0,091 x2	0,7 x2		
FCAHG140HVEB	RZAG140N2V1B	27,5	—	32	—	23,6	0,234	1,4	0,244	1,4		
FCAG35BVEB	x4 RZAG140N2V1B	27,2	—	32	—	23,6	0,234	1,4	0,044 x4	0,3 x4		
FCAG50BVEB	x3 RZAG140N2V1B	26,9	—	32	—	23,6	0,234	1,4	0,039 x3	0,3 x3		
FCAG71BVEB	x2 RZAG140N2V1B	26,8	—	32	—	23,6	0,234	1,4	0,054 x2	0,4 x2		
FCAG140BVEB	RZAG140N2V1B	27,4	—	32	—	23,6	0,234	1,4	0,168	1,3		
FFA35A2VEB	x4 RZAG140N2V1B	26,8	—	32	—	23,6	0,234	1,4	0,050 x4	0,2 x4		
FFA50A2VEB	x3 RZAG140N2V1B	27,2	—	32	—	23,6	0,234	1,4	0,050 x3	0,4 x3		
FBA35A2VEB	x4 RZAG140N2V1B	31,8	—	32	—	23,6	0,234	1,4	0,089 x4	1,4 x4		
FBA50A2VEB	x3 RZAG140N2V1B	30,4	—	32	—	23,6	0,234	1,4	0,089 x3	1,4 x3		
FBA71A2VEB	x2 RZAG140N2V1B	28,7	—	32	—	23,6	0,234	1,4	0,070 x2	1,3 x2		
FBA140A2VEB	RZAG140N2V1B	30,1	—	32	—	23,6	0,234	1,4	0,187	3,9		
FUA71AVEB9	x2 RZAG140N2V1B	27,9	—	32	—	23,6	0,234	1,4	0,046 x2	0,9 x2		
FAA71B1V1B	x2 RZAG140N2V1B	27,0	—	32	—	23,6	0,234	1,4	0,048 x2	0,5 x2		
FVA140AMVEB	RZAG140N2V1B	27,9	—	32	—	23,6	0,234	1,4	0,276	1,8		
FDXM35F3V1B	x4 RZAG140N2V1B	27,2	—	32	—	23,6	0,234	1,4	0,034 x4	0,3 x4		
FDXM50F3V1B	x3 RZAG140N2V1B	28,8	—	32	—	23,6	0,234	1,4	0,060 x3	0,9 x3		
FHA35AVEB99	x4 RZAG140N2V1B	28,5	—	32	—	23,6	0,234	1,4	0,060 x4	0,6 x4		
FHA50AVEB99	x3 RZAG140N2V1B	27,9	—	32	—	23,6	0,234	1,4	0,060 x3	0,6 x3		
FHA71AVEB99	x2 RZAG140N2V1B	27,7	—	32	—	23,6	0,234	1,4	0,091 x2	0,8 x2		
FHA140AVEB9	RZAG140N2V1B	27,9	—	32	—	23,6	0,234	1,4	0,150	1,8		

3D120944E

3 Electrical data

3 - 1 Electrical Data

RZAG-NV1 RZAG-NY1

Indoor	Outdoor	Power supply	Voltage range	Compressor				OFM		IFM				
				MCA	TOCA	MFA	MSC	RLA	kW	FLA	kW	FLA		
FCAHG100HVEB	RZAG71N2Y1B	3N- 50Hz 380-415V	Minimum: -342 V Maximum: -457 V	11,8	—	16	—	9,2	0,234	0,8	0,221	1,3		
FCAG35BVEB	x3 RZAG71N2Y1B			11,3	—	16	—	9,2	0,234	0,8	0,044 x3	0,3 x3		
FCAG50BVEB	x2 RZAG71N2Y1B			11,0	—	16	—	9,2	0,234	0,8	0,039 x2	0,3 x2		
FCAG100BVEB	RZAG71N2Y1B			11,1	—	16	—	9,2	0,234	0,8	0,117	0,7		
FFA35A2VEB	x3 RZAG71N2Y1B			11,0	—	16	—	9,2	0,234	0,8	0,050 x3	0,2 x3		
FFA50A2VEB	x2 RZAG71N2Y1B			11,2	—	16	—	9,2	0,234	0,8	0,050 x2	0,4 x2		
FBA35A2VEB	x3 RZAG71N2Y1B			14,6	—	16	—	9,2	0,234	0,8	0,089 x3	1,4 x3		
FBA50A2VEB	x2 RZAG71N2Y1B			13,2	—	16	—	9,2	0,234	0,8	0,089 x2	1,4 x2		
FBA100A2VEB	RZAG71N2Y1B			13,9	—	16	—	9,2	0,234	0,8	0,127	3,5		
FUA100AVEB9	RZAG71N2Y1B			11,8	—	16	—	9,2	0,234	0,8	0,106	1,3		
FAA100BUV1B	RZAG71N2Y1B			11,3	—	16	—	9,2	0,234	0,8	0,064	0,9		
FVA100AMVEB	RZAG71N2Y1B			12,0	—	16	—	9,2	0,234	0,8	0,238	1,5		
FDXM35F3V1B	x3 RZAG71N2Y1B			11,3	—	16	—	9,2	0,234	0,8	0,034 x3	0,3 x3		
FDXM50F3V1B	x2 RZAG71N2Y1B			12,3	—	16	—	9,2	0,234	0,8	0,060 x2	0,9 x2		
FHA35AVEB99	x3 RZAG71N2Y1B			12,3	—	16	—	9,2	0,234	0,8	0,060 x3	0,6 x3		
FHA50AVEB99	x2 RZAG71N2Y1B			11,6	—	16	—	9,2	0,234	0,8	0,060 x2	0,6 x2		
FHA100AVEB9	RZAG71N2Y1B			11,8	—	16	—	9,2	0,234	0,8	0,150	1,3		
FCAHG71HVEB	RZAG100N2Y1B			3N- 50Hz 380-415V	Minimum: -342 V Maximum: -457 V	13,5	—	16	—	10,4	0,234	1,2	0,091 x2	0,7 x2
FCAG140HVEB	RZAG100N2Y1B					15,0	—	16	—	11,8	0,234	1,2	0,244	1,4
FCAG35BVEB	x4 RZAG100N2Y1B					13,3	—	16	—	10,4	0,234	1,2	0,044 x4	0,3 x4
FCAG50BVEB	x3 RZAG100N2Y1B	13,0	—			16	—	10,4	0,234	1,2	0,039 x3	0,3 x3		
FCAG71BVEB	x2 RZAG100N2Y1B	12,9	—			16	—	10,4	0,234	1,2	0,054 x2	0,4 x2		
FCAG140BVEB	RZAG100N2Y1B	14,9	—			16	—	11,8	0,234	1,2	0,168	1,3		
FFA35A2VEB	x4 RZAG100N2Y1B	12,9	—			16	—	10,4	0,234	1,2	0,050 x4	0,8		
FFA50A2VEB	x3 RZAG100N2Y1B	13,3	—			16	—	10,4	0,234	1,2	0,050 x3	0,4 x3		
FBA35A2VEB	x4 RZAG100N2Y1B	17,7	—			20	—	10,4	0,234	1,2	0,089 x4	1,4 x4		
FBA50A2VEB	x3 RZAG100N2Y1B	16,3	—			20	—	10,4	0,234	1,2	0,089 x3	1,4 x3		
FBA71A2VEB	x2 RZAG100N2Y1B	14,7	—			16	—	10,4	0,234	1,2	0,070 x2	1,3 x2		
FBA140A2VEB	RZAG100N2Y1B	17,4	—			20	—	11,8	0,234	1,2	0,187	3,9		
FUA71AVEB9	x2 RZAG100N2Y1B	13,9	—			16	—	10,4	0,234	1,2	0,046 x2	0,9 x2		
FAA71BUV1B	x2 RZAG100N2Y1B	13,1	—			16	—	10,4	0,234	1,2	0,048 x2	0,5 x2		
FVA140AMVEB	RZAG100N2Y1B	15,4	—			16	—	11,8	0,234	1,2	0,276	1,8		
FDXM35F3V1B	x4 RZAG100N2Y1B	13,3	—			16	—	10,4	0,234	1,2	0,034 x4	0,3 x4		
FDXM50F3V1B	x3 RZAG100N2Y1B	14,9	—			16	—	10,4	0,234	1,2	0,060 x3	0,9 x3		
FHA35AVEB99	x4 RZAG100N2Y1B	14,6	—			16	—	10,4	0,234	1,2	0,060 x4	0,6 x4		
FHA50AVEB99	x3 RZAG100N2Y1B	13,9	—			16	—	10,4	0,234	1,2	0,060 x3	0,6 x3		
FHA71AVEB99	x2 RZAG100N2Y1B	13,7	—			16	—	10,4	0,234	1,2	0,091 x2	0,8 x2		
FHA140AVEB9	RZAG100N2Y1B	15,4	—	16	—	11,8	0,234	1,2	0,150	1,8				

Indoor	Outdoor	Power supply	Voltage range	Compressor				OFM		IFM		
				MCA	TOCA	MFA	MSC	RLA	kW	FLA	kW	FLA
FCAHG71HVEB	x2 RZAG125N2Y1B	3N- 50Hz 380-415V	Minimum: -342 V Maximum: -457 V	15,0	—	16	—	11,8	0,234	1,2	0,091 x2	0,7 x2
FCAG140HVEB	RZAG125N2Y1B			15,0	—	16	—	11,8	0,234	1,2	0,244	1,4
FCAG35BVEB	x4 RZAG125N2Y1B			12,2	—	16	—	9,3	0,234	1,2	0,044 x4	0,3 x4
FCAG50BVEB	x3 RZAG125N2Y1B			12,9	—	16	—	10,3	0,234	1,2	0,039 x3	0,3 x3
FCAG71BVEB	x2 RZAG125N2Y1B			14,4	—	16	—	11,8	0,234	1,2	0,054 x2	0,4 x2
FCAG140BVEB	RZAG125N2Y1B			14,9	—	16	—	11,8	0,234	1,2	0,168	1,3
FFA35A2VEB	x4 RZAG125N2Y1B			11,8	—	16	—	9,3	0,234	1,2	0,050 x4	0,2 x4
FFA50A2VEB	x3 RZAG125N2Y1B			13,2	—	16	—	10,3	0,234	1,2	0,050 x3	0,4 x3
FBA35A2VEB	x4 RZAG125N2Y1B			16,5	—	20	—	9,3	0,234	1,2	0,089 x4	1,4 x4
FBA50A2VEB	x3 RZAG125N2Y1B			16,2	—	20	—	10,3	0,234	1,2	0,089 x3	1,4 x3
FBA71A2VEB	x2 RZAG125N2Y1B			16,1	—	20	—	11,8	0,234	1,2	0,070 x2	1,3 x2
FBA140A2VEB	RZAG125N2Y1B			17,4	—	20	—	11,8	0,234	1,2	0,187	3,9
FUA71AVEB9	x2 RZAG125N2Y1B			15,4	—	16	—	11,8	0,234	1,2	0,046 x2	0,9 x2
FAA71BUV1B	x2 RZAG125N2Y1B			14,6	—	16	—	11,8	0,234	1,2	0,048 x2	0,5 x2
FVA140AMVEB9	RZAG125N2Y1B			15,4	—	16	—	11,8	0,234	1,2	0,276	1,8
FDXM35F3V1B	x4 RZAG125N2Y1B			12,2	—	16	—	9,3	0,234	1,2	0,034 x4	0,3 x4
FDXM50F3V1B	x3 RZAG125N2Y1B			14,8	—	16	—	10,3	0,234	1,2	0,060 x3	0,9 x3
FHA35AVEB99	x4 RZAG125N2Y1B			13,4	—	16	—	9,3	0,234	1,2	0,060 x4	0,6 x4
FHA50AVEB99	x3 RZAG125N2Y1B			13,8	—	16	—	10,3	0,234	1,2	0,060 x3	0,6 x3
FHA71AVEB99	x2 RZAG125N2Y1B			15,2	—	16	—	11,8	0,234	1,2	0,091 x2	0,8 x2
FHA140AVEB9	RZAG125N2Y1B	15,4	—	16	—	11,8	0,234	1,2	0,150	1,8		
FCAHG71HVEB	x2 RZAG140N2Y1B	3N- 50Hz 380-415V	Minimum: -342 V Maximum: -457 V	15,0	—	16	—	11,6	0,234	1,4	0,091 x2	0,7 x2
FCAG140HVEB	RZAG140N2Y1B			15,0	—	16	—	11,6	0,234	1,4	0,244	1,4
FCAG35BVEB	x4 RZAG140N2Y1B			12,2	—	16	—	9,1	0,234	1,4	0,044 x4	0,3 x4
FCAG50BVEB	x3 RZAG140N2Y1B			12,9	—	16	—	10,1	0,234	1,4	0,039 x3	0,3 x3
FCAG71BVEB	x2 RZAG140N2Y1B			14,4	—	16	—	11,6	0,234	1,4	0,054 x2	0,4 x2
FCAG140BVEB	RZAG140N2Y1B			14,9	—	16	—	11,6	0,234	1,4	0,168	1,3
FFA35A2VEB	x4 RZAG140N2Y1B			11,8	—	16	—	9,1	0,234	1,4	0,050 x4	0,2 x4
FFA50A2VEB	x3 RZAG140N2Y1B			13,2	—	16	—	10,1	0,234	1,4	0,050 x3	0,4 x3
FBA35A2VEB	x4 RZAG140N2Y1B			16,5	—	20	—	9,1	0,234	1,4	0,089 x4	1,4 x4
FBA50A2VEB	x3 RZAG140N2Y1B			16,2	—	20	—	10,1	0,234	1,4	0,089 x3	1,4 x3
FBA71A2VEB	x2 RZAG140N2Y1B			16,1	—	20	—	11,6	0,234	1,4	0,070 x2	1,3 x2
FBA140A2VEB	RZAG140N2Y1B			17,4	—	20	—	11,6	0,234	1,4	0,187	3,9
FUA71AVEB9	x2 RZAG140N2Y1B			15,4	—	16	—	11,6	0,234	1,4	0,046 x2	0,9 x2
FAA71BUV1B	x2 RZAG140N2Y1B			14,6	—	16	—	11,6	0,234	1,4	0,048 x2	0,5 x2
FVA140AMVEB	RZAG140N2Y1B			15,4	—	16	—	11,6	0,234	1,4	0,276	1,8
FDXM35F3V1B	x4 RZAG140N2Y1B			12,2	—	16	—	9,1	0,234	1,4	0,034 x4	0,3 x4
FDXM50F3V1B	x3 RZAG140N2Y1B			14,8	—	16	—	10,1	0,234	1,4	0,060 x3	0,9 x3
FHA35AVEB99	x4 RZAG140N2Y1B			13,4	—	16	—	9,1	0,234	1,4	0,060 x4	0,6 x4
FHA50AVEB99	x3 RZAG140N2Y1B			13,8	—	16	—	10,1	0,234	1,4	0,060 x3	0,6 x3
FHA71AVEB99	x2 RZAG140N2Y1B			15,2	—	16	—	11,6	0,234	1,4	0,091 x2	0,8 x2
FHA140AVEB9	RZAG140N2Y1B	15,4	—	16	—	11,6	0,234	1,4	0,150	1,8		

3D120944E

3 Electrical data

3 - 1 Electrical Data

RZAG-NV1

RZAG-NY1

3

Notes

1. The ·RLA· is based on the following conditions.

Cooling

Indoor temperature ·27.0·°C DB / ·19.0·°C WB

Outdoor temperature ·35.0·°C DB

Heating

Indoor temperature ·20.0·°C DB

Outdoor temperature ·7.0·°C DB / ·6.0·°C WB

2. ·TOCA· is the total value of each overcurrent set.

3. Voltage range

The units are suitable for use with electrical systems in which the voltage supplied to the unit terminals is not below or above the listed range limits.

4. The maximum allowable voltage that is unbalanced between phases is ·2·%.

5. ·MCA· is the maximum input current.

The capacity of the ·MFA· must be greater than that of the ·MCA·.

Select the ·MFA· according to the table.

6. Select the wire size according to the MCA.

7. ·MFA· is used to select the circuit breaker and the ground fault circuit interruptor.

Earth leakage circuit breaker

3D120943D

3 Electrical data

3 - 1 Electrical Data

RZAG-NV1 RZAG-NY1

Indoor	Outdoor	Power supply	Voltage range		MCA	TOCA	MFA	Compressor		OFM		IFM					
								MSC	RLA	kW	FLA	kW	FLA				
FCAG71HVEB	RZAG71N2V1B	50Hz ~ 220-240V	Minimum: 198 V	Maximum: 264 V	17,7	—	20	—	15,5	0,234	0,8	0,091	0,7				
FCAG35BVEB	RZAG71N2V1B				17,6	—	20	—	15,5	0,234	0,8	0,044 x2	0,3 x2				
FCAG71BVEB	RZAG71N2V1B				17,4	—	20	—	15,5	0,234	0,8	0,054	0,4				
FFA35A2VEB	RZAG71N2V1B				17,4	—	20	—	15,5	0,234	0,8	0,050 x2	0,2 x2				
FBA35A2VEB	RZAG71N2V1B				19,9	—	20	—	15,5	0,234	0,8	0,089 x2	1,4 x2				
FBA71A2VEB	RZAG71N2V1B				18,3	—	20	—	15,5	0,234	0,8	0,070	1,3				
FNA35A2VEB	RZAG71N2V1B				18,0	—	20	—	15,5	0,234	0,8	0,034 x2	0,5 x2				
FUA71AVEB9	RZAG71N2V1B				17,9	—	20	—	15,5	0,234	0,8	0,046	0,9				
FAA71BUBV1B	RZAG71N2V1B				17,5	—	20	—	15,5	0,234	0,8	0,048	0,5				
FVA71AMVEB	RZAG71N2V1B				17,8	—	20	—	15,5	0,234	0,8	0,117	0,8				
FDXM35F3V1B	RZAG71N2V1B				17,6	—	20	—	15,5	0,234	0,8	0,034 x2	0,3 x2				
FHA35AVEB99	RZAG71N2V1B				18,2	—	20	—	15,5	0,234	0,8	0,060 x2	0,6 x2				
FHA71AVEB99	RZAG71N2V1B				17,8	—	20	—	15,5	0,234	0,8	0,091	0,8				
FCAG100HVEB	RZAG100N2V1B				50Hz ~ 220-240V	Minimum: 198 V	Maximum: 264 V	22,2	—	32	—	18,8	0,234	1,2	0,221	1,3	
FCAG35BVEB	RZAG100N2V1B							21,7	—	32	—	18,8	0,234	1,2	0,044 x3	0,3 x3	
FCAG50BVEB	RZAG100N2V1B							21,4	—	32	—	18,8	0,234	1,2	0,039 x2	0,3 x2	
FCAG100BVEB	RZAG100N2V1B	21,5	—	32				—	18,8	0,234	1,2	0,117	0,7				
FFA35A2VEB	RZAG100N2V1B	21,4	—	32				—	18,8	0,234	1,2	0,050 x3	0,2 x3				
FFA50A2VEB	RZAG100N2V1B	21,6	—	32				—	18,8	0,234	1,2	0,050 x2	0,4 x2				
FBA35A2VEB	RZAG100N2V1B	25,2	—	32				—	18,8	0,234	1,2	0,089 x3	1,4 x3				
FBA50A2VEB	RZAG100N2V1B	23,7	—	32				—	18,8	0,234	1,2	0,089 x2	1,4 x2				
FBA100A2VEB	RZAG100N2V1B	24,4	—	32				—	18,8	0,234	1,2	0,127	3,5				
FNA35A2VEB	RZAG100N2V1B	22,4	—	32				—	18,8	0,234	1,2	0,034 x3	0,5 x3				
FNA50A2VEB	RZAG100N2V1B	21,8	—	32				—	18,8	0,234	1,2	0,060 x2	0,5 x2				
FUA100AVEB9	RZAG100N2V1B	22,2	—	32				—	18,8	0,234	1,2	0,106	1,3				
FAA100BUBV1B	RZAG100N2V1B	21,7	—	32				—	18,8	0,234	1,2	0,064	0,9				
FVA100AMVEB	RZAG100N2V1B	22,4	—	32				—	18,8	0,234	1,2	0,238	1,5				
FDXM35F3V1B	RZAG100N2V1B	21,7	—	32				—	18,8	0,234	1,2	0,034 x3	0,3 x3				
FDXM50F3V1B	RZAG100N2V1B	22,7	—	32				—	18,8	0,234	1,2	0,060 x2	0,9 x2				
FHA35AVEB99	RZAG100N2V1B	22,7	—	32	—	18,8	0,234	1,2	0,060 x3	0,6 x3							
FHA50AVEB99	RZAG100N2V1B	22,0	—	32	—	18,8	0,234	1,2	0,060 x2	0,6 x2							
FHA100AVEB9	RZAG100N2V1B	22,2	—	32	—	18,8	0,234	1,2	0,150	1,3							

Indoor	Outdoor	Power supply	Voltage range		MCA	TOCA	MFA	Compressor		OFM		IFM		
								MSC	RLA	kW	FLA	kW	FLA	
FCAG125HVEB	RZAG125N2V1B	50Hz ~ 220-240V	Minimum: 198 V	Maximum: 264 V	27,5	—	32	—	23,8	0,234	1,2	0,244	1,4	
FCAG35BVEB	RZAG125N2V1B				27,2	—	32	—	23,8	0,234	1,2	0,044 x4	0,3 x4	
FCAG50BVEB	RZAG125N2V1B				26,9	—	32	—	23,8	0,234	1,2	0,039 x3	0,3 x3	
FCAG60BVEB	RZAG125N2V1B				26,6	—	32	—	23,8	0,234	1,2	0,044 x2	0,3 x2	
FCAG125BVEB	RZAG125N2V1B				27,0	—	32	—	23,8	0,234	1,2	0,168	1,0	
FFA35A2VEB	RZAG125N2V1B				26,8	—	32	—	23,8	0,234	1,2	0,050 x4	0,2 x4	
FFA50A2VEB	RZAG125N2V1B				27,2	—	32	—	23,8	0,234	1,2	0,050 x3	0,4 x3	
FFA60A2VEB	RZAG125N2V1B				27,2	—	32	—	23,8	0,234	1,2	0,050 x2	0,6 x2	
FBA35A2VEB	RZAG125N2V1B				31,8	—	32	—	23,8	0,234	1,2	0,089 x4	1,4 x4	
FBA50A2VEB	RZAG125N2V1B				30,4	—	32	—	23,8	0,234	1,2	0,089 x3	1,4 x3	
FBA60A2VEB	RZAG125N2V1B				28,7	—	32	—	23,8	0,234	1,2	0,070 x2	1,3 x2	
FBA125A2VEB	RZAG125N2V1B				30,1	—	32	—	23,8	0,234	1,2	0,187	3,9	
FNA35A2VEB	RZAG125N2V1B				28,1	—	32	—	23,8	0,234	1,2	0,034 x4	0,5 x4	
FNA50A2VEB	RZAG125N2V1B				27,6	—	32	—	23,8	0,234	1,2	0,060 x3	0,5 x3	
FNA60A2VEB	RZAG125N2V1B				27,2	—	32	—	23,8	0,234	1,2	0,060 x2	0,6 x2	
FUA125AVEB9	RZAG125N2V1B				27,5	—	32	—	23,8	0,234	1,2	0,106	1,4	
FUA125AVEB9	RZAG125N2V1B				28,2	—	32	—	23,8	0,234	1,2	0,350	2,1	
FVA125AMVEB	RZAG125N2V1B				27,6	—	32	—	23,8	0,234	1,2	0,238	1,5	
FDXM35F3V1B	RZAG125N2V1B				27,2	—	32	—	23,8	0,234	1,2	0,034 x4	0,3 x4	
FDXM50F3V1B	RZAG125N2V1B				28,8	—	32	—	23,8	0,234	1,2	0,060 x3	0,9 x3	
FDXM60F3V1B	RZAG125N2V1B				27,9	—	32	—	23,8	0,234	1,2	0,060 x2	0,9 x2	
FHA35AVEB99	RZAG125N2V1B				28,5	—	32	—	23,8	0,234	1,2	0,060 x4	0,6 x4	
FHA50AVEB99	RZAG125N2V1B				27,9	—	32	—	23,8	0,234	1,2	0,060 x3	0,6 x3	
FHA60AVEB99	RZAG125N2V1B				27,2	—	32	—	23,8	0,234	1,2	0,091 x2	0,6 x2	
FHA125AVEB9	RZAG125N2V1B	27,6	—	32	—	23,8	0,234	1,2	0,150	1,5				
FCAG71HVEB	RZAG140N2V1B	50Hz ~ 220-240V	Minimum: 198 V	Maximum: 264 V	27,5	—	32	—	23,6	0,234	1,4	0,091 x2	0,7 x2	
FCAG140HVEB	RZAG140N2V1B				27,5	—	32	—	23,6	0,234	1,4	0,244	1,4	
FCAG35BVEB	RZAG140N2V1B				27,2	—	32	—	23,6	0,234	1,4	0,044 x4	0,3 x4	
FCAG50BVEB	RZAG140N2V1B				26,9	—	32	—	23,6	0,234	1,4	0,039 x3	0,3 x3	
FCAG71BVEB	RZAG140N2V1B				26,8	—	32	—	23,6	0,234	1,4	0,054 x2	0,4 x2	
FCAG140BVEB	RZAG140N2V1B				27,4	—	32	—	23,6	0,234	1,4	0,168	1,3	
FFA35A2VEB	RZAG140N2V1B				26,8	—	32	—	23,6	0,234	1,4	0,050 x4	0,2 x4	
FFA50A2VEB	RZAG140N2V1B				27,2	—	32	—	23,6	0,234	1,4	0,050 x3	0,4 x3	
FBA35A2VEB	RZAG140N2V1B				31,8	—	32	—	23,6	0,234	1,4	0,089 x4	1,4 x4	
FBA50A2VEB	RZAG140N2V1B				30,4	—	32	—	23,6	0,234	1,4	0,089 x3	1,4 x3	
FBA71A2VEB	RZAG140N2V1B				28,7	—	32	—	23,6	0,234	1,4	0,070 x2	1,3 x2	
FBA140A2VEB	RZAG140N2V1B				30,1	—	32	—	23,6	0,234	1,4	0,187	3,9	
FNA35A2VEB	RZAG140N2V1B				28,1	—	32	—	23,6	0,234	1,4	0,034 x4	0,5 x4	
FNA50A2VEB	RZAG140N2V1B				27,6	—	32	—	23,6	0,234	1,4	0,060 x3	0,5 x3	
FUA71AVEB9	RZAG140N2V1B				27,9	—	32	—	23,6	0,234	1,4	0,046 x2	0,9 x2	
FAA71BUBV1B	RZAG140N2V1B				27,0	—	32	—	23,6	0,234	1,4	0,048 x2	0,5 x2	
FVA71AMVEB	RZAG140N2V1B				27,7	—	32	—	23,6	0,234	1,4	0,117 x2	0,8 x2	
FVA140AMVEB	RZAG140N2V1B				27,9	—	32	—	23,6	0,234	1,4	0,276	1,8	
FDXM35F3V1B	RZAG140N2V1B				27,2	—	32	—	23,6	0,234	1,4	0,034 x4	0,3 x4	
FDXM50F3V1B	RZAG140N2V1B				28,8	—	32	—	23,6	0,234	1,4	0,060 x3	0,9 x3	
FHA35AVEB99	RZAG140N2V1B				28,5	—	32	—	23,6	0,234	1,4	0,060 x4	0,6 x4	
FHA50AVEB99	RZAG140N2V1B				27,9	—	32	—	23,6	0,234	1,4	0,060 x3	0,6 x3	
FHA71AVEB99	RZAG140N2V1B				27,7	—	32	—	23,6	0,234	1,4	0,091 x2	0,8 x2	
FHA140AVEB9	RZAG140N2V1B				27,9	—	32	—	23,6	0,234	1,4	0,150	1,8	

Symbols
MCA: Minimum Circuit Ampere [A]
TOCA: Total overcurrent amps [A]
MFA: Maximum Fuse Ampere [A]
MSC: Maximum current of the starting compressor [A]
RLA: Rated load amps [A]
OFM: Outdoor fan motor
IFM: Indoor fan motor
FLA: Full Load Ampere [A]
KW: Fan motor rated output [kW]

3D120943D

3 Electrical data

3 - 1 Electrical Data

RZAG-NV1
RZAG-NY1

3

Indoor	Outdoor	Power supply	Voltage range	MCA	TOCA	MFA	Compressor		OFM		IFM		
							MSC	RLA	kW	FLA	kW	FLA	
FCAHG71HVEB	RZAG71N2Y1B	3N~ 50Hz 380-415V	Minimum: -342 V Maximum: -457 V	11,1	—	16	—	9,2	0,234	0,8	0,091	0,7	
FCAG35BVEB	x2 RZAG71N2Y1B			11,0	—	16	—	9,2	0,234	0,8	0,044 x2	0,3 x2	
FCAG71BVEB	RZAG71N2Y1B			10,8	—	16	—	9,2	0,234	0,8	0,054	0,4	
FFA35A2VEB	x2 RZAG71N2Y1B			10,8	—	16	—	9,2	0,234	0,8	0,050 x2	0,2 x2	
FBA35A2VEB	x2 RZAG71N2Y1B			13,2	—	16	—	9,2	0,234	0,8	0,089 x2	1,4 x2	
FBA71A2VEB	RZAG71N2Y1B			11,7	—	16	—	9,2	0,234	0,8	0,070	1,3	
FNA35A2VEB	x2 RZAG71N2Y1B			11,4	—	16	—	9,2	0,234	0,8	0,034 x2	0,5 x2	
FUA71AVEB9	RZAG71N2Y1B			11,3	—	16	—	9,2	0,234	0,8	0,046	0,9	
FAA71BUV1B	RZAG71N2Y1B			10,9	—	16	—	9,2	0,234	0,8	0,048	0,5	
FVA71AMVEB	RZAG71N2Y1B		11,2	—	16	—	9,2	0,234	0,8	0,117	0,8		
FDMX35F3V1B	x2 RZAG71N2Y1B		11,0	—	16	—	9,2	0,234	0,8	0,034 x2	0,3 x2		
FHA35AVEB99	x2 RZAG71N2Y1B		11,6	—	16	—	9,2	0,234	0,8	0,060 x2	0,6 x2		
FHA71AVEB99	RZAG71N2Y1B		11,2	—	16	—	9,2	0,234	0,8	0,091	0,8		
FCAHG100HVEB	RZAG100N2Y1B		3N~ 50Hz 380-415V	Minimum: -342 V Maximum: -457 V	14,9	—	16	—	11,8	0,234	1,2	0,221	1,3
FCAG35BVEB	x3 RZAG100N2Y1B				13,0	—	16	—	10,4	0,234	1,2	0,044 x3	0,3 x3
FCAG50BVEB	x2 RZAG100N2Y1B				12,7	—	16	—	10,4	0,234	1,2	0,039 x2	0,3 x2
FCAG100BVEB	RZAG100N2Y1B				14,2	—	16	—	11,8	0,234	1,2	0,117	0,7
FFA35A2VEB	x3 RZAG100N2Y1B				12,7	—	16	—	10,4	0,234	1,2	0,050 x3	0,2 x3
FFA50A2VEB	x2 RZAG100N2Y1B	12,9			—	16	—	10,4	0,234	1,2	0,050 x2	0,4 x2	
FBA35A2VEB	x3 RZAG100N2Y1B	16,3			—	20	—	10,4	0,234	1,2	0,089 x3	1,4 x3	
FBA50A2VEB	x2 RZAG100N2Y1B	14,9			—	16	—	10,4	0,234	1,2	0,089 x2	1,4 x2	
FBA100A2VEB	RZAG100N2Y1B	17,0			—	20	—	11,8	0,234	1,2	0,127	3,5	
FNA35A2VEB	x3 RZAG100N2Y1B	13,6		—	16	—	10,4	0,234	1,2	0,034 x3	0,5 x3		
FNA50A2VEB	x2 RZAG100N2Y1B	13,1		—	16	—	10,4	0,234	1,2	0,060 x2	0,5 x2		
FUA100AVEB9	RZAG100N2Y1B	14,0		—	16	—	11,8	0,234	1,2	0,106	1,3		
FAA100BUV1B	RZAG100N2Y1B	14,4		—	16	—	11,8	0,234	1,2	0,064	0,9		
FVA100AMVEB	RZAG100N2Y1B	15,1		—	16	—	11,8	0,234	1,2	0,238	1,5		
FDMX35F3V1B	x3 RZAG100N2Y1B	13,0		—	16	—	10,4	0,234	1,2	0,034 x3	0,3 x3		
FDMX50F3V1B	x2 RZAG100N2Y1B	13,9		—	16	—	10,4	0,234	1,2	0,060 x2	0,9 x2		
FHA35AVEB99	x3 RZAG100N2Y1B	13,9		—	16	—	10,4	0,234	1,2	0,060 x3	0,6 x3		
FHA50AVEB99	x2 RZAG100N2Y1B	13,3		—	16	—	10,4	0,234	1,2	0,060 x2	0,6 x2		
FHA100AVEB9	RZAG100N2Y1B	14,9	—	16	—	11,8	0,234	1,2	0,150	1,3			

Indoor	Outdoor	Power supply	Voltage range	MCA	TOCA	MFA	Compressor		OFM		IFM	
							MSC	RLA	kW	FLA	kW	FLA
FCAHG125HVEB	RZAG125N2Y1B	3N~ 50Hz 380-415V	Minimum: -342 V Maximum: -457 V	15,0	—	16	—	11,8	0,234	1,2	0,244	1,4
FCAG35BVEB	x4 RZAG125N2Y1B			12,2	—	16	—	9,3	0,234	1,2	0,044 x4	0,3 x4
FCAG50BVEB	x3 RZAG125N2Y1B			12,9	—	16	—	10,3	0,234	1,2	0,039 x3	0,3 x3
FCAG60BVEB	x2 RZAG125N2Y1B			14,1	—	16	—	11,8	0,234	1,2	0,044 x2	0,3 x2
FCAG125BVEB	RZAG125N2Y1B			14,6	—	16	—	11,8	0,234	1,2	0,168	1,0
FFA35A2VEB	x4 RZAG125N2Y1B			11,8	—	16	—	9,3	0,234	1,2	0,050 x4	0,2 x4
FFA50A2VEB	x3 RZAG125N2Y1B			13,2	—	16	—	10,3	0,234	1,2	0,050 x3	0,4 x3
FFA60A2VEB	x2 RZAG125N2Y1B			14,8	—	16	—	11,8	0,234	1,2	0,050 x2	0,6 x2
FBA35A2VEB	x4 RZAG125N2Y1B			16,5	—	20	—	9,3	0,234	1,2	0,089 x4	1,4 x4
FBA50A2VEB	x3 RZAG125N2Y1B			16,2	—	20	—	10,3	0,234	1,2	0,089 x3	1,4 x3
FBA60A2VEB	x2 RZAG125N2Y1B			16,1	—	20	—	11,8	0,234	1,2	0,070 x2	1,3 x2
FBA125A2VEB	RZAG125N2Y1B			17,4	—	20	—	11,8	0,234	1,2	0,187	3,9
FNA35A2VEB	x4 RZAG125N2Y1B		13,0	—	16	—	9,3	0,234	1,2	0,034 x4	0,5 x4	
FNA50A2VEB	x3 RZAG125N2Y1B		13,5	—	16	—	10,3	0,234	1,2	0,060 x3	0,5 x3	
FNA60A2VEB	x2 RZAG125N2Y1B		14,8	—	16	—	11,8	0,234	1,2	0,060 x2	0,6 x2	
FUA125AVEB9	RZAG125N2Y1B		15,0	—	16	—	11,8	0,234	1,2	0,106	1,4	
FDA125AVEB9	RZAG125N2Y1B		15,7	—	16	—	11,8	0,234	1,2	0,350	2,1	
FVA125AMVEB	RZAG125N2Y1B		15,1	—	16	—	11,8	0,234	1,2	0,238	1,5	
FDMX35F3V1B	x4 RZAG125N2Y1B		12,2	—	16	—	9,3	0,234	1,2	0,034 x4	0,3 x4	
FDMX50F3V1B	x3 RZAG125N2Y1B		14,8	—	16	—	10,3	0,234	1,2	0,060 x3	0,9 x3	
FDMX60F3V1B	x2 RZAG125N2Y1B		15,4	—	16	—	11,8	0,234	1,2	0,060 x2	0,9 x2	
FHA35AVEB99	x4 RZAG125N2Y1B		13,4	—	16	—	9,3	0,234	1,2	0,060 x4	0,6 x4	
FHA50AVEB99	x3 RZAG125N2Y1B		13,8	—	16	—	10,3	0,234	1,2	0,060 x3	0,6 x3	
FHA60AVEB99	x2 RZAG125N2Y1B		14,8	—	16	—	11,8	0,234	1,2	0,091 x2	0,6 x2	
FHA125AVEB9	RZAG125N2Y1B	15,1	—	16	—	11,8	0,234	1,2	0,150	1,5		
FCAHG71HVEB	x2 RZAG140N2Y1B	3N~ 50Hz 380-415V	Minimum: -342 V Maximum: -457 V	15,0	—	16	—	11,6	0,234	1,4	0,091 x2	0,7 x2
FCAHG140HVEB	RZAG140N2Y1B			15,0	—	16	—	11,6	0,234	1,4	0,244	1,4
FCAG35BVEB	x4 RZAG140N2Y1B			12,2	—	16	—	9,1	0,234	1,4	0,044 x4	0,3 x4
FCAG50BVEB	x3 RZAG140N2Y1B			12,9	—	16	—	10,1	0,234	1,4	0,039 x3	0,3 x3
FCAG71BVEB	x2 RZAG140N2Y1B			14,4	—	16	—	11,6	0,234	1,4	0,054 x2	0,4 x2
FCAG140BVEB	RZAG140N2Y1B			14,9	—	16	—	11,6	0,234	1,4	0,168	1,3
FFA35A2VEB	x4 RZAG140N2Y1B			11,8	—	16	—	9,1	0,234	1,4	0,050 x4	0,2 x4
FFA50A2VEB	x3 RZAG140N2Y1B			13,2	—	16	—	10,1	0,234	1,4	0,050 x3	0,4 x3
FBA35A2VEB	x4 RZAG140N2Y1B			16,5	—	20	—	9,1	0,234	1,4	0,089 x4	1,4 x4
FBA50A2VEB	x3 RZAG140N2Y1B			16,2	—	20	—	10,1	0,234	1,4	0,089 x3	1,4 x3
FBA71A2VEB	x2 RZAG140N2Y1B			16,1	—	20	—	11,6	0,234	1,4	0,070 x2	1,3 x2
FBA140A2VEB	RZAG140N2Y1B			17,4	—	20	—	11,6	0,234	1,4	0,187	3,9
FNA35A2VEB	x4 RZAG140N2Y1B		13,0	—	16	—	9,1	0,234	1,4	0,034 x4	0,5 x4	
FNA50A2VEB	x3 RZAG140N2Y1B		13,5	—	16	—	10,1	0,234	1,4	0,060 x3	0,5 x3	
FUA71AVEB9	x2 RZAG140N2Y1B		15,4	—	16	—	11,6	0,234	1,4	0,046 x2	0,9 x2	
FAA71BUV1B	x2 RZAG140N2Y1B		14,6	—	16	—	11,6	0,234	1,4	0,048 x2	0,5 x2	
FVA71AMVEB	x2 RZAG140N2Y1B		15,2	—	16	—	11,6	0,234	1,4	0,117 x2	0,8 x2	
FVA140AMVEB	RZAG140N2Y1B		15,4	—	16	—	11,6	0,234	1,4	0,276	1,8	
FDMX35F3V1B	x4 RZAG140N2Y1B		12,2	—	16	—	9,1	0,234	1,4	0,034 x4	0,3 x4	
FDMX50F3V1B	x3 RZAG140N2Y1B		14,8	—	16	—	10,1	0,234	1,4	0,060 x3	0,9 x3	
FHA35AVEB99	x4 RZAG140N2Y1B		13,4	—	16	—	9,1	0,234	1,4	0,060 x4	0,6 x4	
FHA50AVEB99	x3 RZAG140N2Y1B		13,8	—	16	—	10,1	0,234	1,4	0,060 x3	0,6 x3	
FHA71AVEB99	x2 RZAG140N2Y1B		15,2	—	16	—	11,6	0,234	1,4	0,091 x2	0,8 x2	
FHA140AVEB9	RZAG140N2Y1B		15,4	—	16	—	11,6	0,234	1,4	0,150	1,8	

Symbols

- MCA: Minimum Circuit Ampere [A]
- TOCA: Total overcurrent amps [A]
- MFA: Maximum Fuse Ampere [A]
- MSC: Maximum current of the starting compressor [A]
- RLA: Rated load amps [A]
- OFM: Outdoor fan motor
- IFM: Indoor fan motor
- FLA: Full Load Ampere [A]
- KW: Fan motor rated output [kW]

3D120943D

4 Options

4 - 1 Options

RZAG-NV1
RZAG-NY1

Available options for ·RZAG· models

Option	Option kit			
	RZAG71N7V1B	RZAG100N7V1B	RZAG125N7V1B	RZAG140N7V1B
	RZAG71N7Y1B	RZAG100N7Y1B	RZAG125N7Y1B	RZAG140N7Y1B
	RZAG71N2V1B	RZAG100N2V1B	RZAG125N2V1B	RZAG140N2V1B
	RZAG71N2Y1B	RZAG100N2Y1B	RZAG125N2Y1B	RZAG140N2Y1B
Bottom plate heater		EKBPH140N		
Refrigerant branch piping	Twin	KHRQ(M)58T		
	Triple	KHRQ(M)58H		
	Double twin	-	KHRQ(M)58T (3x)	
Demand adaptor kit (1)		SB.KRP58M52 (KRP58M51 + EKMKA2)		
Sound reduction kit		EKLN140A1		

Notes

- (1) To mount ·KRP58M51·, an additional mounting kit (·EKMKA2·) needs to be used (obligatory).
 This will be offered as sales bom SB.·KRP58M52· = ·KRP58M51· + ·EKMKA2·

3D120932C

5 Combination table

5 - 1 Combination Table

5

RZAG-NV1

RZAG-NY1

Possible combinations

- P= Pair
- 2= Twin
- 3= Triple
- 4= Double twin

OU_IO_ID	FAA71B1UV1B	FAA100B1UV1B	FBA100A2VEB	FBA140A2VEB	FBA35A2VEB9	FBA50A2VEB9	FBA71A2VEB9	FCAG35BVEB	FCAG50BVEB	FCAG71BVEB	FCAG100BVEB	FCAG140BVEB	FCAG71HVEB	FCAG100HVEB	FCAG140HVEB	FDXM35F3V1B9	FDXM50F3V1B9	FFA35A2VEB9	FFA50A2VEB9	FHA100AVEB9	FHA140AVEB9	FHA35AVEB99	FHA50AVEB99	FHA71AVEB99	FUA71AVEB9	FUA100AVEB9	FVA100AMVEB	FVA140AMVEB
RZAG71N7V1B		P	P		3	2		3	2		P			P		3	2	3	2	P		3	2			P	P	
RZAG100N7V1B	2			P	4	3	2	4	3	2		P	2		P	4	3	4	3		P	4	3	2	2			P
RZAG125N7V1B	2			P	4	3	2	4	3	2		P	2		P	4	3	4	3		P	4	3	2	2			P
RZAG140N7V1B	2			P	4	3	2	4	3	2		P	2		P	4	3	4	3		P	4	3	2	2			P
RZAG71N7Y1B		P	P		3	2		3	2		P			P		3	2	3	2	P		3	2			P	P	
RZAG100N7Y1B	2			P	4	3	2	4	3	2		P	2		P	4	3	4	3		P	4	3	2	2			P
RZAG125N7Y1B	2			P	4	3	2	4	3	2		P	2		P	4	3	4	3		P	4	3	2	2			P
RZAG140N7Y1B	2			P	4	3	2	4	3	2		P	2		P	4	3	4	3		P	4	3	2	2			P

Notes

- When combining multiple indoor units, designate the unit whose remote controller is equipped with the most functions as the master unit.

3D120929B

RZAG-NV1

RZAG-NY1

Possible combinations

- P= Pair
- 2= Twin
- 3= Triple
- 4= Double twin

OU_IO_ID	FAA71B1UV1B	FAA100B1UV1B	FBA100A2VEB	FBA125A2VEB	FBA140A2VEB	FBA35A2VEB9	FBA50A2VEB9	FBA60A2VEB9	FBA71A2VEB9	FCAG35BVEB	FCAG50BVEB	FCAG60BVEB	FCAG71BVEB	FCAG100BVEB	FCAG125BVEB	FCAG140BVEB	FCAG71HVEB	FCAG100HVEB	FCAG125HVEB	FCAG140HVEB	FDA125A5VEB	FDXM35F3V1B9	FDXM50F3V1B9	FDXM60F3V1B9	FFA35A2VEB9	FFA50A2VEB9	FFA60A2VEB9	FHA100AVEB9	FHA125AVEB9	FHA140AVEB9	FHA35AVEB99	FHA50AVEB99	FHA60AVEB99	FHA71AVEB99	FNA35A2VEB9	FNA50A2VEB9	FNA60A2VEB9	FUA71AVEB9	FUA100AVEB9	FUA125AVEB9	FUA71AMVEB	FVA100AMVEB	FVA125AMVEB	FVA140AMVEB									
RZAG71N7V1B	P					2			P	2			P				P					2																															
RZAG100N7V1B		P	P			3	2			3	2		P				P					3	2	3	2		P																										
RZAG125N7V1B			P		P	4	3	2		4	3	2		P			P				P	4	3	2	4	3	2		P																								
RZAG140N7V1B	2			P	P	4	3	2	4	3	2			P	2			P				4	3	4	3			P	4	3																							
RZAG71N7Y1B	P				2				P	2			P				P					2																															
RZAG100N7Y1B		P	P			3	2			3	2			P			P					3	2	3	2		P																										
RZAG125N7Y1B			P		P	4	3	2		4	3	2		P			P				P	4	3	2	4	3	2		P	4	3																						
RZAG140N7Y1B	2			P	P	4	3	2	4	3	2			P	2			P				4	3	4	3			P	4	3																							

Notes

- When combining multiple indoor units, designate the unit whose remote controller is equipped with the most functions as the master unit.



3D120926B

6 Capacity tables

6 - 1 Cooling/Heating Capacity Tables

RZAG71NV1

RZAG71NY1

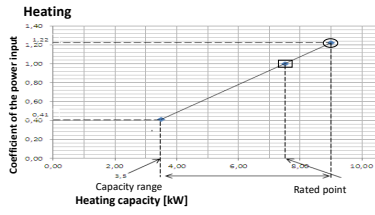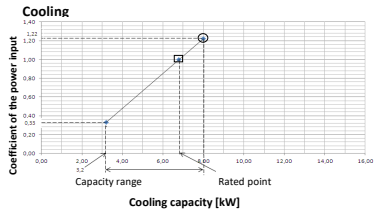

Symbols

- AFR: Air flow rate [m³/min]
 - BF: Bypass factor
 - EWB: Entering wet-bulb temperature [°C WB]
 - EDB: Entering dry-bulb temperature [°C DB]
 - TC: Maximum total cooling/heating capacity [kW]
 - SHC: Sensible heat capacity [kW]
 - CPI: Coefficient of the power input
 - PI: Power input [kW]
- compressor + indoor and outdoor fan motors

Indoor	Outdoor temperature [°C DB]												
	25			30			35			40			
	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	
[°C WB]	[°C DB]	kW	kW	-	kW	kW	-	kW	kW	-	kW	kW	-
16.0	22	8.03	5.45	1.00	7.76	5.32	1.11	7.48	5.20	1.21	7.21	5.06	1.32
18.0	25	8.40	5.45	1.00	8.11	5.32	1.11	7.83	5.19	1.22	7.54	5.05	1.33
19.0	27	8.59	5.44	1.01	8.30	5.32	1.12	8.00	5.18	1.22	7.70	5.05	1.33
19.5	27	8.68	5.43	1.01	8.39	5.31	1.12	8.09	5.17	1.22	7.79	5.05	1.33
22.0	30	9.15	5.38	1.01	8.84	5.25	1.12	8.52	5.13	1.23	8.21	4.99	1.34
24.0	32	9.53	5.31	1.03	9.20	5.19	1.13	8.87	5.06	1.25	8.54	4.92	1.35

Indoor	Outdoor temperature [°C WB]														
	-15			-10			-5			0			10		
	TC	CPI	TC	CPI	TC	CPI	TC	CPI	TC	CPI	TC	CPI	TC	CPI	
[°C DB]	kW	-	kW	-	kW	-	kW	-	kW	-	kW	-	kW	-	
16	6.44	0.93	7.09	0.99	7.55	1.02	7.79	1.06	9.00	1.12	9.71	1.19	1.19	1.19	
18	6.43	0.98	7.08	1.03	7.54	1.07	7.78	1.10	9.00	1.17	9.71	1.24	1.24	1.24	
20	6.42	1.01	7.07	1.07	7.53	1.12	7.77	1.14	9.00	1.22	9.71	1.28	1.28	1.28	
21	6.42	1.03	7.07	1.09	7.53	1.13	7.77	1.16	9.00	1.24	9.71	1.31	1.31	1.31	
22	6.42	1.05	7.06	1.11	7.52	1.15	7.76	1.19	9.00	1.27	9.71	1.33	1.33	1.33	
24	6.41	1.09	7.05	1.15	7.51	1.20	7.75	1.23	9.00	1.32	9.67	1.38	1.38	1.38	

- The ratings shown are net capacities which include a correction for indoor fan motor heat.
- = Maximum at standard conditions
□ = Rated capacity and rated coefficient of the power input
The maximum capacity is not guaranteed except at standard conditions.
- SHC- is based on indoor units -EWB & EDB-
-SHC- for other dry-bulb temperatures = SHC + SHC*
SHC* = -SHC- correction for other dry-bulb temperatures
= 0.02 x AFR (m³/min) x (1-BF) x (DB* - EDB)
- The capacities are based on the following conditions:
Outdoor air: 85% RH-
However, the outdoor ambient condition of the rated capacity during heating operation is -7°C DB / 6°C WB.
Corresponding refrigerant piping length: -5.0- m
Level difference: -0- m
- CPI- is a percentage value compared to the rated value which is -1.00-.
- The error rate for this value is less than -5- % and depends on the indoor unit type.
- The heating performance takes into account the drop that occurs during defrost operation.
- The air flow rate and bypass factor are mentioned in the table.
- The rated power input for each model is mentioned in the table below.

Pair	FCAG71H	FCAG71B	FAA71B	FVA71A	FHA71A	FUA71A	FBA71A
Cooling	1.65	1.92	2.08	2.08	1.81	1.77	2.00
Heating	1.60	2.02	2.19	2.21	1.90	1.73	1.99

Twin	FCAG35B X 2	FHA35A X 2	FFA35A X 2	FDXM35F X 2	FBA35A X 2	FNA35A X 2
Cooling	1.56	1.53	1.75	1.64	1.67	1.68
Heating	1.59	1.69	2.25	1.84	1.90	1.86



Pair	FCAG71H	FCAG71B	FAA71B	FVA71A	FHA71A	FUA71A	FBA71A
AFR	21.2	15.3	18.0	18.0	20.5	23.0	18.0
(BF)	(0.20)	(0.14)	(0.16)	(0.16)	(0.13)	(0.24)	(0.13)

Twin	FCAG35B X 2	FHA35A X 2	FFA35A X 2	FDXM35F X 2	FBA35A X 2	FNA35A X 2
AFR	12.5 x 2	14.0 x 2	10.0 x 2	8.7 x 2	15.0 x 2	8.7 x 2
(BF)	(0.40 x 2)	(0.17 x 2)	(0.25 x 2)	(0.17 x 2)	(0.08 x 2)	(0.17 x 2)

3D125180B

RZAG100NV1

RZAG100NY1

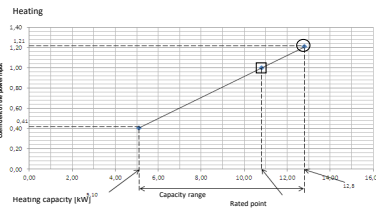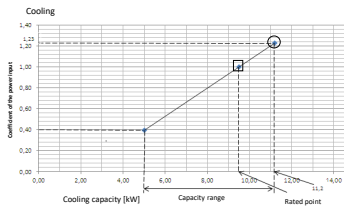

Symbols

- AFR: Air flow rate [m³/min]
 - BF: Bypass factor
 - EWB: Entering wet-bulb temperature [°C WB]
 - EDB: Entering dry-bulb temperature [°C DB]
 - TC: Maximum total cooling/heating capacity [kW]
 - SHC: Sensible heat capacity [kW]
 - CPI: Coefficient of the power input
 - PI: Power input [kW]
- compressor + indoor and outdoor fan motors

Indoor	Outdoor temperature [°C DB]												
	25			30			35			40			
	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	
[°C WB]	[°C DB]	kW	kW	-	kW	kW	-	kW	kW	-	kW	kW	-
16.0	22	11.20	7.61	1.01	10.85	7.44	1.11	10.50	7.29	1.22	10.11	7.09	1.32
18.0	25	11.80	7.59	1.01	11.37	7.49	1.12	11.00	7.27	1.23	10.55	7.09	1.33
19.0	27	12.00	7.57	1.02	11.62	7.44	1.12	11.20	7.26	1.23	10.80	7.04	1.33
19.5	27	12.15	7.59	1.02	11.74	7.37	1.13	11.43	7.34	1.23	10.91	7.04	1.34
22.0	30	12.80	7.52	1.02	12.37	7.36	1.13	11.90	7.16	1.24	11.52	7.03	1.35
24.0	32	13.30	7.42	1.03	12.88	7.27	1.14	12.40	7.06	1.25	11.97	6.91	1.36

Indoor	Outdoor temperature [°C WB]														
	-15			-10			-5			0			10		
	TC	CPI	TC	CPI	TC	CPI	TC	CPI	TC	CPI	TC	CPI	TC	CPI	
[°C DB]	kW	-	kW	-	kW	-	kW	-	kW	-	kW	-	kW	-	
16	8.58	0.92	9.45	0.98	10.1	1.02	10.4	1.05	12.8	1.11	13.8	1.18	1.18	1.18	
18	8.57	0.97	9.44	1.02	10.0	1.06	10.3	1.09	12.8	1.16	13.8	1.23	1.23	1.23	
20	8.56	1.00	9.43	1.06	10.0	1.11	10.3	1.13	12.8	1.21	13.8	1.27	1.27	1.27	
21	8.56	1.02	9.42	1.08	10.0	1.12	10.3	1.15	12.8	1.23	13.8	1.30	1.30	1.30	
22	8.55	1.04	9.42	1.1	10.0	1.14	10.3	1.18	12.8	1.26	13.8	1.32	1.32	1.32	
24	8.54	1.08	9.41	1.14	10.0	1.19	10.3	1.22	12.8	1.31	13.8	1.37	1.37	1.37	

- The ratings shown are net capacities which include a correction for indoor fan motor heat.
- = Maximum at standard conditions
□ = Rated capacity and rated coefficient of the power input
The maximum capacity is not guaranteed except at standard conditions.
- SHC- is based on indoor units -EWB & EDB-
-SHC- for other dry-bulb temperatures = SHC + SHC*
SHC* = -SHC- correction for other dry-bulb temperatures
= 0.02 x AFR (m³/min) x (1-BF) x (DB* - EDB)
- The capacities are based on the following conditions:
Outdoor air: 85% RH-
However, the outdoor ambient condition of the rated capacity during heating operation is -7°C DB / 6°C WB.
Corresponding refrigerant piping length: -5.0- m
Level difference: -0- m
- CPI- is a percentage value compared to the rated value which is -1.00-.
- The error rate for this value is less than -5- % and depends on the indoor unit type.
- The heating performance takes into account the drop that occurs during defrost operation.

8. The air flow rate and bypass factor are mentioned in the table.

Pair	FCAG100H	FCAG100B	FAA100B	FVA100A	FHA100A	FUA100A	FBA100A
AFR	32.3	22.8	26.0	28.0	28.0	31.0	29.0
(BF)	(0.17)	(0.17)	(0.18)	(0.20)	(0.09)	(0.20)	(0.09)

Twin

	FCAG50B X 2	FHA50A X 2	FFA50A X 2	FDXM50F X 2	FBA50A X 2	FNA50A X 2
AFR	13.6 x 2	15.0 x 2	12.0 x 2	15.8 x 2	15.0 x 2	16.0 x 2
(BF)	(0.22 x 2)	(0.18 x 2)	(0.16 x 2)	(0.11 x 2)	(0.13 x 2)	(0.11 x 2)

Triple

	FCAG35B X 3	FHA35A X 3	FFA35A X 3	FDXM35F X 3	FBA35A X 3	FNA35A X 3
AFR	12.5 x 3	14.0 x 3	10.0 x 3	8.7 x 3	15.0 x 3	8.7 x 3
(BF)	(0.40 x 3)	(0.17 x 3)	(0.25 x 3)	(0.17 x 3)	(0.08 x 3)	(0.17 x 3)

9. The rated power input for each model is mentioned in the table below.

Pair	FCAG100H	FCAG100B	FAA100B	FVA100A	FHA100A	FUA100A	FBA100A
Cooling	2.25	2.65	2.93	2.66	2.31	2.66	2.58
Heating	2.36	2.91	3.41	2.79	2.72	2.68	2.79

Twin

	FCAG50B X 2	FHA50A X 2	FFA50A X 2	FDXM50F X 2	FBA50A X 2	FNA50A X 2
Cooling	2.16	2.35	2.51	2.80	2.29	2.10
Heating	2.37	2.65	2.75	2.57	2.79	2.57

Triple

	FCAG35B X 3	FHA35A X 3	FFA35A X 3	FDXM35F X 3	FBA35A X 3	FNA35A X 3
Cooling	2.05	2.00	2.23	2.11	2.20	2.17
Heating	2.36	2.15	2.76	2.91	2.32	2.91

3D125181C



6 Capacity tables

6 - 1 Cooling/Heating Capacity Tables

6

RZAG125NV1

RZAG125NY1

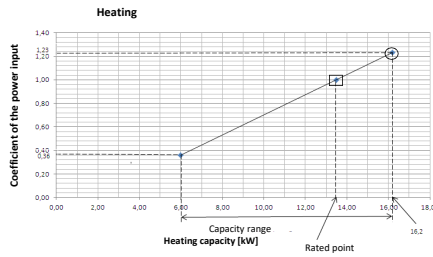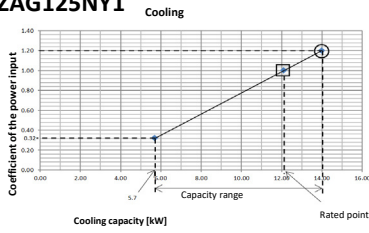

- Symbols**
 AFR: Air flow rate [m³/min]
 BF: Bypass factor
 EWB: Entering wet-bulb temperature [°C WB]
 EDB: Entering dry-bulb temperature [°C DB]
 TC: Maximum total cooling/heating capacity [kW]
 SHC: Sensible heat capacity [kW]
 CPI: Coefficient of the power input
 Pi: Power input [kW]
 compressor + indoor and outdoor fan motors

Indoor	Outdoor temperature [°C DB]												
	25			30			35			40			
TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI		
16.0	22	14.30	9.54	0.99	14.20	9.32	1.09	13.10	0.12	1.19	12.60	8.78	1.29
18.0	25	14.70	9.50	0.99	14.20	9.32	1.09	13.70	0.09	1.20	13.20	8.83	1.30
19.0	27	15.00	9.52	1.00	14.50	9.34	1.10	14.00	0.06	1.20	13.50	8.87	1.31
19.5	27	15.21	9.52	1.00	14.58	9.26	1.11	14.15	0.08	1.20	13.64	8.81	1.31
22.0	30	16.00	9.39	1.00	15.47	9.14	1.11	14.90	0.05	1.21	14.38	8.74	1.32
24.0	32	16.70	9.41	1.01	16.30	9.09	1.11	15.50	0.04	1.23	14.97	8.64	1.33

- Notes**
 1. The ratings shown are net capacities which include a deduction for indoor fan motor heat.
 ○ = Maximum at standard conditions
 □ = Rated capacity and rated coefficient of the power input
 The maximum capacity is not guaranteed except at standard conditions.
 3. SHC is based on indoor units -EWB & EDB.
 -SHC for other dry-bulb temperatures = SHC + SHC*
 SHC* = -SHC correction for other dry-bulb temperatures
 = 0.02 x AFR (m³/min) x (1-BF) x (DB* - EDB)
 4. The capacities are based on the following conditions:
 Outdoor air: 85% RH
 However, the outdoor ambient condition of the rated capacity during heating operation is 7°C DB / 6°C WB.
 Corresponding refrigerant piping length: 5.0 m
 Level difference: 0 m

Outdoor air: 85% RH
 However, the outdoor ambient condition of the rated capacity during heating operation is 7°C DB / 6°C WB.
 Corresponding refrigerant piping length: 5.0 m
 Level difference: 0 m

Pair	FCAG125H	FCAG125B	FDA125A	FVA125A	FHA125A	FUA125A	FBA125A
AFR	33.5	26.0	39.0	28.0	31.0	32.5	34.0
(BF)	(0.19)	(0.21)	(0.16)	(0.16)	(0.14)	(0.19)	(0.06)

Twin	FCAG30B x 2	FHA50A x 2	FFA50A x 2	FDXMS0F x 2	FBA50A x 2	FNAS0A x 2
AFR	13.6 x 2	19.5 x 2	14.5 x 2	16.0 x 2	18.0 x 2	16.0 x 2
(BF)	(0.20 x 2)	(0.20 x 2)	(0.11 x 2)	(0.12 x 2)	(0.18 x 2)	(0.12 x 2)

Triple	FCAG50A x 3	FHA50A x 3	FFA50A x 3	FDXMS0F x 3	FBA50A x 3	FNAS0A x 3
AFR	12.8 x 3	15.0 x 3	12.0 x 3	15.8 x 3	15.0 x 3	16.0 x 3
(BF)	(0.22 x 3)	(0.18 x 3)	(0.16 x 3)	(0.11 x 3)	(0.13 x 3)	(0.11 x 3)

Double twin	FCAG35B x 4	FHA35A x 4	FFA35A x 4	FDXMS3F x 4	FBA35A x 4	FNAS3A x 4
AFR	17.5 x 4	14.0 x 4	10.0 x 4	8.7 x 4	15.0 x 4	8.7 x 4
(BF)	(0.40 x 4)	(0.17 x 4)	(0.25 x 4)	(0.17 x 4)	(0.08 x 4)	(0.17 x 4)

Indoor	Outdoor temperature [°C WB]											
	-15.0		-10.0		-5.0		0.0		6.0		10.0	
TC	CPI	TC	CPI	TC	CPI	TC	CPI	TC	CPI	TC	CPI	
1.6	11.0	0.94	1.21	1.00	1.29	1.03	1.32	1.06	1.62	1.13	1.75	1.20
1.8	11.0	0.98	1.21	1.03	1.29	1.08	1.32	1.11	1.62	1.18	1.75	1.26
2.0	11.0	1.02	1.20	1.08	1.29	1.13	1.32	1.15	1.62	1.23	1.75	1.30
2.1	11.0	1.04	1.20	1.10	1.28	1.14	1.32	1.17	1.62	1.26	1.75	1.32
2.2	11.0	1.06	1.20	1.12	1.28	1.16	1.32	1.20	1.62	1.28	1.74	1.34
2.4	11.0	1.10	1.20	1.16	1.28	1.21	1.32	1.24	1.62	1.33	1.74	1.39

5. CPI is a percentage value compared to the rated value which is -1.00.
 6. The error rate for this value is less than -5% and depends on the indoor unit type.
 7. The heating performance takes into account the drop that occurs during defrost operation.
 8. The air flow rate and bypass factor are mentioned in the table.
 9. The rated power input for each model is mentioned in the table below.

Pair	FCAG125H	FCAG125B	FDA125A	FVA125A	FHA125A	FUA125A	FBA125A
Cooling	3.15	3.65	3.73	3.77	3.56	4.00	3.70
Heating	3.08	3.82	3.26	3.84	3.36	3.40	3.15

Twin	FCAG30B x 2	FHA50A x 2	FFA50A x 2	FDXMS0F x 2	FBA50A x 2	FNAS0A x 2
Cooling	2.36	2.83	3.35	2.50	2.78	2.65
Heating	3.49	3.27	3.58	3.03	2.82	3.04



Triple	FCAG50A x 3	FHA50A x 3	FFA50A x 3	FDXMS0F x 3	FBA50A x 3	FNAS0A x 3
Cooling	2.57	2.79	2.97	2.36	2.74	2.50
Heating	2.86	2.73	3.19	2.45	2.69	2.53

Double twin	FCAG35B x 4	FHA35A x 4	FFA35A x 4	FDXMS3F x 4	FBA35A x 4	FNAS3A x 4
Cooling	2.51	2.45	2.71	2.55	2.96	2.62
Heating	2.63	2.41	3.44	2.88	2.84	2.91

3D125182

RZAG140NV1

RZAG140NY1

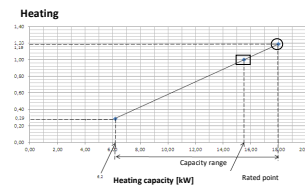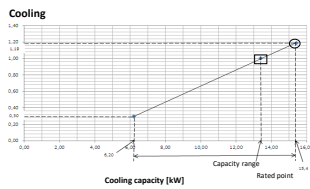

- Symbols**
 AFR: Air flow rate [m³/min]
 BF: Bypass factor
 EWB: Entering wet-bulb temperature [°C WB]
 EDB: Entering dry-bulb temperature [°C DB]
 TC: Maximum total cooling/heating capacity [kW]
 SHC: Sensible heat capacity [kW]
 CPI: Coefficient of the power input
 Pi: Power input [kW]
 compressor + indoor and outdoor fan motors

Indoor	Outdoor temperature [°C DB]												
	25			30			35			40			
TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI		
16.0	22	15.50	10.47	0.98	14.93	10.25	1.08	14.44	10.03	1.18	13.96	9.69	1.28
18.0	25	16.37	10.53	0.99	15.62	10.21	1.09	15.11	10.01	1.19	14.52	9.71	1.30
19.0	27	16.56	10.43	0.99	15.96	10.18	1.09	15.40	0.98	1.19	14.83	9.76	1.30
19.5	27	16.74	10.49	0.99	16.14	10.16	1.10	15.57	10.00	1.19	14.98	9.66	1.30
22.0	30	17.61	10.37	0.99	17.01	10.16	1.10	16.36	0.83	1.21	15.76	9.60	1.31
24.0	32	18.38	10.20	1.00	17.72	10.00	1.11	17.04	0.67	1.22	16.43	9.47	1.32

- Notes**
 1. The ratings shown are net capacities which include a correction for indoor fan motor heat.
 ○ = Maximum at standard conditions
 □ = Rated capacity and rated coefficient of the power input
 The maximum capacity is not guaranteed except at standard conditions.
 3. SHC is based on indoor units -EWB & EDB.
 -SHC for other dry-bulb temperatures = SHC + SHC*
 SHC* = -SHC correction for other dry-bulb temperatures
 = 0.02 x AFR (m³/min) x (1-BF) x (DB* - EDB)
 4. The capacities are based on the following conditions:
 Outdoor air: 85% RH
 However, the outdoor ambient condition of the rated capacity during heating operation is 7°C DB / 6°C WB.
 Corresponding refrigerant piping length: 5.0 m
 Level difference: 0 m

Outdoor air: 85% RH
 However, the outdoor ambient condition of the rated capacity during heating operation is 7°C DB / 6°C WB.
 Corresponding refrigerant piping length: 5.0 m
 Level difference: 0 m

Pair	FCAG140H	FCAG140B	FVA140A	FHA140A	FBA140A
AFR	33.5	26.0	30.0	34.0	34.0
(BF)	(0.15)	(0.23)	(0.18)	(0.17)	(0.06)

Twin	FCAG71H x 2	FCAG71B x 2	FAA71B x 2	FHA71A x 2	FUA71A x 2	FBA71A x 2	FVA71A x 2
AFR	21.2 x 2	15.3 x 2	18.0 x 2	20.5 x 2	23.0 x 2	18.0 x 2	18.0 x 2
(BF)	(0.20 x 2)	(0.14 x 2)	(0.16 x 2)	(0.13 x 2)	(0.24 x 2)	(0.13 x 2)	(0.16 x 2)

Triple	FCAG50B x 3	FHA50A x 3	FFA50A x 3	FDXMS0F x 3	FBA50A x 3	FNAS0A x 3
AFR	12.6 x 3	15.0 x 3	12.0 x 3	15.8 x 3	15.0 x 3	16.0 x 3
(BF)	(0.22 x 3)	(0.18 x 3)	(0.16 x 3)	(0.11 x 3)	(0.13 x 3)	(0.11 x 3)

Double twin	FCAG35B x 4	FHA35A x 4	FFA35A x 4	FDXMS3F x 4	FBA35A x 4	FNAS3A x 4
AFR	12.5 x 4	14.0 x 4	10.0 x 4	8.7 x 4	15.0 x 4	8.7 x 4
(BF)	(0.40 x 4)	(0.20 x 4)	(0.25 x 4)	(0.17 x 4)	(0.08 x 4)	(0.17 x 4)

Indoor	Outdoor temperature [°C WB]											
	-15		-10		-5		0		6		10	
TC	CPI	TC	CPI	TC	CPI	TC	CPI	TC	CPI	TC	CPI	
1.6	11.6	0.91	1.27	0.97	1.36	1.00	1.39	1.03	1.8.0	1.09	1.94	1.16
1.8	11.6	0.95	1.27	1.00	1.36	1.04	1.39	1.07	1.8.0	1.14	1.94	1.21
2.0	11.6	0.99	1.27	1.05	1.35	1.09	1.39	1.11	1.8.0	1.19	1.94	1.25
2.1	11.5	1.00	1.27	1.06	1.35	1.11	1.39	1.13	1.8.0	1.21	1.94	1.28
2.2	11.5	1.02	1.27	1.08	1.35	1.12	1.39	1.16	1.8.0	1.24	1.94	1.30
2.4	11.5	1.07	1.26	1.12	1.35	1.17	1.39	1.20	1.8.0	1.29	1.94	1.35

9. The rated power input for each model is mentioned in the table below.

Pair	FCAG140H	FCAG140B	FVA140A	FHA140A	FBA140A
Cooling	3.64	4.29	4.42	4.31	4.69
Heating	3.64	4.55	4.48	4.33	4.92

Twin	FCAG71H x 2	FCAG71B x 2	FAA71B x 2	FHA71A x 2	FUA71A x 2	FBA71A x 2	FVA71A x 2
Cooling	2.89	3.15	3.27	3.01	3.02	2.97	3.1
Heating	3.03	3.69	3.67	3.50	3.28	3.55	3.1

Triple	FCAG50B x 3	FHA50A x 3	FFA50A x 3	FDXMS0F x 3	FBA50A x 3	FNAS0A x 3
Cooling	2.88	3.14	3.37	2.65	3.06	2.79
Heating	3.44	3.29	3.87	2.96	3.22	3.03

Double twin	FCAG35B x 4	FHA35A x 4	FFA35A x 4	FDXMS3F x 4	FBA35A x 4	FNAS3A x 4
Cooling	3.08	2.73	3.04	2.87	3.32	2.94
Heating	3.97	2.89	4.19	3.49	4.22	3.53

3D125183B

6 Capacity tables

6 - 1 Cooling/Heating Capacity Tables

6

RZAG125NV1 RZAG125NY1

Performance characteristics for ·EDP· room

Indoor			Outdoor temperature [°C DB]																																			
			-20		-15		-10		-5		0		5		10		15		20		25		30		35		40											
RH [%]	*CWB	*CDB	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI									
41.8	11	18	7.49	7.49	0.32	7.49	7.49	0.33	7.49	7.49	0.34	7.49	7.49	0.35	7.49	7.49	0.36	7.49	7.49	0.37	7.49	7.49	0.38	7.49	7.49	0.38	10.25	9.60	0.98	9.71	9.28	1.08	9.17	8.94	1.18	8.69	8.60	1.27
57.0	13	18	9.34	7.60	0.41	9.34	7.60	0.42	9.34	7.60	0.43	9.34	7.60	0.44	9.34	7.60	0.45	9.34	7.60	0.45	9.34	7.60	0.45	9.34	7.60	0.45	11.91	9.22	0.99	11.41	8.92	1.09	10.91	8.61	1.19	10.37	8.28	1.28
31.4	11	20	7.49	7.49	0.32	7.49	7.49	0.33	7.49	7.49	0.34	7.49	7.49	0.35	7.49	7.49	0.36	7.49	7.49	0.37	7.49	7.49	0.38	7.49	7.49	0.38	10.25	10.25	0.98	9.71	9.71	1.08	9.17	9.17	1.18	8.69	8.69	1.27
44.9	13	20	9.34	8.65	0.41	9.34	8.65	0.42	9.34	8.65	0.43	9.34	8.65	0.44	9.34	8.65	0.45	9.34	8.65	0.45	9.34	8.65	0.45	9.34	8.65	0.45	11.91	10.27	0.99	11.41	9.96	1.09	10.91	9.64	1.19	10.37	9.31	1.28
52.0	14	20	10.27	8.56	0.46	10.27	8.56	0.46	10.27	8.56	0.47	10.27	8.56	0.48	10.27	8.56	0.49	10.27	8.56	0.49	10.27	8.56	0.49	10.27	8.56	0.49	12.88	10.16	0.99	12.54	10.00	1.09	12.21	9.83	1.19	11.87	9.55	1.29
22.9	11	22	7.49	7.49	0.32	7.49	7.49	0.33	7.49	7.49	0.34	7.49	7.49	0.35	7.49	7.49	0.36	7.49	7.49	0.37	7.49	7.49	0.38	7.49	7.49	0.38	10.25	10.25	0.98	9.71	9.71	1.08	9.17	9.17	1.18	8.69	8.69	1.27
34.8	13	22	9.34	9.34	0.41	9.34	9.34	0.42	9.34	9.34	0.43	9.34	9.34	0.44	9.34	9.34	0.45	9.34	9.34	0.45	9.34	9.34	0.45	9.34	9.34	0.45	11.91	11.91	0.99	11.41	11.41	1.09	10.91	10.91	1.19	10.37	10.37	1.28
47.6	15	22	11.20	9.34	0.50	11.20	9.34	0.51	11.20	9.34	0.52	11.20	9.34	0.53	11.20	9.34	0.54	11.20	9.34	0.54	11.20	9.34	0.54	11.20	9.34	0.54	13.83	11.06	0.99	13.36	10.78	1.09	12.88	10.49	1.20	12.41	10.20	1.29
54.3	16	22	12.12	9.00	0.55	12.12	9.00	0.55	12.12	9.00	0.56	12.12	9.00	0.57	12.12	9.00	0.58	12.12	9.00	0.58	12.12	9.00	0.58	12.12	9.00	0.58	14.51	10.10	1.00	13.98	9.89	1.10	13.52	9.67	1.20	12.98	9.35	1.30
21.2	12	24	8.42	8.42	0.36	8.42	8.42	0.37	8.42	8.42	0.38	8.42	8.42	0.39	8.42	8.42	0.41	8.42	8.42	0.41	8.42	8.42	0.41	8.42	8.42	0.41	11.08	11.08	0.98	10.56	10.56	1.08	10.04	10.04	1.19	9.53	9.53	1.27
32.1	14	24	10.27	10.27	0.46	10.27	10.27	0.46	10.27	10.27	0.47	10.27	10.27	0.49	10.27	10.27	0.50	10.27	10.27	0.50	10.27	10.27	0.50	10.27	10.27	0.50	12.88	12.88	0.99	12.54	12.54	1.09	12.21	12.21	1.19	11.87	11.87	1.29
43.8	16	24	12.12	10.35	0.55	12.12	10.35	0.55	12.12	10.35	0.56	12.12	10.35	0.57	12.12	10.35	0.58	12.12	10.35	0.58	12.12	10.35	0.58	12.12	10.35	0.58	14.51	11.71	1.00	13.98	11.44	1.10	13.52	11.21	1.20	12.98	10.90	1.30
50.0	17	24	12.47	9.38	0.56	12.47	9.38	0.57	12.47	9.38	0.58	12.47	9.38	0.59	12.47	9.38	0.60	12.47	9.38	0.60	12.47	9.38	0.60	12.47	9.38	0.60	15.20	11.96	1.00	14.64	11.02	1.10	13.89	10.66	1.20	13.24	10.25	1.31
21.5	14	27	10.27	10.27	0.46	10.27	10.27	0.46	10.27	10.27	0.47	10.27	10.27	0.49	10.27	10.27	0.50	10.27	10.27	0.50	10.27	10.27	0.50	10.27	10.27	0.50	12.88	12.88	0.99	12.54	12.54	1.09	12.21	12.21	1.19	11.87	11.87	1.29
26.3	15	27	11.20	11.20	0.50	11.20	11.20	0.51	11.20	11.20	0.52	11.20	11.20	0.53	11.20	11.20	0.54	11.20	11.20	0.54	11.20	11.20	0.54	11.20	11.20	0.54	13.83	13.83	0.99	13.36	13.36	1.09	12.88	12.88	1.20	12.41	12.41	1.29
31.3	16	27	12.12	11.12	0.55	12.12	11.12	0.55	12.12	11.12	0.56	12.12	11.12	0.57	12.12	11.12	0.58	12.12	11.12	0.58	12.12	11.12	0.58	12.12	11.12	0.58	14.51	14.51	1.00	13.98	13.98	1.10	13.52	13.52	1.20	12.98	12.98	1.30

Symbols
 TC: Maximum total cooling capacity [kW]
 SHC: Sensible heat capacity [kW]
 CPI: Coefficient of the power input
 Pl: Power input [kW]
 compressor + indoor and outdoor fan motors
 RH: Relative humidity [%]

Pair	FCAG140H	FCAG140B	FVA140A	FHA140A	FBA140A
Cooling	3.09	3.07	3.17	3.05	2.99

Twin	FCAG71Hx2	FCAG71Bx2	FHA71Ax2	FUA71Ax2	FAA71Bx2	FBA71Ax2
Cooling	2.57	2.79	2.68	2.69	2.88	2.64

Triple	FCAG50Bx3	FHA50Ax3	FFA50Ax3	FDXM50Fx3	FBA50Ax3
Cooling	2.57	2.79	2.97	2.36	2.74

Double	FCAG35Bx4	FHA35Ax4	FFA35Ax4	FDXM35Fx4	FBA35Ax4
Cooling	2.51	2.45	2.71	2.55	2.96

- Notes
- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
 - The capacities are based on the following conditions:
Outdoor air: 85% RH
Corresponding refrigerant piping length: 5.0 m
Level difference: 0 m
 - For EDP applications, it is recommended to use outdoor unit setting 2-57-2.
 - CPI is a percentage value compared to the rated value which is 1.00.
 - The error rate for this value is less than 5% and depends on the indoor unit type.
 - The rated power input for each model is mentioned in the table below.

3D125186A

RZAG140NV1 RZAG140NY1

Performance characteristics for ·EDP· room


Indoor			Outdoor temperature [°C DB]																																			
			-20		-15		-10		-5		0		5		10		15		20		25		30		35		40											
RH [%]	*CWB	*CDB	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI			
41.8	11	18	8.24	8.24	0.31	8.24	8.24	0.32	8.24	8.24	0.33	8.24	8.24	0.34	8.24	8.24	0.35	8.24	8.24	0.37	8.24	8.24	0.37	8.24	8.24	0.38	10.95	9.96	0.96	10.37	9.62	1.06	9.79	9.79	1.16	9.28	8.92	1.25
57.0	13	18	10.28	8.22	0.40	10.28	8.22	0.41	10.28	8.22	0.42	10.28	8.22	0.43	10.28	8.22	0.45	10.28	8.22	0.45	10.28	8.22	0.44	10.28	8.22	0.44	12.72	9.56	0.97	12.18	9.25	1.07	11.65	8.93	1.17	11.07	8.58	1.26
31.4	11	20	8.24	8.24	0.31	8.24	8.24	0.32	8.24	8.24	0.33	8.24	8.24	0.34	8.24	8.24	0.35	8.24	8.24	0.37	8.24	8.24	0.37	8.24	8.24	0.38	10.95	10.95	0.96	10.37	10.37	1.06	9.79	9.79	1.16	9.28	9.28	1.25
44.9	13	20	10.28	9.35	0.40	10.28	9.35	0.41	10.28	9.35	0.42	10.28	9.35	0.43	10.28	9.35	0.45	10.28	9.35	0.45	10.28	9.35	0.44	10.28	9.35	0.44	12.72	10.64	0.97	12.18	10.33	1.07	11.65	10.00	1.17	11.07	9.65	1.26
52.0	14	20	11.30	9.26	0.45	11.30	9.26	0.45	11.30	9.26	0.47	11.30	9.26	0.48	11.30	9.26	0.49	11.30	9.26	0.49	11.30	9.26	0.49	11.30	9.26	0.49	13.75	10.53	0.97	13.40	10.36	1.07	13.04	10.19	1.17	12.68	9.90	1.27
22.9	11	22	8.24	8.24	0.31	8.24	8.24	0.32	8.24	8.24	0.33	8.24	8.24	0.34	8.24	8.24	0.35	8.24	8.24	0.37	8.24	8.24	0.37	8.24	8.24	0.38	10.95	10.95	0.96	10.37	10.37	1.06	9.79	9.79	1.16	9.28	9.28	1.25
34.8	13	22	10.28	10.28	0.40	10.28	10.28	0.41	10.28	10.28	0.42	10.28	10.28	0.43	10.28	10.28	0.45	10.28	10.28	0.45	10.28	10.28	0.44	10.28	10.28	0.44	12.72	12.72	0.97	12.18	12.18	1.07	11.65	11.65	1.17	11.07	11.07	1.26
47.6	15	22	12.32	10.10	0.50	12.32	10.10	0.50	12.32	10.10	0.51	12.32	10.10	0.52	12.32	10.10	0.54	12.32	10.10	0.54	12.32	10.10	0.53	12.32	10.10	0.53	14.77	11.47	0.98	14.26	11.18	1.08	13.76	10.88	1.18	13.25	10.57	1.27
54.3	16	22	13.33	9.73	0.54	13.33	9.73	0.54	13.33	9.73	0.55	13.33	9.73	0.56	13.33	9.73	0.57	13.33	9.73	0.57	13.33	9.73	0.57	13.33	9.73	0.57	15.50	10.47	0.98	14.93	10.25	1.08	14.44	10.03	1.18	13.86	9.69	1.28
21.2	12	24	9.26	9.26	0.36	9.26	9.26	0.37	9.26	9.26	0.38	9.26	9.26	0.39	9.26	9.26	0.40	9.26	9.26	0.41	9.26	9.26	0.41	9.26	9.26	0.41	11.83	11.83	0.97	11.28	11.28	1.07	10.72	10.72	1.17	10.17	10.17	1.25
32.1	14	24	11.30	11.30	0.45	11.30	11.30	0.45	11.30	11.30	0.47	11.30	11.30	0.48	11.30	11.30	0.49	11.30	11.30	0.49	11.30	11.30	0.49	11.30	11.30	0.49	13.75	13.75	0.97	13.40	13.40	1.07	13.04	13.04	1.17	12.68	12.68	1.27
43.8	16	24	13.33	11.20	0.54	13.33																																

6 Capacity tables

6 - 2 Capacity Correction Factor

RZAG-NV1
RZAG-NY1

Capacity in function of field piping length

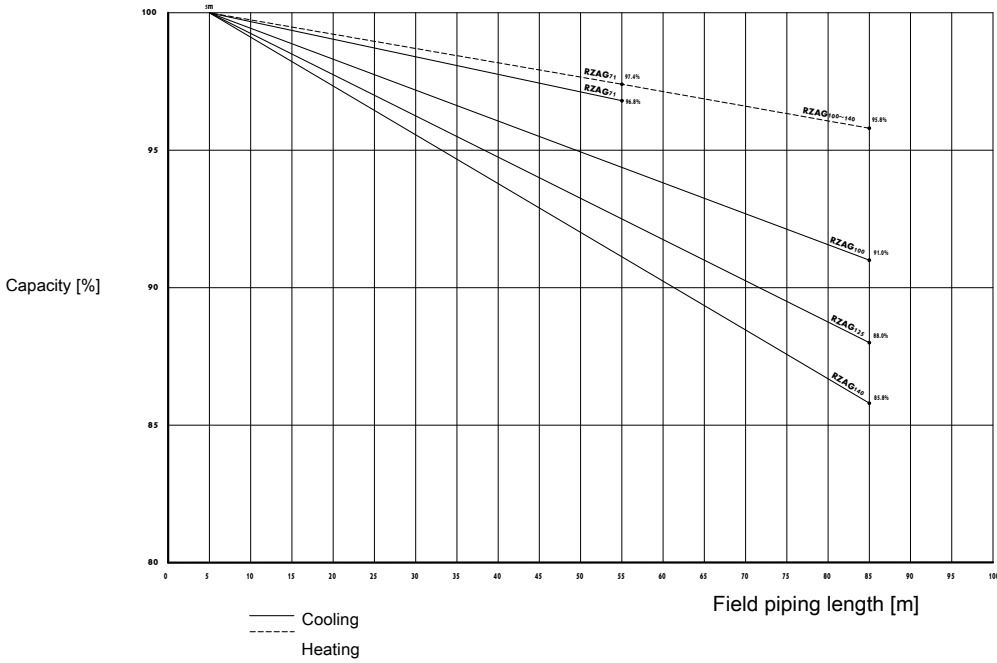


3D112162

7 Dimensional drawings

7 - 1 Dimensional Drawings

7

RZAG-NV1
RZAG-NY1

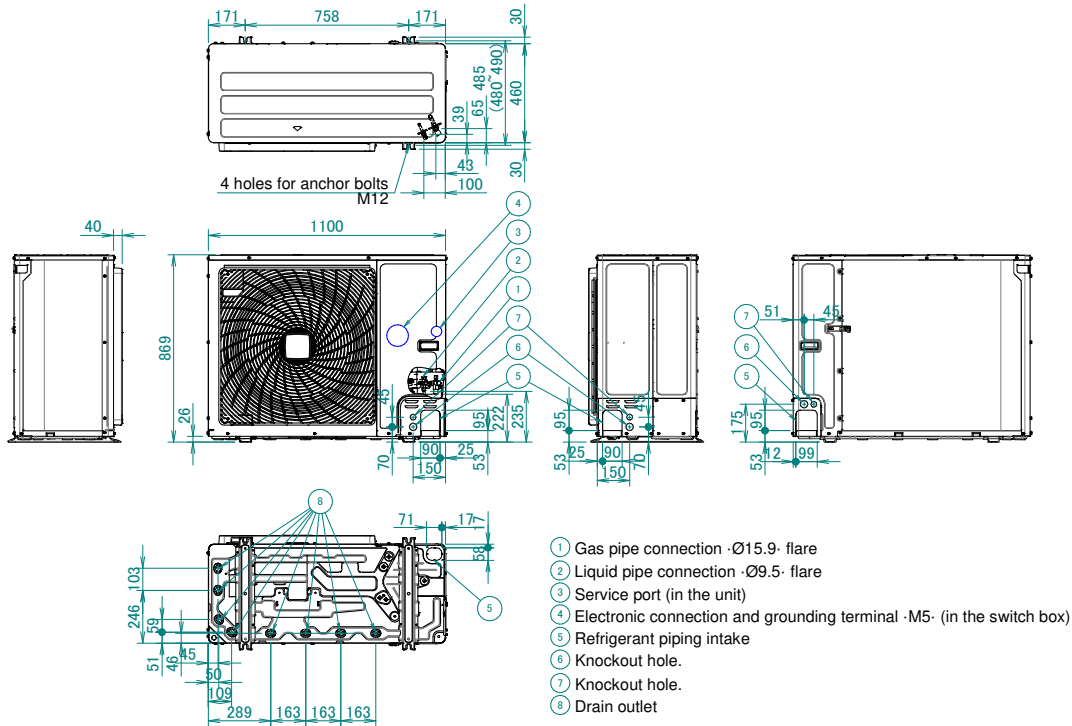


3D120936

8 Centre of gravity

8 - 1 Centre of Gravity

RZAG-NV1
RZAG-NY1

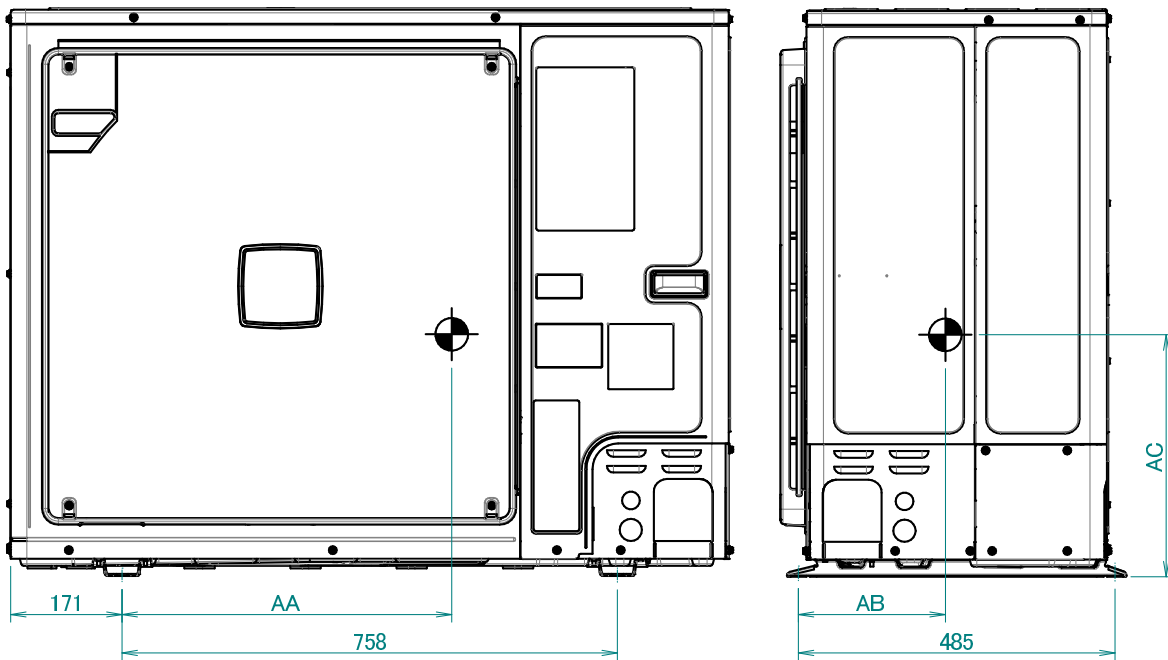

Model	AA	AB	AC
RZAG71N2/7V1B	520.3	238.7	357.8
RZAG71N2/7Y1B	525.9	224.7	359.8
RZAG100N2/7V1B	499.7	239.3	367.6
RZAG100N2/7Y1B	511.2	223.5	362.5
RZAG125/140N2/7V1B	486.3	229.2	371.8
RZAG125/140N2/7Y1B	493.4	215.8	372.2
RXYSA4/5/6A7V1B	530.4	249.9	389.0
RXYSA4/5/6A7Y1B			


4D120933C

9 Piping diagrams

9 - 1 Piping Diagrams

9

RZAG-NV1
RZAG-NY1

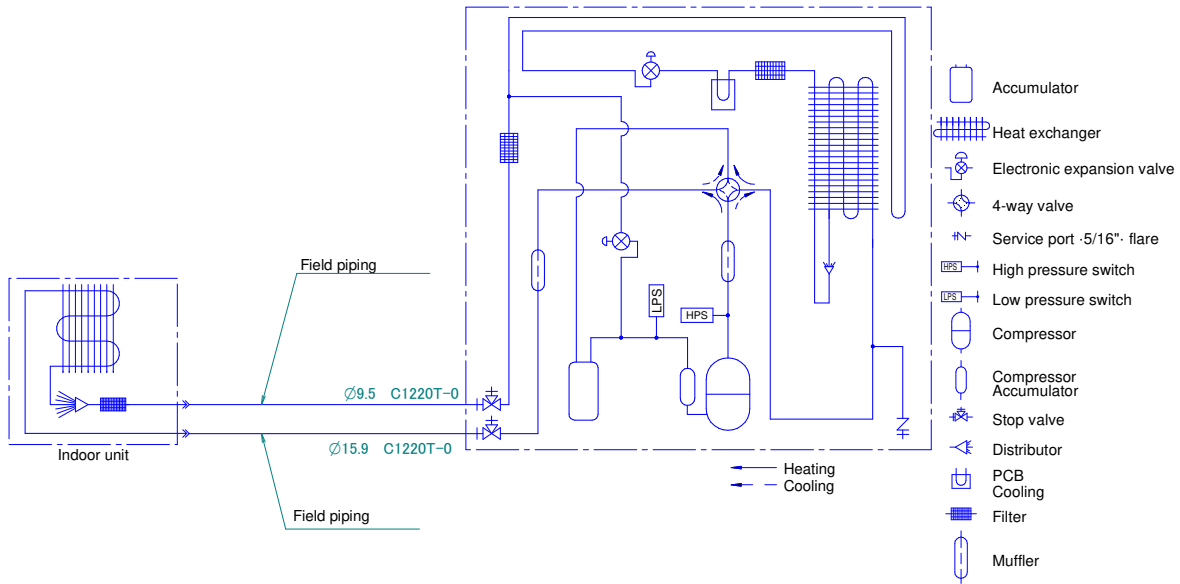

Notes


1. The pipes between the branch and the indoor units should have the same size as the indoor connections.

3D120907

9 Piping diagrams

9 - 2 Piping Diagram Twin Application

RZAG-NV1
RZAG-NY1

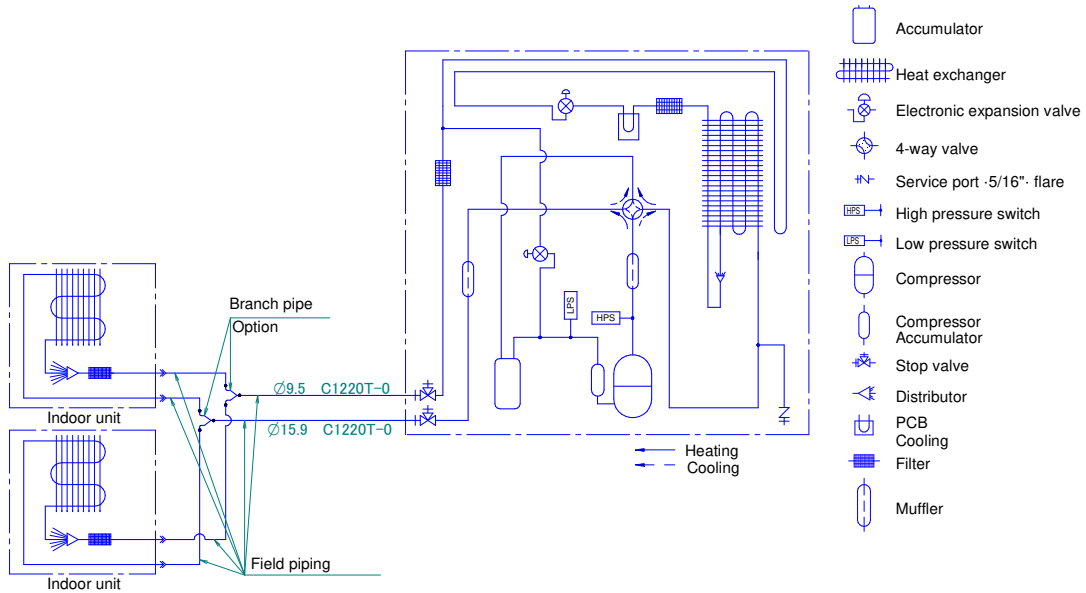

Notes

1. The pipes between the branch and the indoor units should have the same size as the indoor connections.


3D120913

9 Piping diagrams

9 - 3 Piping Diagram Triple Application

9

RZAG100-140NV1
RZAG100-140NY1

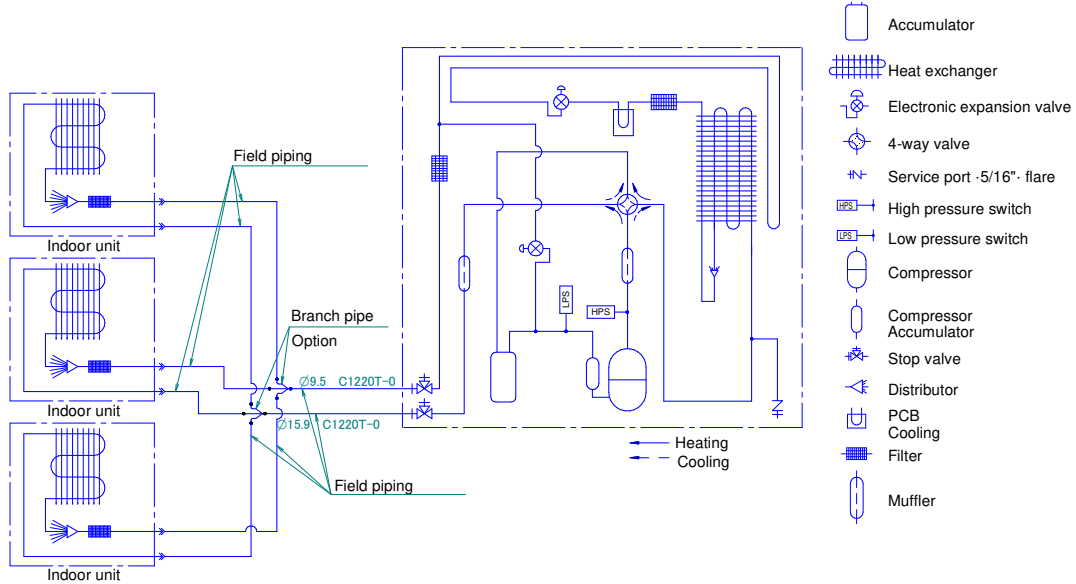

Notes


1. The pipes between the branch and the indoor units should have the same size as the indoor connections.

3D120914

9 Piping diagrams

9 - 4 Piping Diagram Double Twin Application

RZAG125-140NV1
RZAG125-140NY1

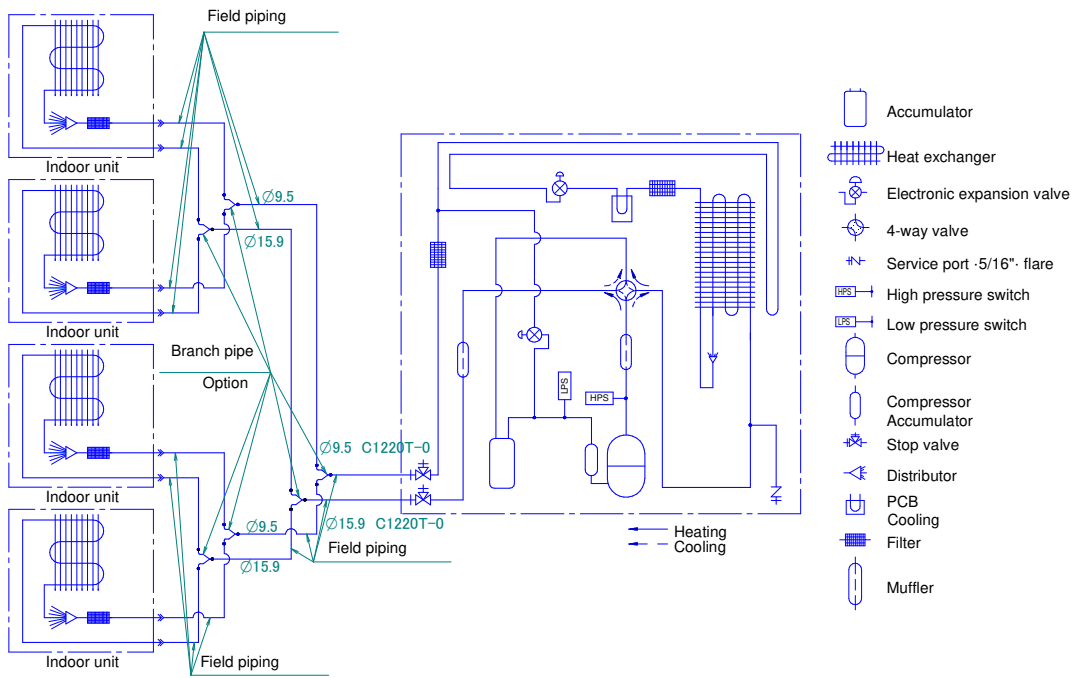

Notes

1. The pipes between the branch and the indoor units should have the same size as the indoor connections.

3D120915


10 Wiring diagrams

10 - 1 Wiring Diagrams - Single Phase

10

RZAG71-100NV1

(1) Connection diagram

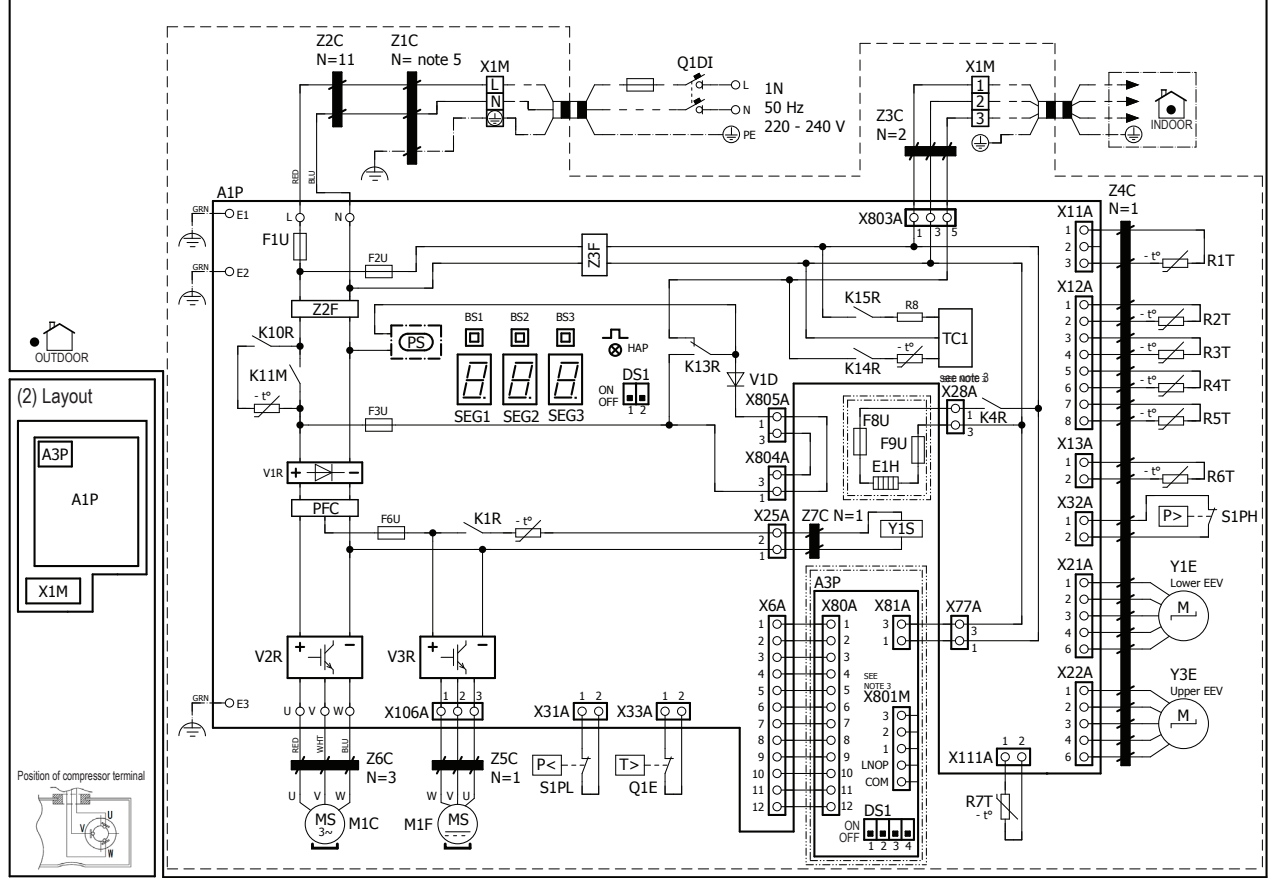

(3) NOTES

- : Connection
- : Earth wiring
- : Field supply
- : Option
- : switch box
- : PCB
- : Wiring depending on model
- : Protective earth
- : Field wire

(4) LEGEND

Part n°	Description
A1P	Printed circuit board (main)
A3P	* Printed circuit board (demand)
BS1-3 (A1P)	Push-button switch
DS1 (A1-2P)	Dipswitch
E1-3 (A1P)	Connector
E1H	* Bottom plate heater
F1U (A1P)	Fuse T 31,5 A 250 V
F2U (A1P)	Fuse T 6,3 A 250 V
F3U (A1P)	Fuse T 6,3 A 250 V
F6U (A1P)	Fuse T 5 A 250V
F8-9U	* Fuse F 1 A 250 V
HAP (A1P)	Light-emitting diode (service monitor is green)
K1R (A1P)	Magnetic relay (Y1S)
K4R (A1P)	Magnetic relay (E1H)
K13-15R, K10R (A1P)	Magnetic relay
K11M (A1P)	Magnetic contactor
L (A1P)	Connector
M1C	Compressor motor
M1F	Fan motor
N (A1P)	Connector
PFC (A1P)	Power factor correction
PS (A1P)	Switching power supply

Part n°	Description
Q1DI	Earth leakage circuit breaker (30mA)
Q1E	Overload protection
R1T	Thermistor (air)
R2T	Thermistor (discharge)
R3T	Thermistor (suction)
R4T	Thermistor (heat exchanger)
R5T	Thermistor (heat exchanger middle)
R6T	Thermistor (liquid)
R7T	Thermistor (fin)
R8 (A1P)	Resistor
S1PH	High pressure switch
S1PL	Low pressure switch
SEG1-3 (A1P)	7-segment display
TC1 (A1P)	Signal transceiver circuit
U, V, W (A1P)	Connector
V1D (A1P)	Diode
V*R (A1P)	Diode module
X*A (A1P)	Connector
X1M	Terminal strip
Y1E, Y3E	Electronic expansion valve
Y1S	Solenoid valve (4-way valve)
Z*C	Noise filter (ferrite core)
Z*F (A1P)	Noise filter

* : optional
: field supply

NOTES


- Refer to the wiring diagram sticker (on the back of the front plate) for how to use the BS1-BS3 and DS1 switches.
- When operating, do not short-circuit protection device(s) S1PH, S1PL and Q1E.
- Refer to the combination table and the option manual for how to connect the wiring to X28A and X801M.
- Colours: BLK:black; RED:red; BLU:blue; WHT:white; GRN:green
- Windings: L-N: 2 - Earth: 1

4D120909

10 Wiring diagrams

10 - 1 Wiring Diagrams - Single Phase

RZAG125-140NV1

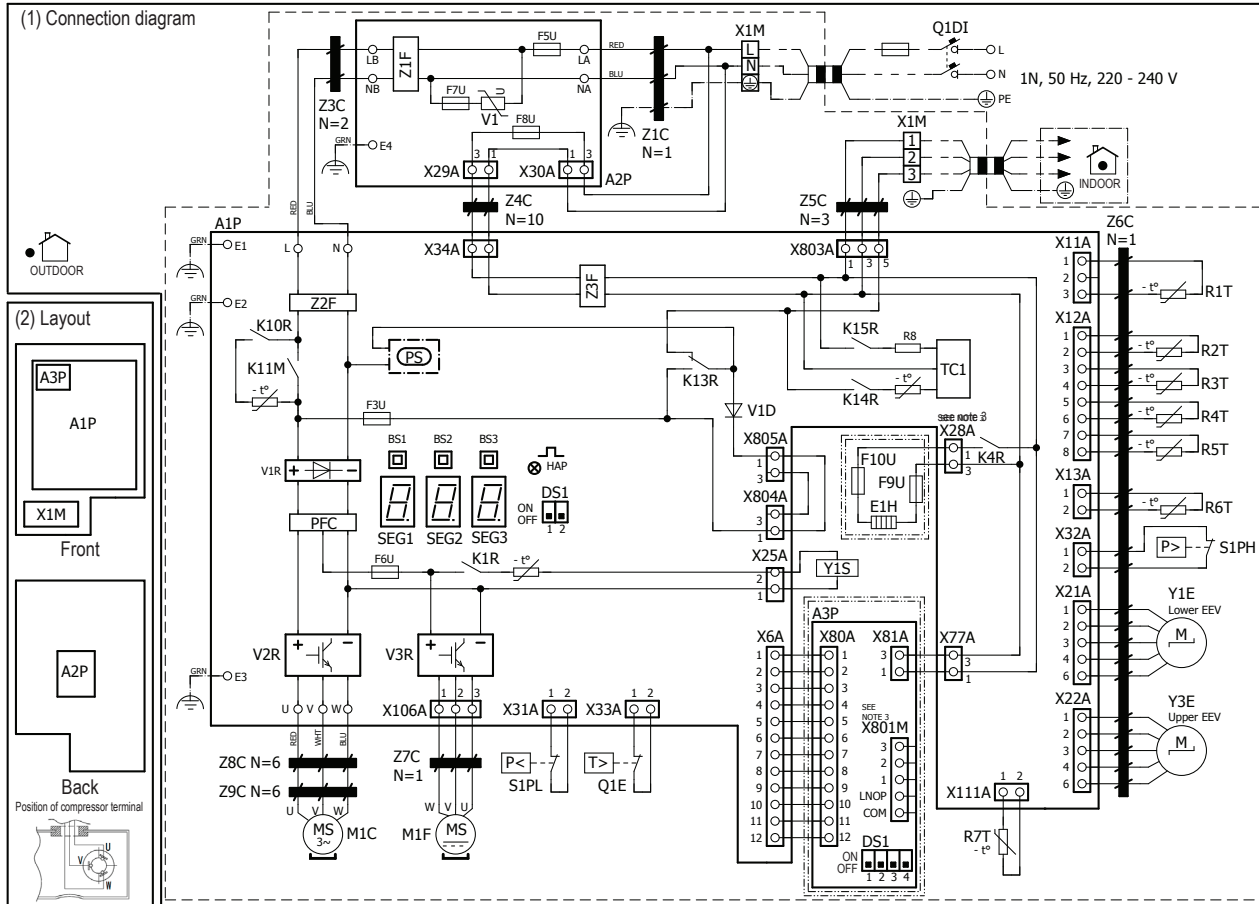

- (3) NOTES**
- ⬤ : Connection
 - X1M : Main terminal
 - : Earth wiring
 - : Field supply
 - ⊕ : Protective earth
 - ⊞ : Option
 - ⎓ : switch box
 - ▭ : PCB
 - ⋯ : Wiring depending on model
 - ⊕ : Protective earth
 - ⊞ : Field wire

(4) LEGEND

Part n°	Description
A1P	Printed circuit board (main)
A2P	Printed circuit board (noise filter)
A3P	* Printed circuit board (demand)
BS1-3 (A1P)	Push-button switch
DS1(A1P,A3P)	Dipswitch
E1-3 (A1~2P)	Connector
E1H	* Bottom plate heater
F3U (A1P)	Fuse T 6.3 A 250 V
F5U (A2P)	Fuse T 56 A 250V
F6U (A1P)	Fuse T 5 A 250V
F7U (A2P)	Fuse T 6.3 A 250 V
F8U (A2P)	Fuse T 6.3 A 250 V
F9-10U	Fuse F 1 A 250 V
HAP (A1P)	Light-emitting diode (service monitor is green)
K1R (A1P)	Magnetic relay (Y1S)
K4R (A1P)	Magnetic relay (E1H)
K13-15R, K10R (A1P)	Magnetic relay
K11M (A1P)	Magnetic contactor
L* (A1-2P)	Connector
M1C	Compressor motor
M1F	Fan motor
PFC (A1P)	Power factor correction

Part n°	Description
PS (A1P)	Switching power supply
Q1DI	Earth leakage circuit breaker (30mA)
Q1E	Overload protection
R1T	Thermistor (air)
R2T	Thermistor (discharge)
R3T	Thermistor (suction)
R4T	Thermistor (heat exchanger)
R5T	Thermistor (heat exchanger middle)
R6T	Thermistor (liquid)
R7T	Thermistor (fin)
R8 (A1P)	Resistor
S1PH	High pressure switch
S1PL	Low pressure switch
SEG1-3 (A1P)	7-segment display
TC1 (A1P)	Signal transceiver circuit
U, V, W (A1P)	Connector
V1 (A2P)	Varistor
V1D (A1P)	Diode
V*R (A1P)	Diode module
X*A (A1-2P)	Connector
X1M	Terminal strip
Y1E, Y3E	Electronic expansion valve
Y1S	Solenoid valve (4-way valve)
Z*C	Noise filter (ferrite core)
Z*F (A1-2P)	Noise filter

* : optional
: field supply

- NOTES**
- Refer to the wiring diagram sticker (on the back of the front plate) for how to use the BS1-BS3 and DS1 switches.
 - When operating, do not short-circuit protection device(s) S1PH, S1PL and Q1E.
 - Refer to the combination table and the option manual for how to connect the wiring to X28A and X801M.
 - Colours: BLK:black; RED:red; BLU:blue; WHT:white; GRN:green


4D120910

11 Sound data

11 - 1 Sound Power Spectrum

11

RZAG71NV1
RZAG71NY1

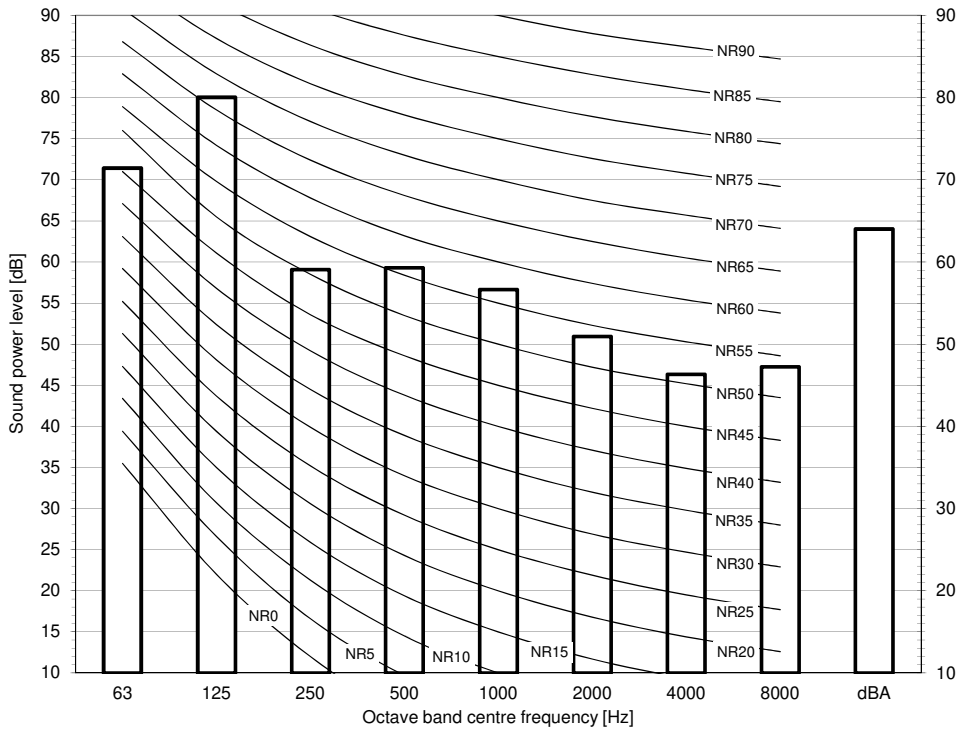


Notes

- dBA = A-weighted sound power level (A scale according to IEC).
- Reference acoustic intensity $O_{dB} = 10E-6 \mu W/m^2$.
- Measured according to ISO 3744

3D125149

RZAG100NV1
RZAG100NY1

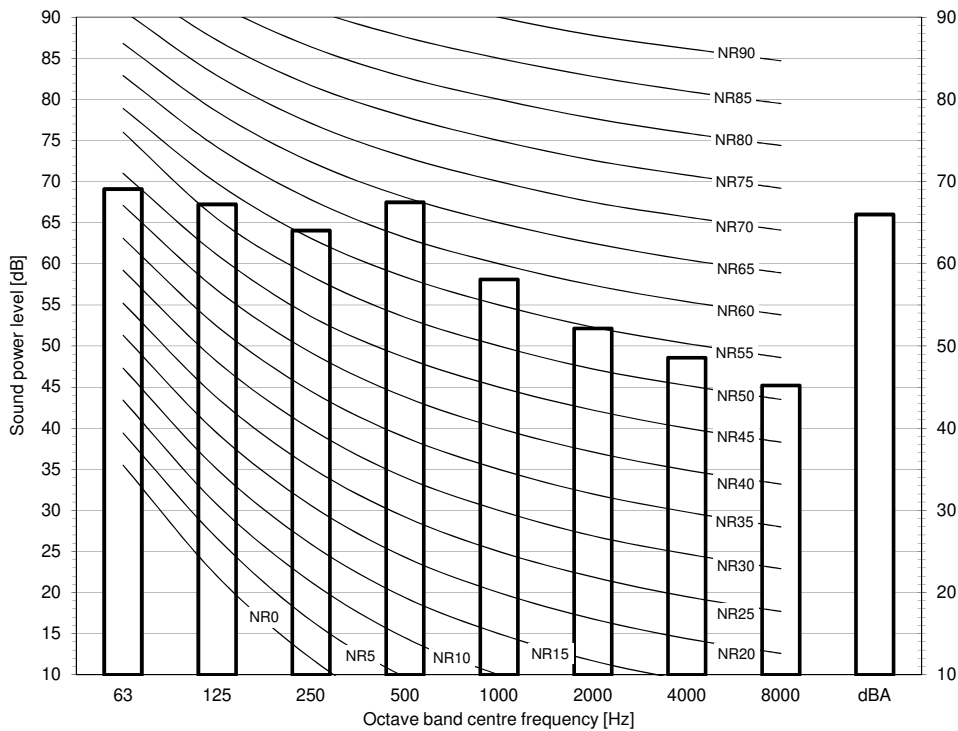

Notes


- dBA = A-weighted sound power level (A scale according to IEC).
- Reference acoustic intensity $O_{dB} = 10E-6 \mu W/m^2$.
- Measured according to ISO 3744

3D125155

11 Sound data

11 - 1 Sound Power Spectrum

RZAG125NV1
RZAG125NY1

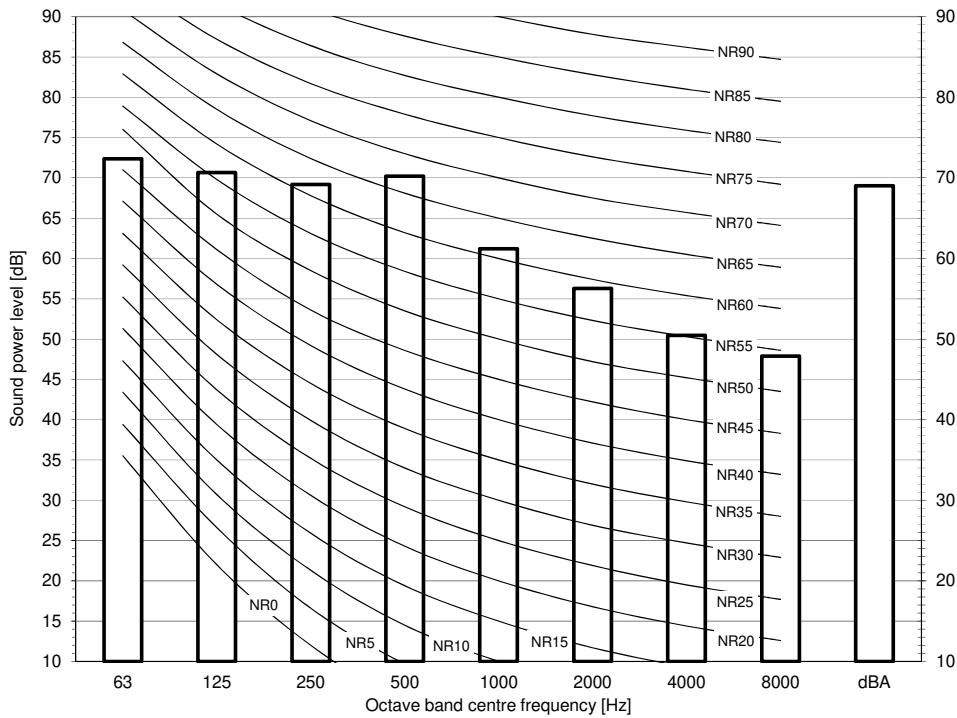


Notes

- dBA = A-weighted sound power level (A scale according to IEC).
- Reference acoustic intensity 0dB = $\cdot 10E-6\mu W/m^2$.
- Measured according to ISO 3744

3D125161

RZAG140NV1
RZAG140NY1

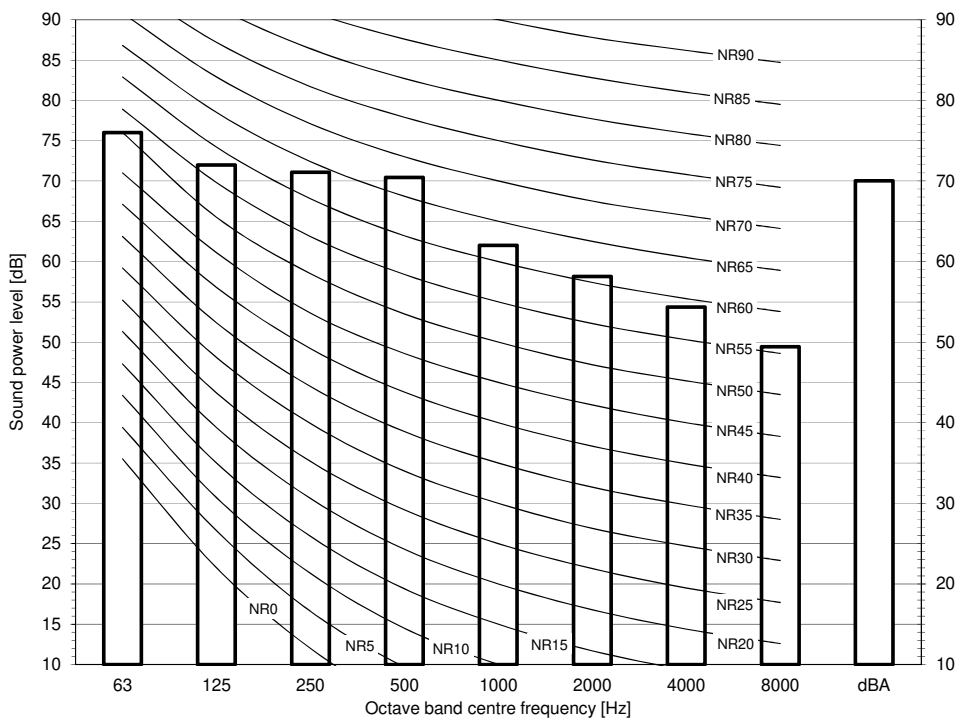

Notes

- dBA = A-weighted sound power level (A scale according to IEC).
- Reference acoustic intensity 0dB = $\cdot 10E-6\mu W/m^2$.
- Measured according to ISO 3744


3D125167

11 Sound data

11 - 2 Sound Pressure Spectrum - Cooling

RZAG71NV1

RZAG71NY1

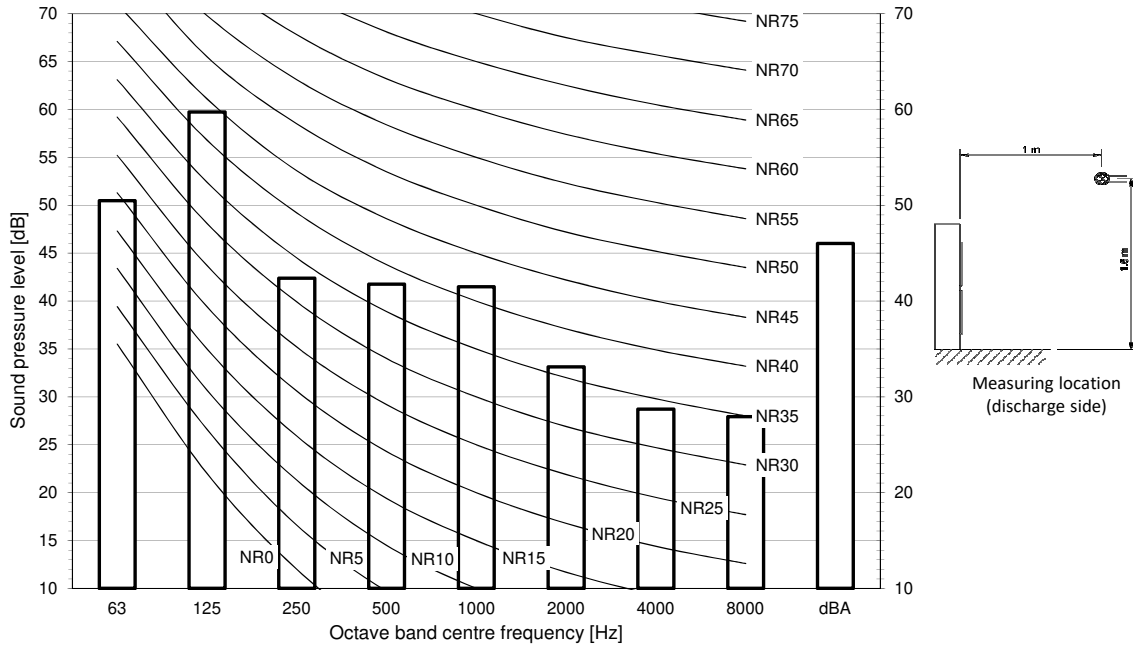


Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 μPa

3D125147

RZAG100NV1

RZAG100NY1

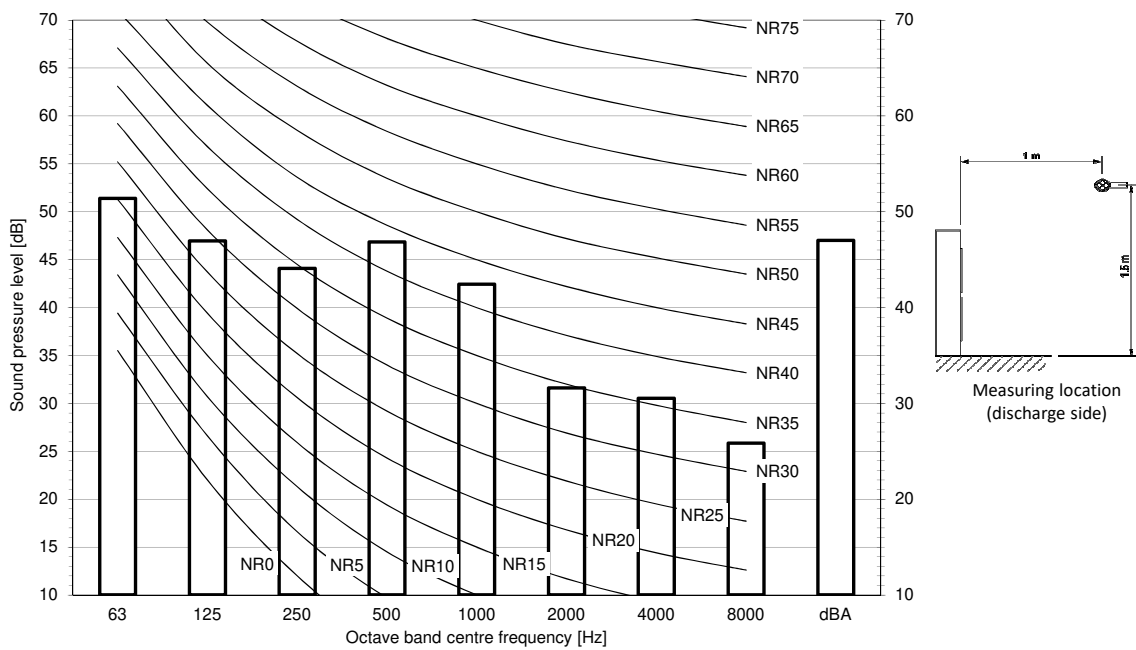

Notes


- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 μPa

3D125153

11 Sound data

11 - 2 Sound Pressure Spectrum - Cooling

RZAG125NV1
RZAG125NY1

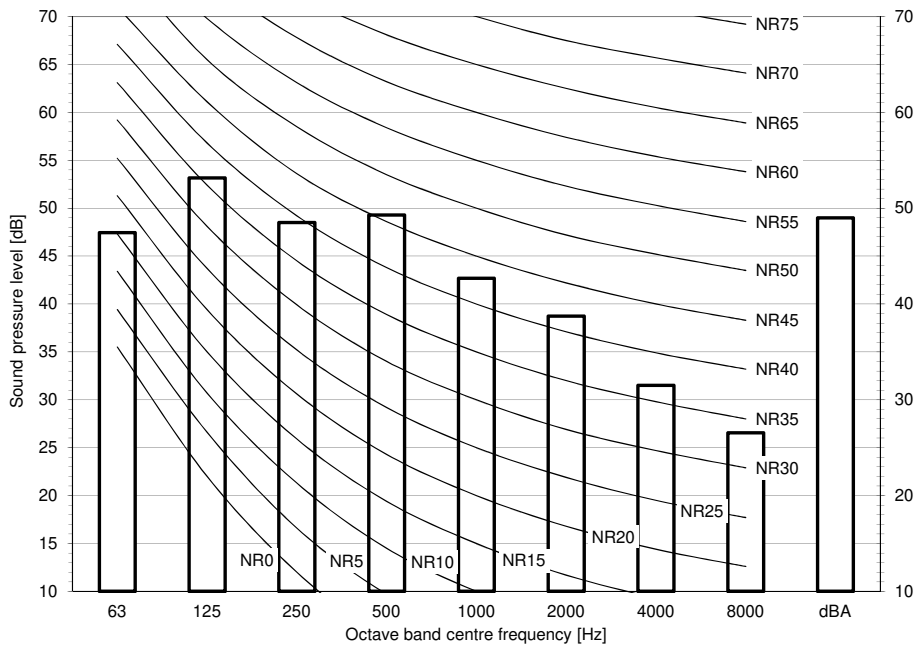


Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 μPa

3D125159

RZAG140NV1
RZAG140NY1

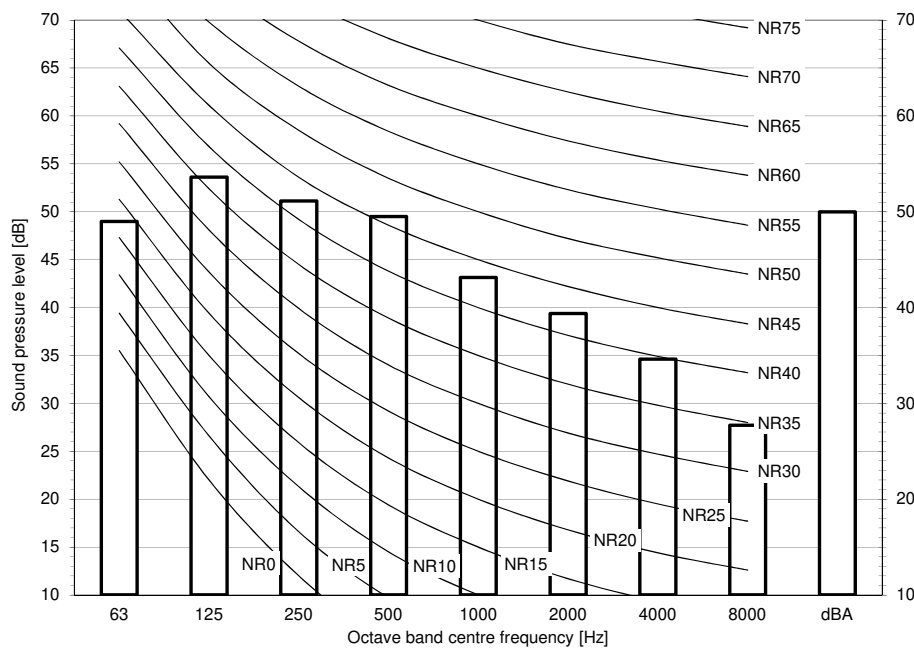

Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 μPa


3D125165

11 Sound data

11 - 3 Sound Pressure Spectrum - Heating

11

RZAG71NV1
RZAG71NY1

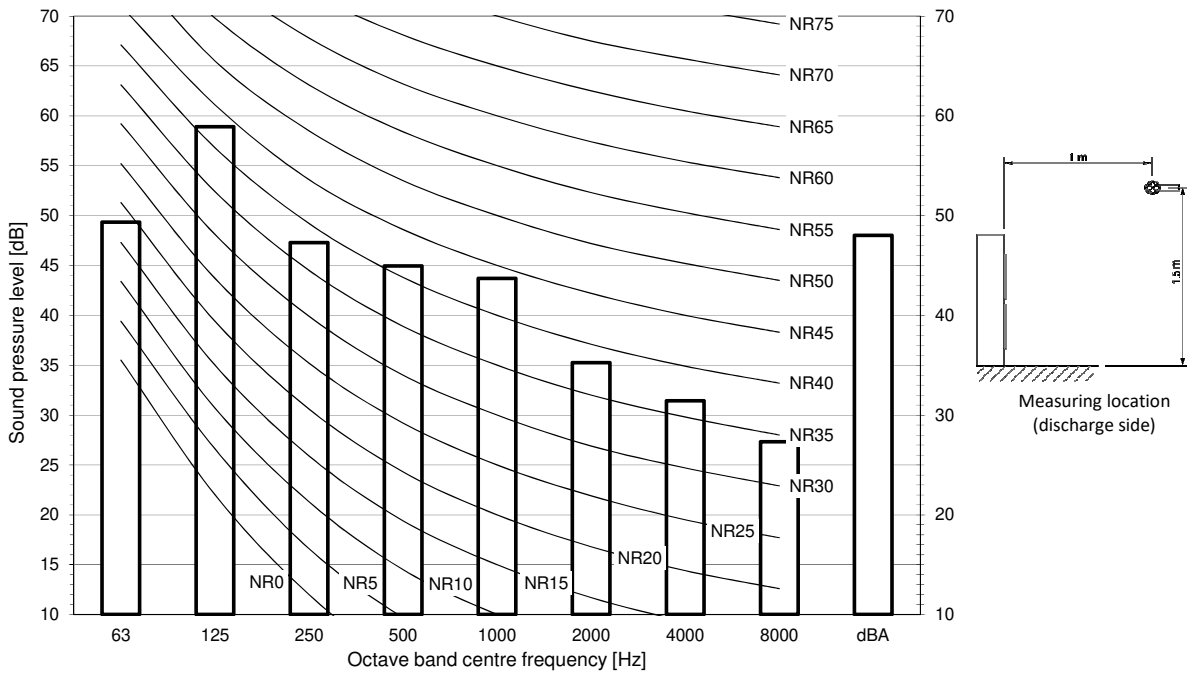


Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 μPa

3D125148

RZAG100NV1
RZAG100NY1

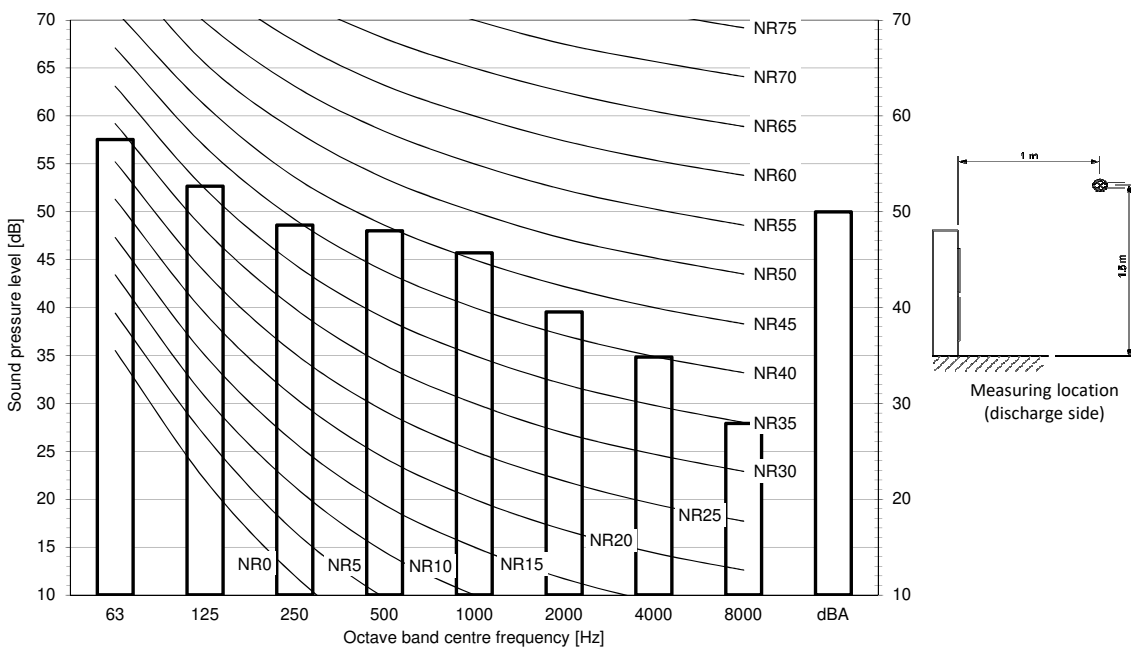



Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 μPa

3D125154

11 Sound data



11 - 3 Sound Pressure Spectrum - Heating

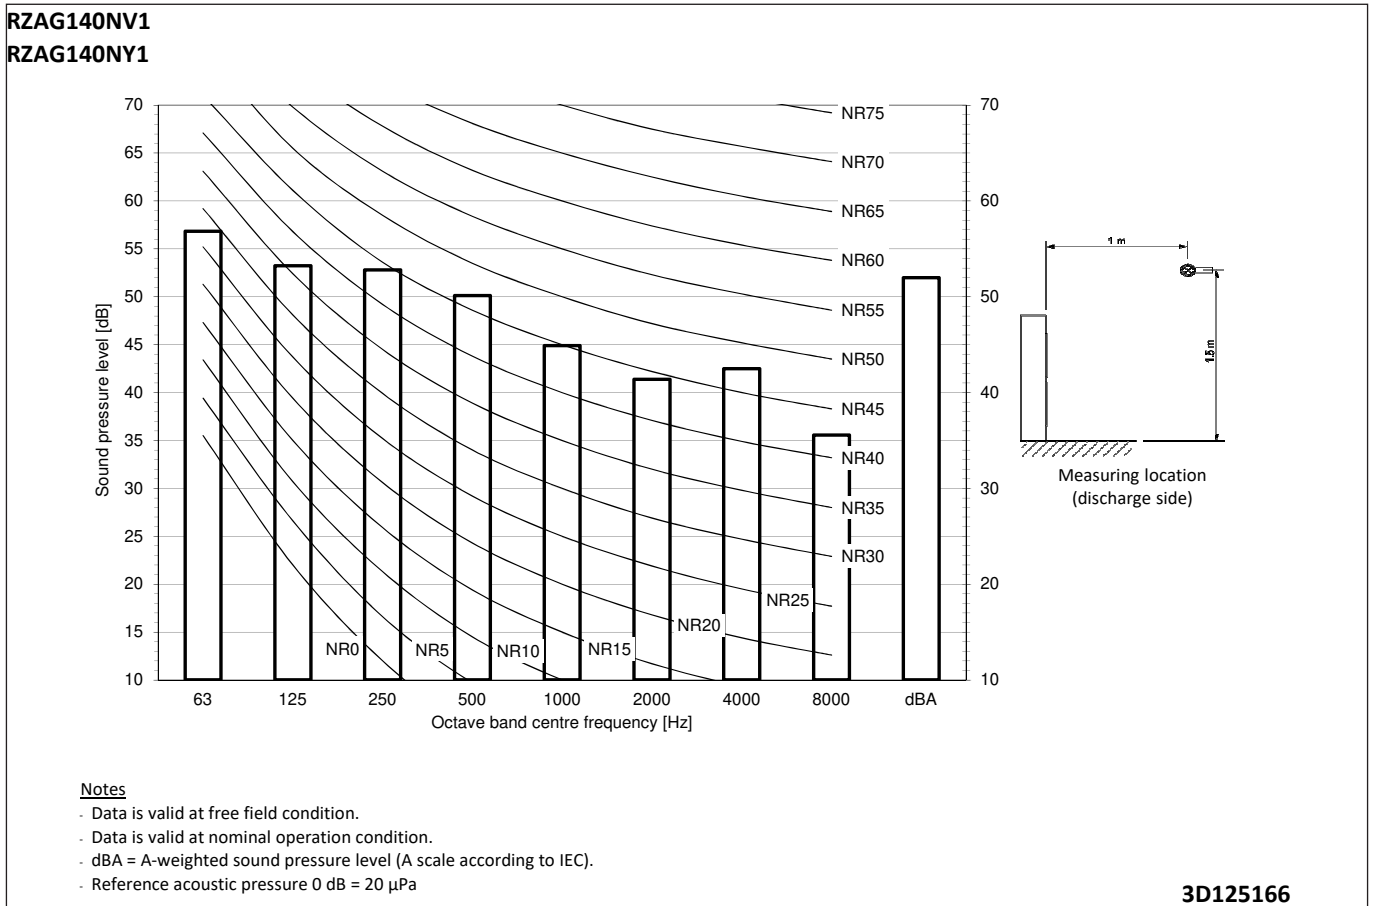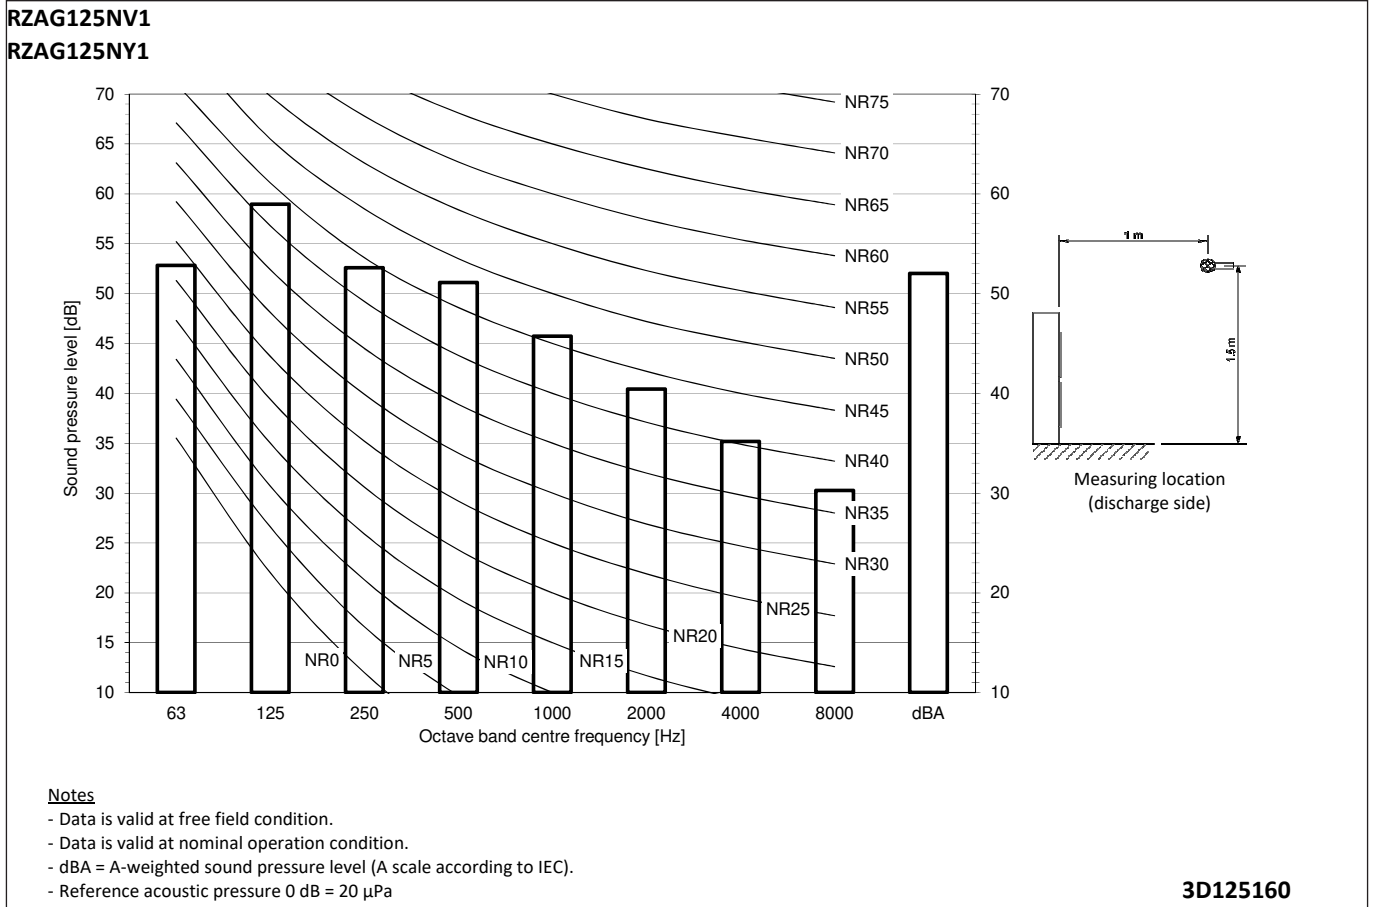

11 Sound data



11 - 4 Sound Pressure Spectrum Quiet Mode Level 1

11

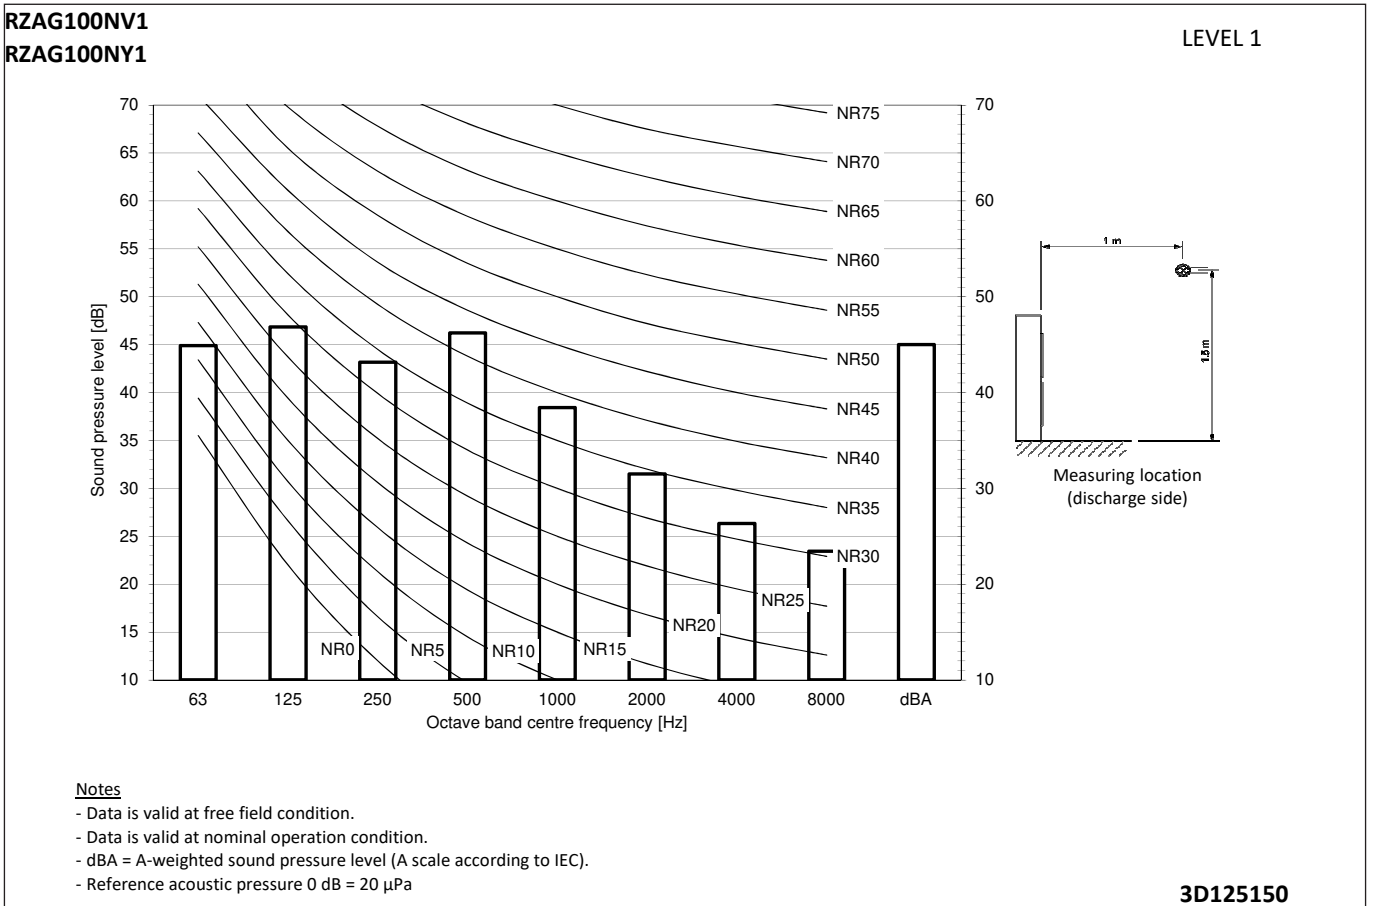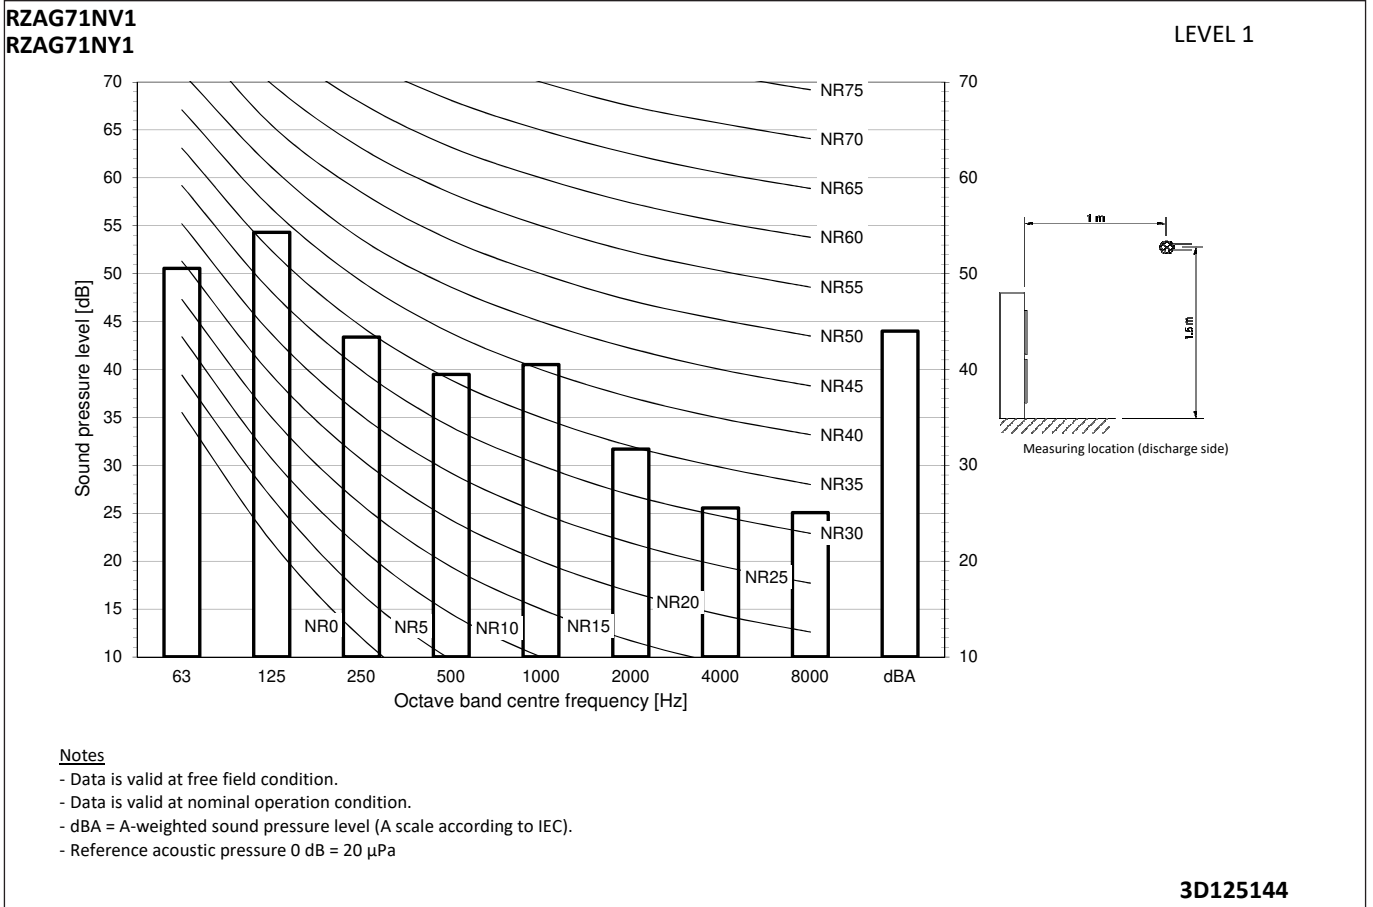

11 Sound data



11 - 4 Sound Pressure Spectrum Quiet Mode Level 1

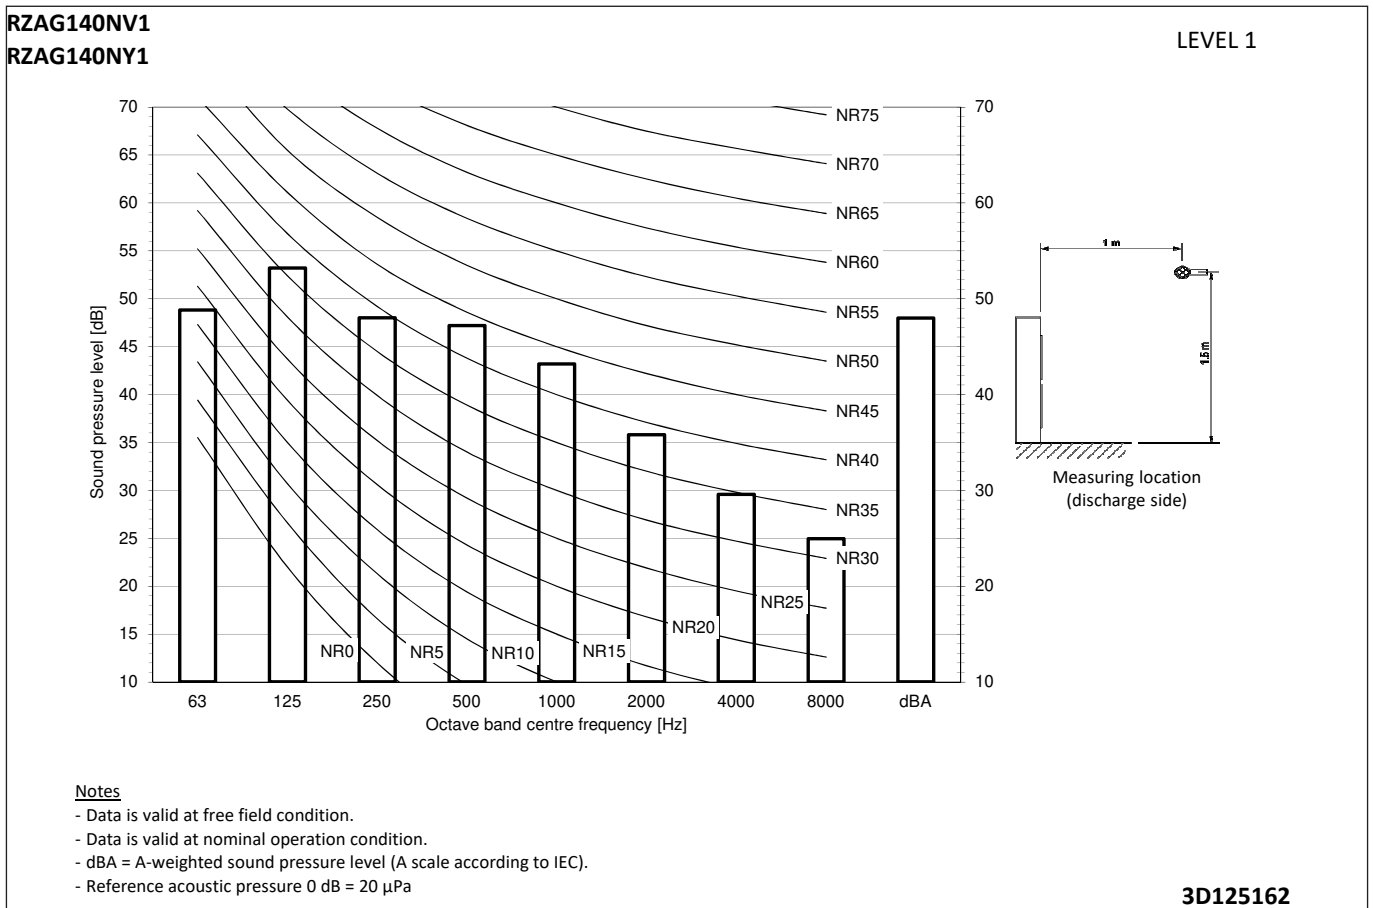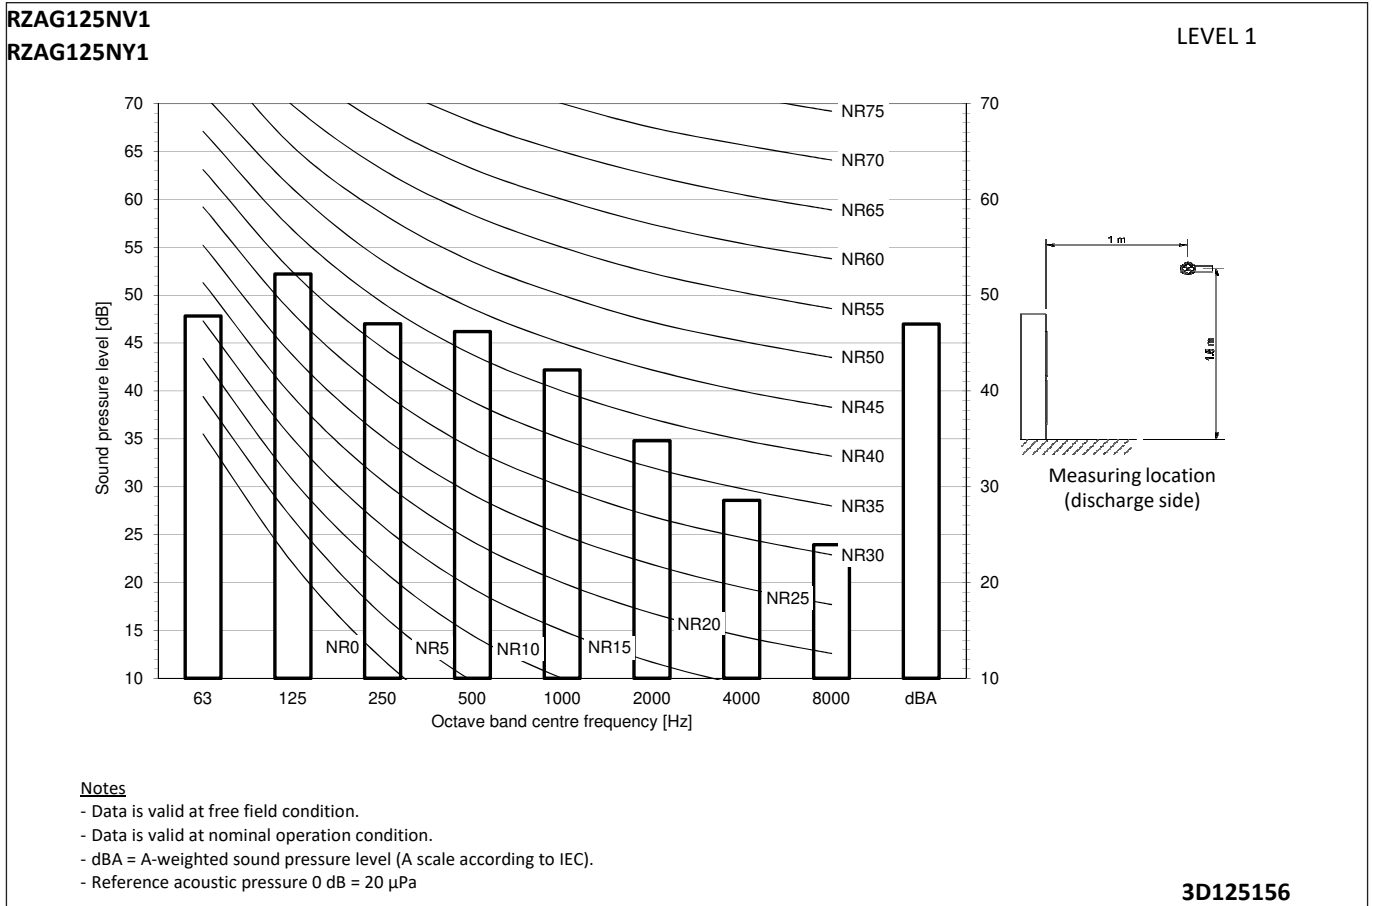

11 Sound data



11 - 5 Sound Pressure Spectrum Quiet Mode Level 2

11

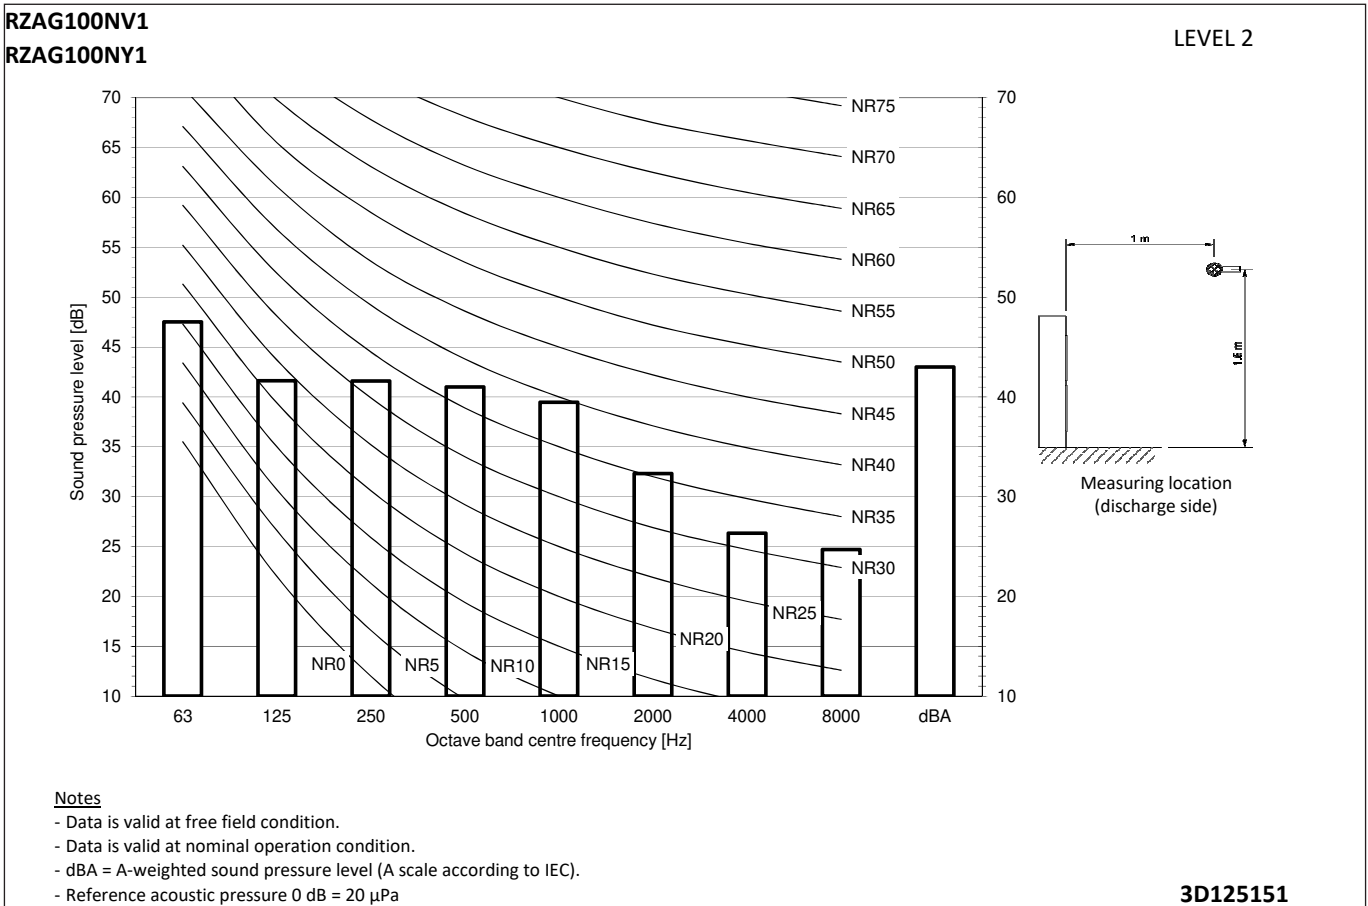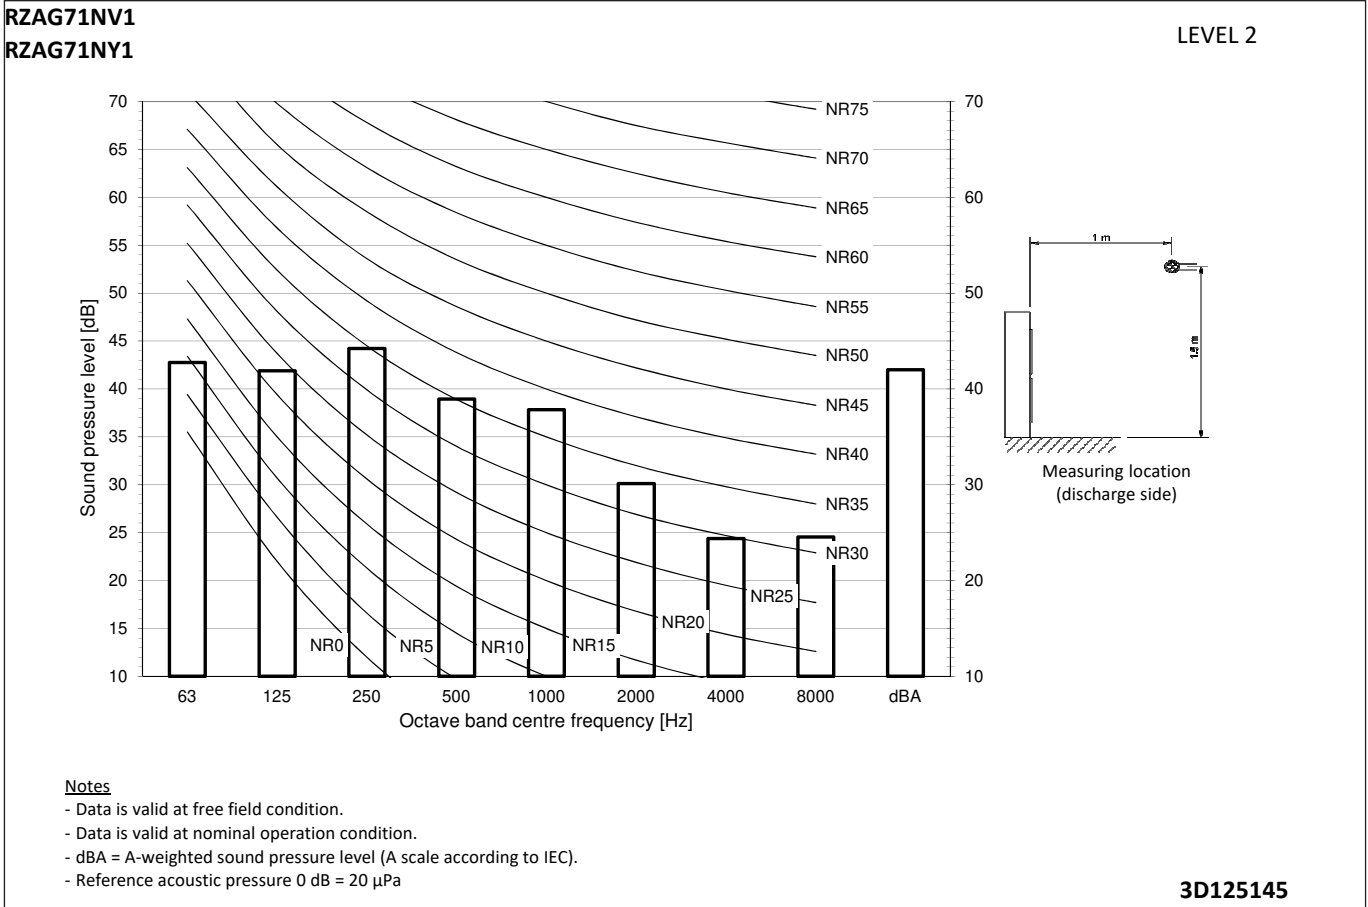

11 Sound data



11 - 5 Sound Pressure Spectrum Quiet Mode Level 2

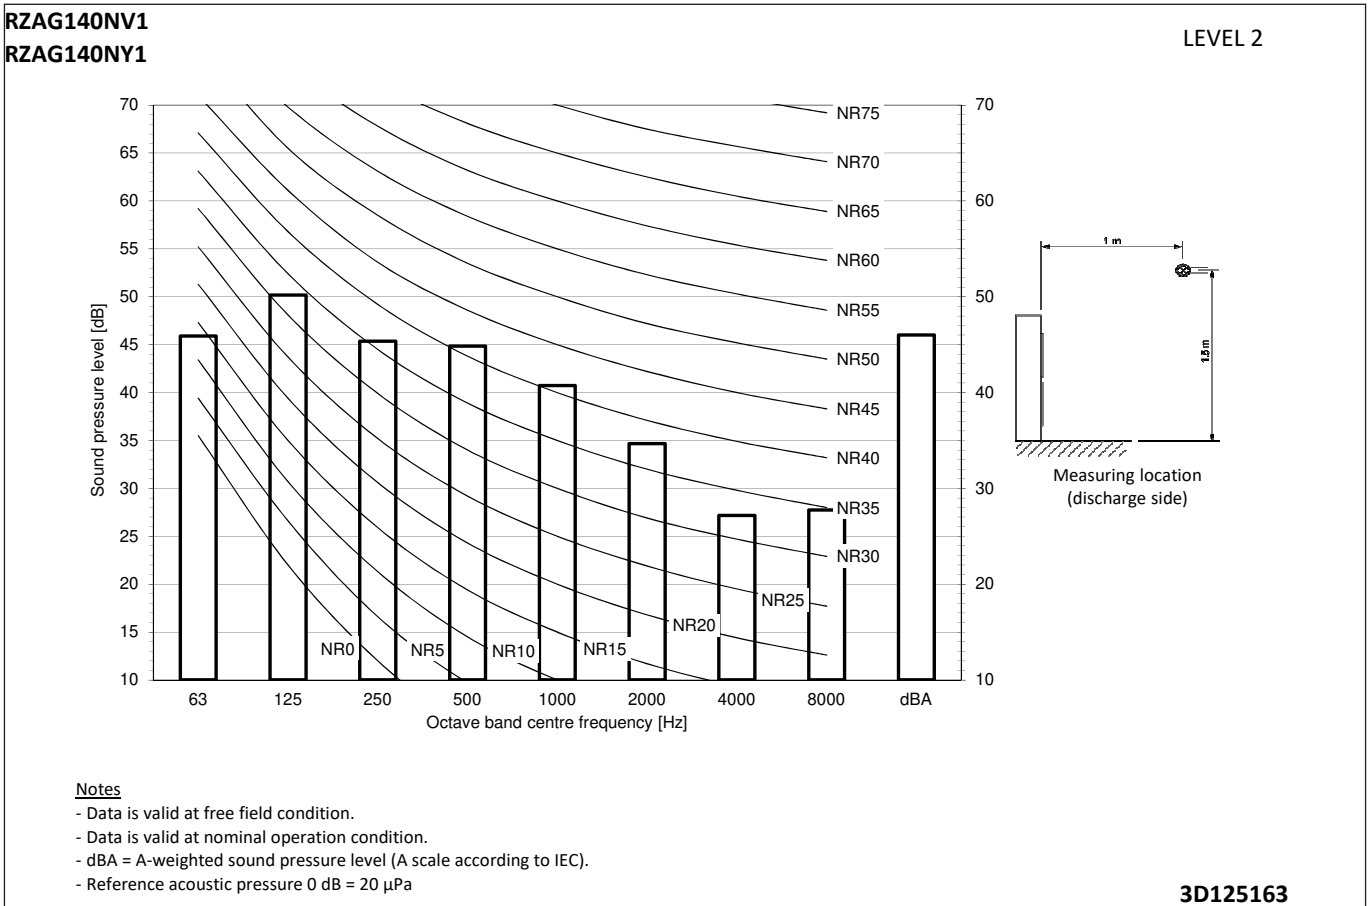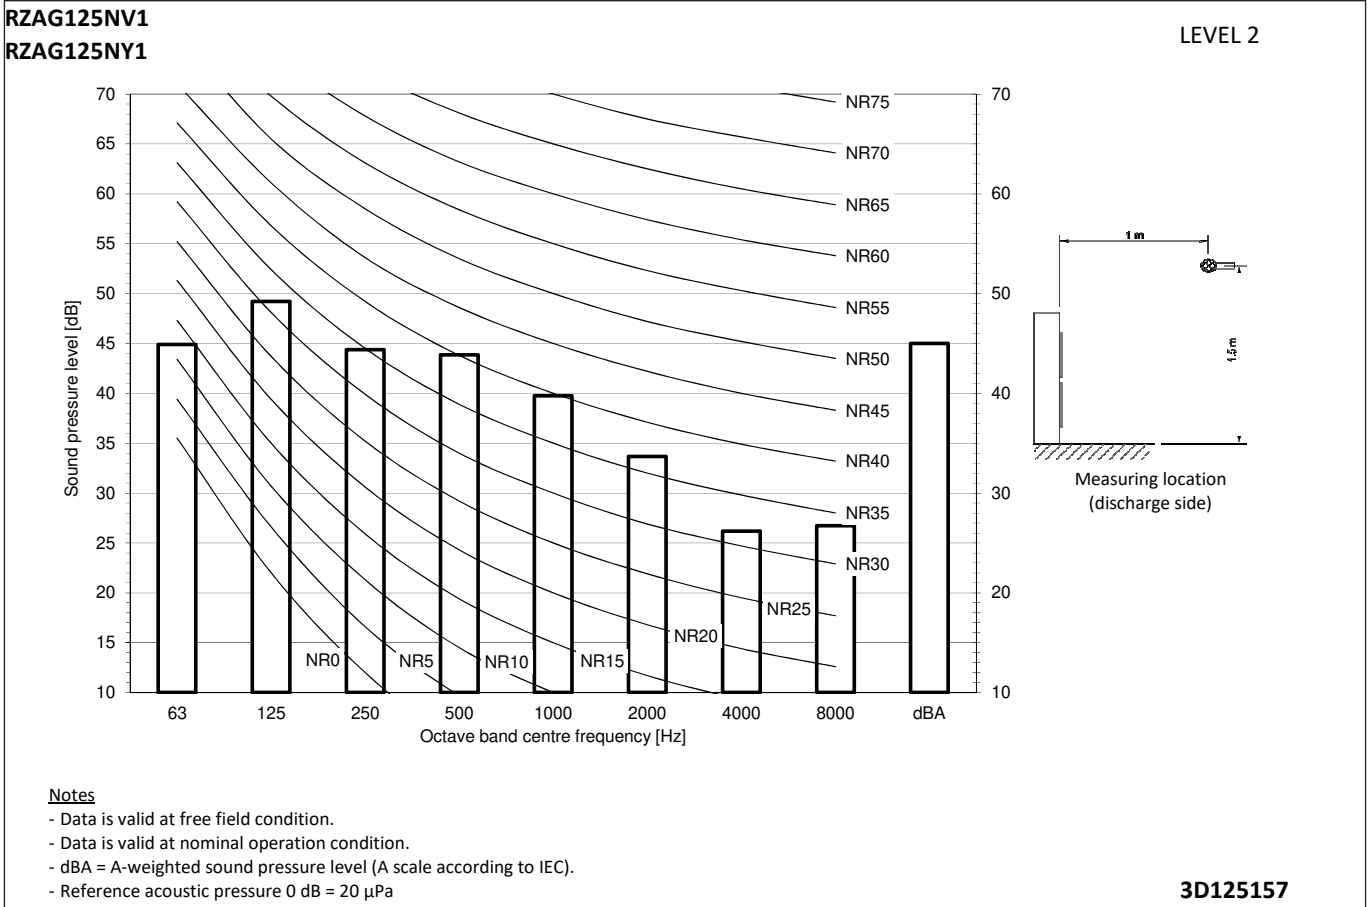

11 Sound data



11 - 6 Sound Pressure Spectrum Quiet Mode Level 3

11

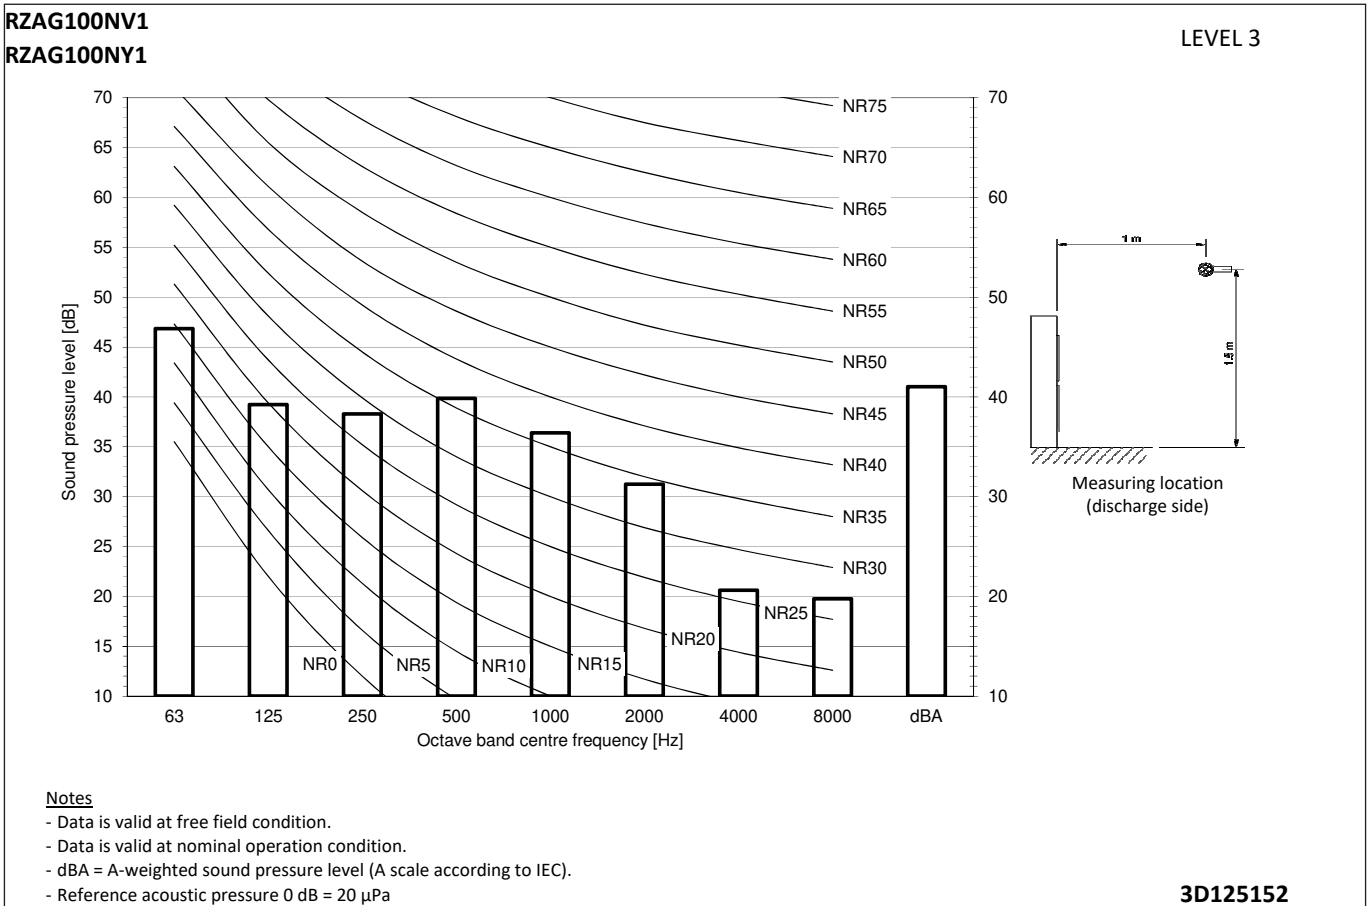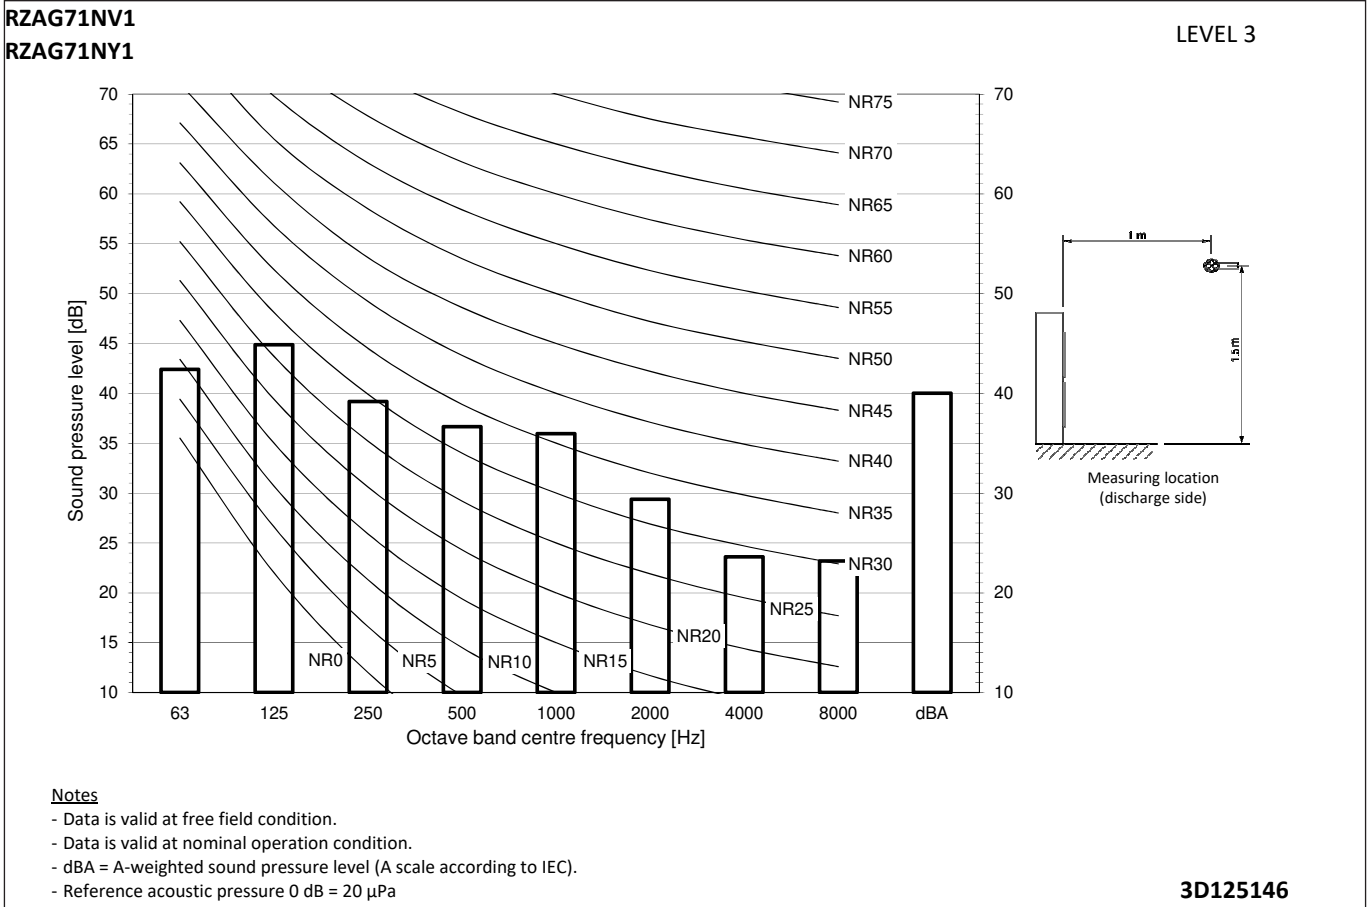

11 Sound data

11 - 6 Sound Pressure Spectrum Quiet Mode Level 3

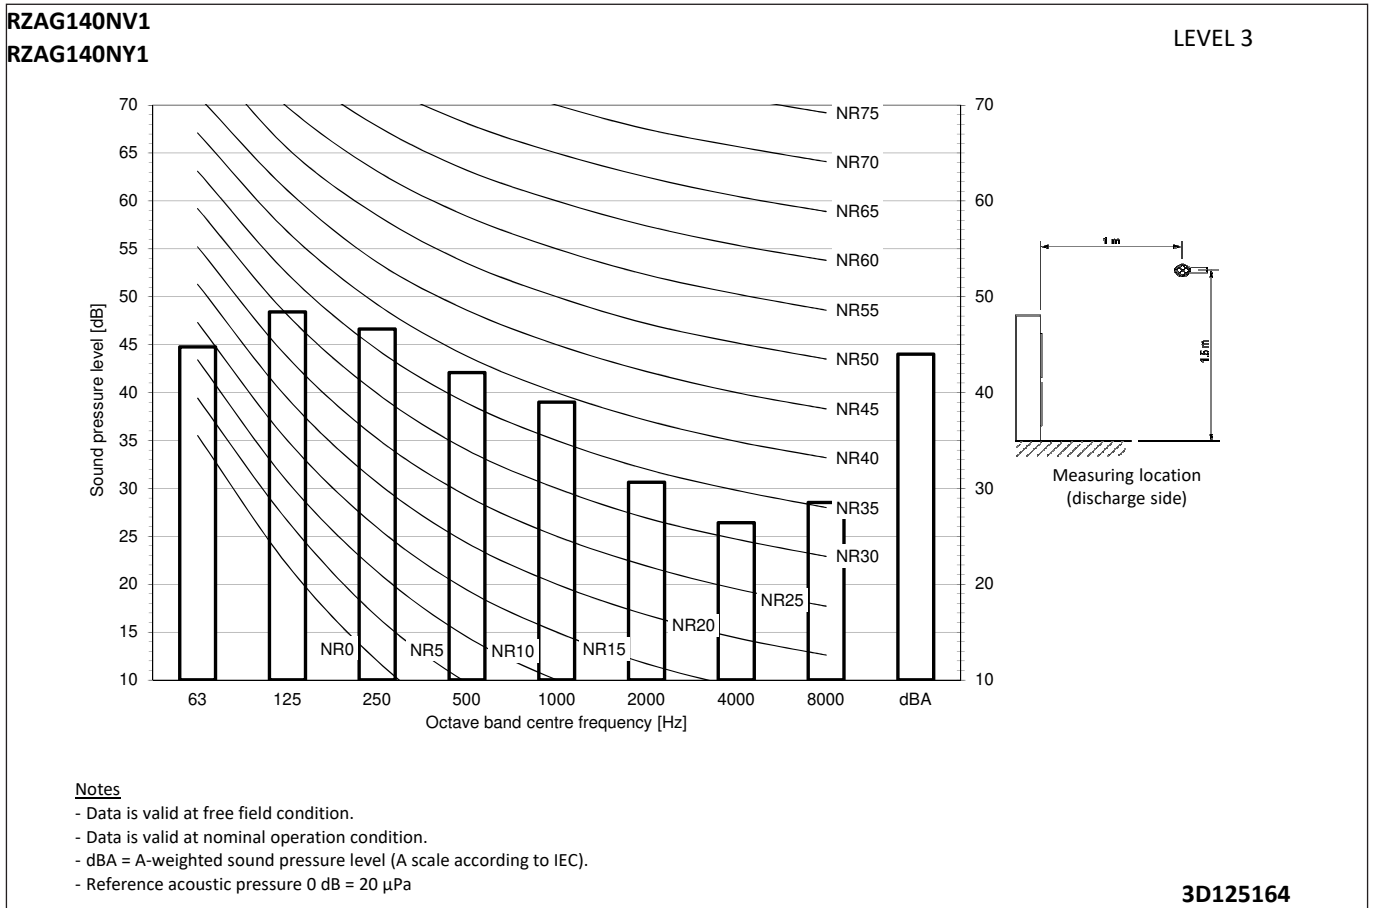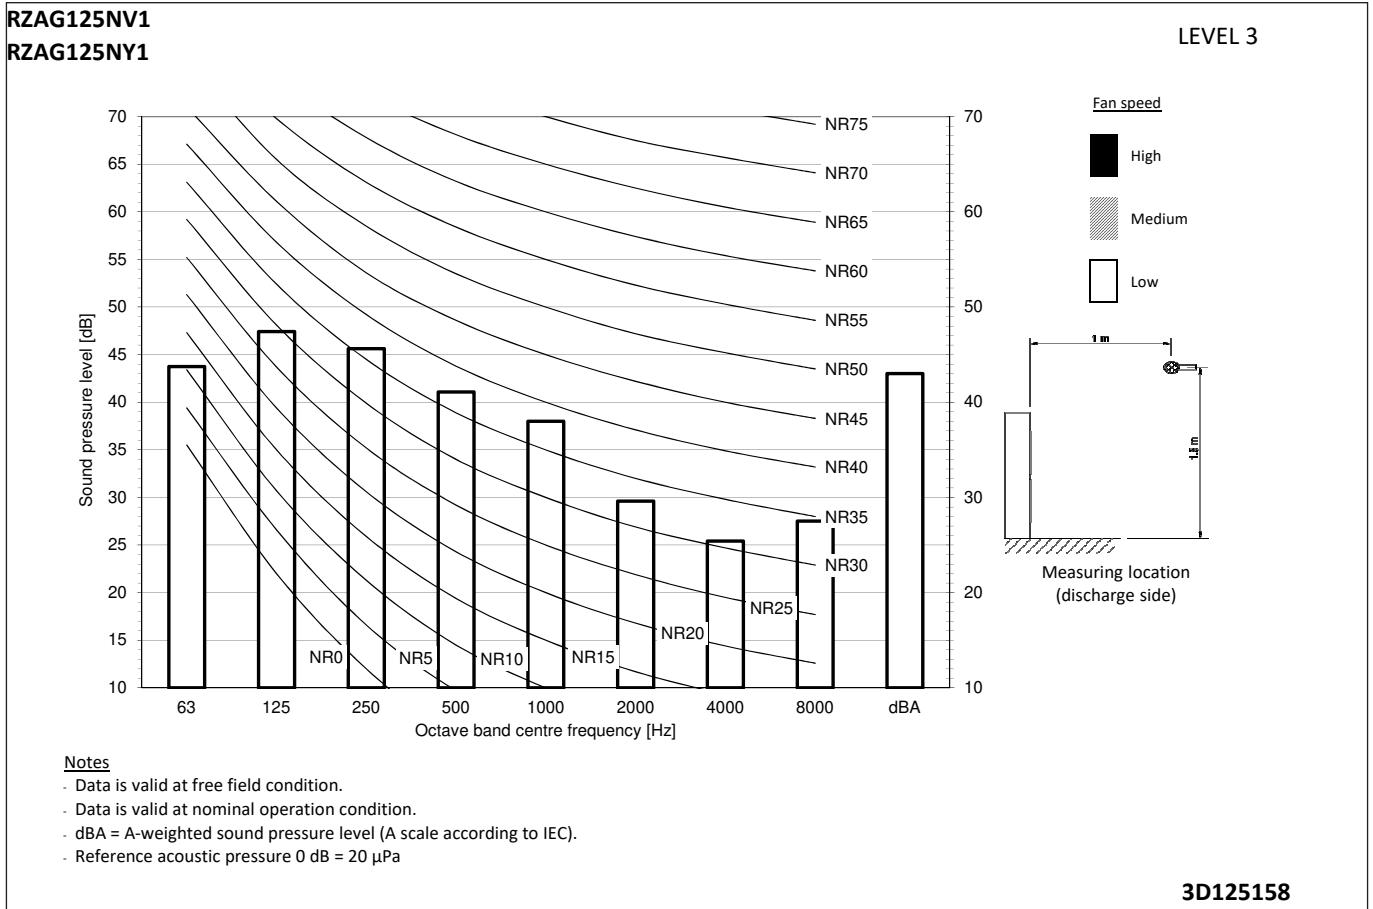

12 Installation

12 - 1 Installation Method

12

RZAG-NV1
RZAG-NY1

Single unit (■) | Single row of units (■ ■ ■)

Suction side

In the illustration below, the service space at the suction side is based on 35°C DB and cooling operation. Foresee more space in the following cases:

- When the suction side temperature regularly exceeds this temperature.
- When the heat load of the outdoor units is expected to regularly exceed the maximum operating capacity.

Discharge side

Take refrigerant piping work into account when positioning the units. If your lay out does not match with any of the layouts below, contact your dealer.

Single unit (■) | Single row of units (■ ■ ■)

	A-E	Hb Hd Hu	(mm)								
			a	b	c	d	e	e _B	e _D		
	B	-		≥ 100							
	A,B,C	-	≥ 100(1)	≥ 100	≥ 100						
	B,E	-		≥ 100			≥ 1000		≤ 500		
	A,B,C,E	-	≥ 150(1)	≥ 150	≥ 150		≥ 1000		≤ 500		
	D	-					≥ 500				
	D,E	-					≥ 500	≥ 1000	≤ 500		
	B,D	Hd > Hu		≥ 100		≥ 500					
			Hd ≤ Hu	≥ 100		≥ 500					
	B,D,E	Hd > Hu	Hb ≤ ½Hu	≥ 250		≥ 750	≥ 1000	≤ 500			1
			½Hu > Hb ≤ Hu	≥ 250		≥ 1000	≥ 1000	≤ 500			
Hb > Hu		⊘									
Hd ≤ Hu		Hd ≤ ½Hu	≥ 100		≥ 1000	≥ 1000	≤ 500				
	½Hu < Hd ≤ Hu	≥ 200		≥ 1000	≥ 1000	≤ 500					
Hd > Hu		⊘									
	A,B,C	-	≥ 200(1)	≥ 300	≥ 1000						
	A,B,C,E	-	≥ 200(1)	≥ 300	≥ 1000		≥ 1000		≤ 500		
	D	-				≥ 1000					
	D,E	-				≥ 1000	≥ 1000	≤ 500			
	B,D	Hd > Hu		≥ 300		≥ 1000					1+2
			Hd ≤ Hu								
			Hd ≤ ½Hu	≥ 250		≥ 1500					
	B,D,E	Hd > Hu	Hb ≤ ½Hu	≥ 300		≥ 1000	≥ 1000	≤ 500			
			½Hu < Hb ≤ Hu	≥ 300		≥ 1250	≥ 1000	≤ 500			
		Hb > Hu		⊘							
Hd ≤ Hu		Hd ≤ ½Hu	≥ 250		≥ 1500	≥ 1000	≤ 500				
	½Hu < Hd ≤ Hu	≥ 300		≥ 1500	≥ 1000	≤ 500					
Hd > Hu		⊘									

(1) For better serviceability, use a distance ≥ 250 mm

A,B,C,D Obstacles (walls/baffle plates)

E Obstacle (roof)

a,b,c,d,e Minimum service space between the unit and obstacles A, B, C, D and E

e_B Maximum distance between the unit and the edge of obstacle E, in the direction of obstacle B

e_D Maximum distance between the unit and the edge of obstacle E, in the direction of obstacle D

Hu Height of the unit

Hb,Hd Height of obstacles B and D

1 Seal the bottom of the installation frame to prevent discharged air from flowing back to the suction side through the bottom of the unit.

2 Maximum two units can be installed.


⊘ Not allowed


1D128513


12 Installation

12 - 1 Installation Method

RZAG-NV1
RZAG-NY1

Multiple rows of units ()

Multiple rows of units ()

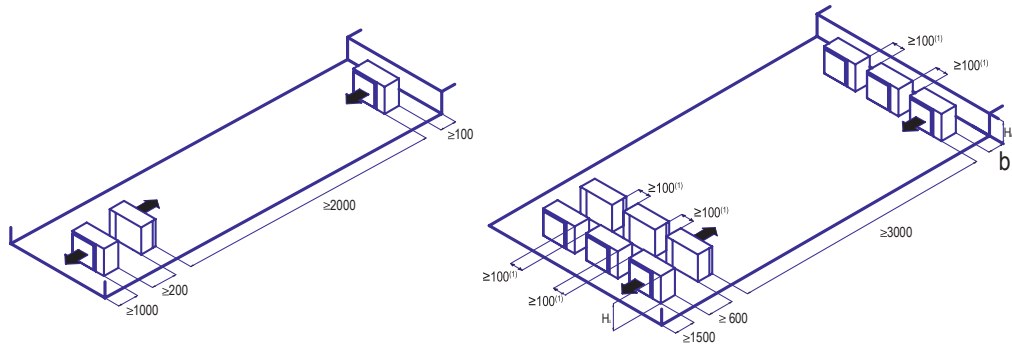

Hb Hu	b (mm)
$Hb \leq \frac{1}{2}Hu$	$b \geq 250$
$\frac{1}{2}Hu < Hb \leq Hu$	$b \geq 300$
$Hb > Hu$	⊘

- (1) For better serviceability, use a distance ≥ 250 mm
- ⊘ Not allowed

1D128513


12 Installation





12 - 1 Installation Method

12

RZAG-NV1
RZAG-NY1

Stacked units (max.2 levels) 

Stacked units (max.2 levels) 

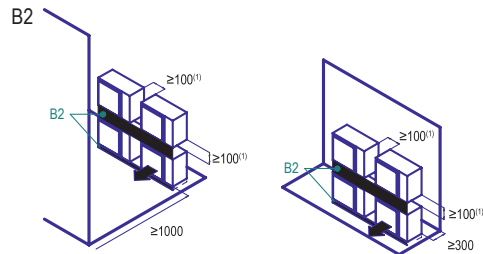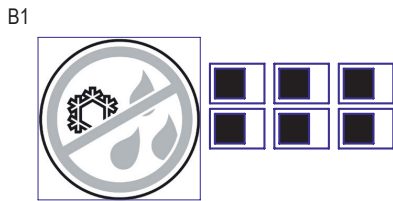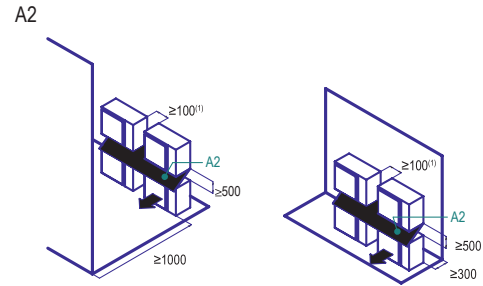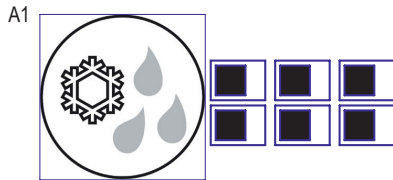


- (1) For better serviceability, use a distance ≥ 250 mm
- A1=>A2 (A1) If there is danger of drainage dripping and freezing between the upper and lower units...
- (A2) Then install a roof between the upper and lower units. Install the upper unit high enough above the lower unit to prevent ice buildup at the upper unit's bottom plate.
- B1=>B2 (B1) If there is no danger of drainage dripping and freezing between the upper and lower units...
- (B2) Then it is not required to install a roof, but seal the gap between the upper and lower units to prevent discharged air from flowing back to the suction side through the bottom of the unit.

1D128513


13 Operation range

13 - 1 Operation Range

RZAG-NV1 RZAG-NY1

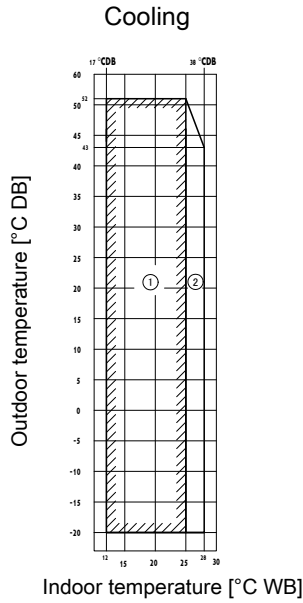

- ① Operation range
- ② Pull-down operation range
- ③ Warm-up operation range

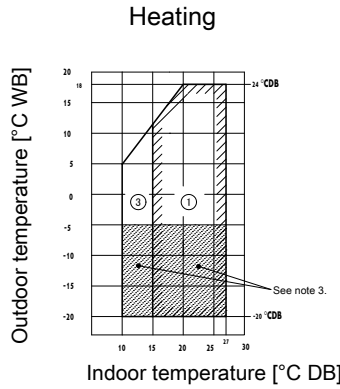


Notes


1. Depending on operation and installation conditions, the indoor unit can change over to freeze-up operation (indoor de-icing).
2. To reduce the freeze-up operation (indoor de-icing) frequency, it is recommended to install the outdoor unit in a location not exposed to wind.
3. If the unit is selected to operate at ambient temperature < -5°C for 5 days or more, with relative humidity of 100%, it is required to install the optional bottom plate heater.

3D110020A

RZAG-NV1 RZAG-NY1

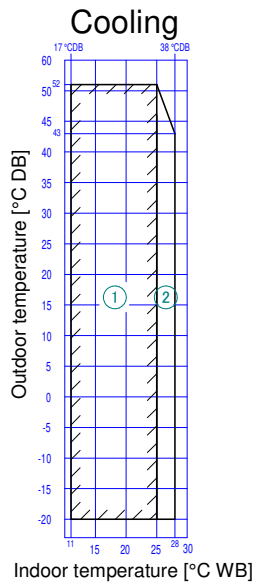

- ① Operation range
- ② Pull-down operation range
- ③ Warm-up operation range

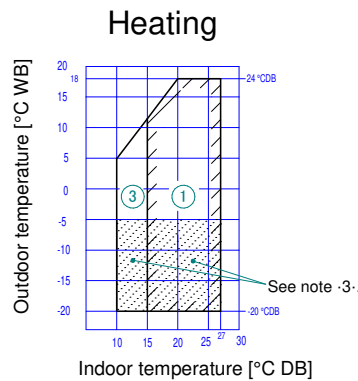

Notes

1. Depending on operation and installation conditions, the indoor unit can change over to freeze-up operation (indoor de-icing).
2. To reduce the freeze-up operation (indoor de-icing) frequency, it is recommended to install the outdoor unit in a location not exposed to wind.
3. If the unit is selected to operate at ambient temperature < -5°C for -5- days or more, with relative humidity of 100%, it is required to install the optional bottom plate heater.

3D110022

14 Appropriate Indoors

14 - 1 Appropriate Indoors

14

RZAG-NV1

RZAG-NY1

ENER Lot 21

Recommended combinations

Sky Air		High Cassette				Thin cassette						2x2 cassette			Duct (medium ESP)				Concealed floor standing type			Ceiling-mounted - 4-way blow			Wall mounted type		Duct (high ESP)					
Model		FCAHG71	FCAHG100	FCAHG125	FCAHG140	FCAG35	FCAG50	FCAG60	FCAG71	FCAG100	FCAG125	FCAG140	FFA35	FFA50	FFA60	FBA35	FBA50	FBA60	FBA71	FBA100	FBA125	FBA140	FNA35	FNA50	FNA60	FUA71	FUA100	FUA125	FAA71	FAA100	FDA125	
RZAG125N2V1B	RZAG125N2Y1B			P		4										4						P										P
RZAG140N2V1B	RZAG140N2Y1B			P		4						P				4						P										

Sky Air		Floor standing type				Slim duct			Ceiling-suspended						Floor standing type	
Model		FVA71	FVA100	FVA125	FVA140	FDXM35	FDXM50	FDXM60	FHA35	FHA50	FHA60	FHA71	FHA100	FHA125	FHA140	AVA125
RZAG125N2V1B	RZAG125N2Y1B			P												P
RZAG140N2V1B	RZAG140N2Y1B			P												P

4D140340

RZAG-NV1

RZAG-NY1

ENER Lot 21

Appropriate indoor units

Connectable to **·RZAG125N2V1B/RZAG125N2Y1B·** and covered by **·ENER Lot 21·**

FCAHG125	FCAG35	FFA35	FBA35	FNA35	FUA125	-	FDA125	FVA125	FDXM35	FHA35	-
-	FCAG50	FFA50	FBA50	FNA50	-	-	-	-	FDXM50	FHA50	-
-	FCAG60	FFA60	FBA60	FNA60	-	-	-	-	FDXM60	FHA60	-
-	FCAG125	-	FBA125	-	-	-	-	-	-	FHA125	-

Connectable to **·RZAG140N2V1B/RZAG140N2Y1B·** and covered by **·ENER Lot 21·**

FCAHG71	FCAG35	FFA35	FBA35	FNA35	FUA71	FAA71	-	FVA71	FDXM35	FHA35	-
FCAHG140	FCAG50	FFA50	FBA50	FNA50	-	-	-	FVA140	FDXM50	FHA50	-
-	FCAG71	-	FBA71	-	-	-	-	-	-	FHA71	-
-	FCAG140	-	FBA140	-	-	-	-	-	-	FHA140	-

4D140340

14 Appropriate Indoors

14 - 1 Appropriate Indoors

RZAG125-140NV1

RZAG125-140NY1

ENER Lot 21

Recommended combinations

Sky Air		High Cassette				Thin cassette						2x2 cassette			Duct (medium ESP)						Concealed floor standing type			Ceiling-mounted - 4-way blow			Wall mounted type		Duct (high ESP)			
Model		FCAHG71	FCAG100	FCAHG125	FCAHG140	FCAG35	FCAG50	FCAG60	FCAG71	FCAG100	FCAG125	FCAG140	FFA35	FFA50	FFA60	FBA35	FBA50	FBA60	FBA71	FBA100	FBA125	FBA140	FNA35	FNA50	FNA60	FUA71	FUA100	FUA125	FAA71	FAA100	FDA125	
RZAG125N7V1B	RZAG125N7Y1B			P		4										4																P
RZAG140N7V1B	RZAG140N7Y1B				P	4										4																P

Sky Air		Floor standing type			Slim duct			Ceiling-suspended						Floor standing type		
Model		FVA71	FVA100	FVA125	FVA140	FDXM35	FDXM50	FDXM60	FHA35	FHA50	FHA60	FHA71	FHA100	FHA125	FHA140	AVA125
RZAG125N7V1B	RZAG125N7Y1B			P											P	
RZAG140N7V1B	RZAG140N7Y1B				P										P	

P= Pair
2= Twin
3= Triple
4= Double twin

3D120939

RZAG-NV1

RZAG-NY1

ENER Lot 21

Appropriate indoor units

Connectable to RZAG125N7V1B / RZAG125N7Y1B and covered by ENER Lot 21

FCAHG125	FCAG35	FFA35	FBA35	FNA35	FUA125	-	FDA125	FVA125	FDXM35	FHA35	-
-	FCAG50	FFA50	FBA50	FNA50	-	-	-	-	FDXM50	FHA50	-
-	FCAG60	FFA60	FBA60	FNA60	-	-	-	-	FDXM60	FHA60	-
-	FCAG125	-	FBA125	-	-	-	-	-	-	FHA125	-

Connectable to RZAG140N7V1B / RZAG140N7Y1B and covered by ENER Lot 21

FCAHG71	FCAG35	FFA35	FBA35	FNA35	FUA71	FAA71	-	FVA71	FDXM35	FHA35	-
FCAHG140	FCAG50	FFA50	FBA50	FNA50	-	-	-	FVA140	FDXM50	FHA50	-
-	FCAG71	-	FBA71	-	-	-	-	-	-	FHA71	-
-	FCAG140	-	FBA140	-	-	-	-	-	-	FHA140	-

ENER Lot 10

Appropriate indoor units


Connectable to RZAG71N7V1B / RZAG71N7Y1B and covered by ENER Lot 10

FCAHG71	FCAG35	FFA35	FBA35	FNA35	FUA71	FAA71	-	FVA71	FDXM35	FHA35	-
-	FCAG71	-	FBA71	-	-	-	-	-	-	FHA71	-

Connectable to RZAG100N7V1B / RZAG100N7Y1B and covered by ENER Lot 10

FCAHG100	FCAG35	FFA35	FBA35	FNA35	FUA100	FAA100	-	FVA100	FDXM35	FHA35	-
-	FCAG50	FFA50	FBA50	FNA50	-	-	-	-	FDXM50	FHA50	-
-	FCAG100	-	FBA100	-	-	-	-	-	-	FHA100	-

3D120939



The present leaflet is drawn up by way of information only and does not constitute an offer binding upon Daikin Europe N.V. Daikin Europe N.V. has compiled the content of this leaflet to the best of its knowledge. No express or implied warranty is given for the completeness, accuracy, reliability or fitness for particular purpose of its content and the products and services presented therein. Specifications are subject to change without prior notice. Daikin Europe N.V. explicitly rejects any liability for any direct or indirect damage, in the broadest sense, arising from or related to the use and/or interpretation of this leaflet. All content is copyrighted by Daikin Europe N.V.

09/2022

